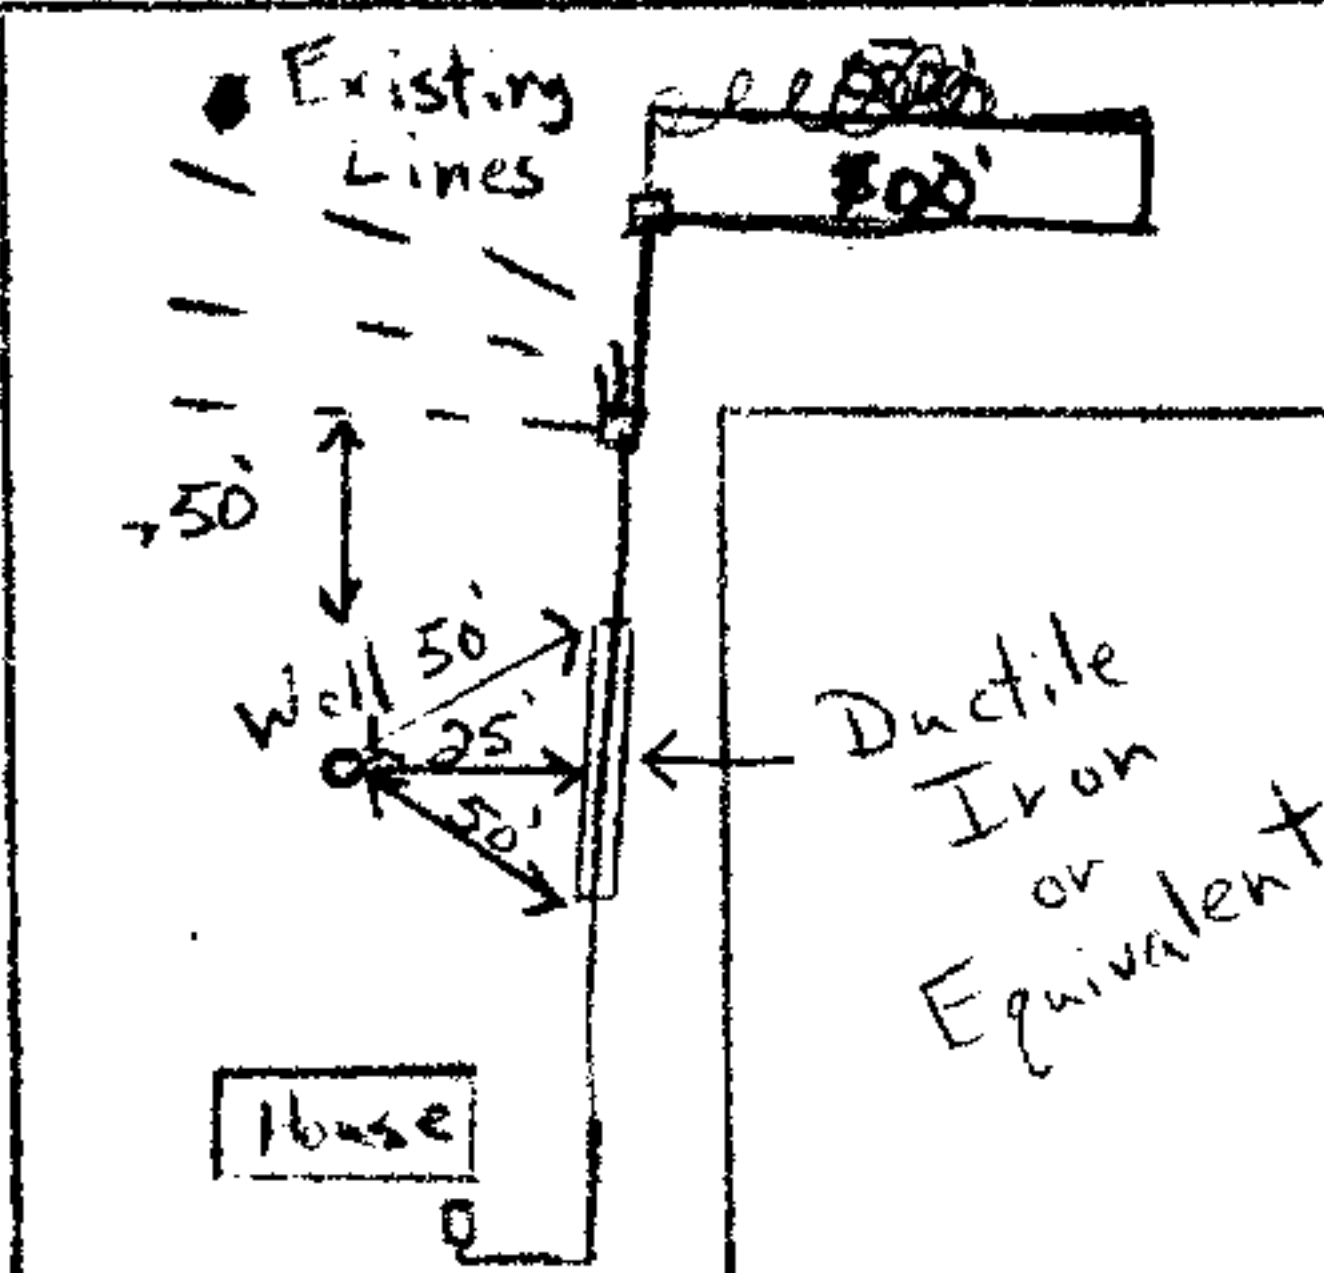


* Expansion Permit

* Installed with EZ Flow.

PERMIT NUMBER 00070

GRANVILLE-VANCE DISTRICT HEALTH DEPARTMENT
IMPROVEMENT AND OPERATION PERMITS

COUNTY:	TAX NO.	TYPE OF ESTABLISHMENTS			*THIS PERMIT SHALL BE ACCOMPANIED BY A LAYOUT SHOWN ON A PLAT, INCLUDING SYSTEM REQUIREMENTS.
Vance	0553 02006	RESIDENCE ☒	NUMBER OF BEDROOMS:	NUMBER OF OCCUPANTS:	
OWNER:	SR. NO.	BUSINESS ☐	3	4	
Sidrick Roberson		OTHER ☐	WELL ☐	OTHER ☐	
APPLICANT'S ADDRESS:		WATER SUPPLY	PUBLIC ☐		*THIS IMPROVEMENT PERMIT IS SUBJECT TO REVOCATION IF THE INTENDED USES CHANGE FROM THOSE SHOWN ON THE IMPROVEMENT PERMIT. CHANGES SHALL REQUIRE HEALTH DEPARTMENT APPROVAL.
66 Epsom Rocky Ford Rd.		TYPE OF WASTEWATER SYSTEM	INITIAL INSTALLATION	REPAIR	
PROPERTY ADDRESS/LOCATION:		DESIGN FLOW:	360 g/day		
Same		LTAR:	.35		
SUBDIVISION:		ABSORPTION AREA:	Add 300 ft ²		
LOT NUMBER:		TRENCH WIDTH:	3'		
REFERENCE SKETCH (SEE PLAT FOR DETAILS)		TRENCH DEPTH:	24"		
		TRENCH SPACING:	9' centers		
		TOTAL TRENCH LENGTH:	Add 100'		
		NUMBER OF TRENCHES:	2		
		GRAVEL DEPTH:	12"		
		TANK SIZE:	Existing		
	PUMP TANK SIZE:	NA			
	DISTRIBUTION DEVICE:	D-box			

PERMIT VALID FOR: 5 YEARS
YES NO

NO EXPIRATION
YES NO

IMPROVEMENT PERMIT

DATE:

FOR:

ISSUED BY:

Mac Shingleton, REHS

7-15-11

CONSTRUCTION AUTHORIZATION FOR IMPROVEMENT PERMIT# 06610

Unless otherwise indicated, the same conditions above apply regarding system type, layout, location and installation requirements.
(The wastewater system cannot be installed until authorization is signed)

Comments:

Date: 7-15-11

Environmental Health Specialist:

Mac Shingleton, REHS

Construction Authorization Addendum ☐ Yes ☒ No

OPERATION PERMIT

DATE:

SYSTEM INSTALLED BY:

TT Beckham

4-13-12

ISSUED BY:

Mac Shingleton, REHS

PERFORMANCE, MONITORING, MAINTENANCE AND OPERATION
AS REQUIRED BY RULE .1961