

OPERATION PERMIT

Granville County Health Dept
Environmental Health
101 Hunt Drive
Oxford, NC 27565
Phone: (252) 492-5263 Fax: (252) 492-2361

For Office Use Only

*CDP File Number 353927 - 1
County ID Number: 193000784150
Evaluated For: NEW

Property Owner: Genesis Buiding Co Inc

Address: 5450 Old Wake Forest Rd

Road #: Ste 102

City: Raleigh

State/Zip: NC/ 27609

Phone #: (919) 669-9491

Township:

Subdivision: Gresham Crossing

Phase : NEW

Lot: 34

Structure: SINGLE FAMILY

of Bedrooms: 3

of People: 6

Water Supply: NEW WELL

Saprolite System?: ☐ Yes ☒ No

Pump Required?: ☐ Yes ☒ No

Design Flow: 360

System Classification/Description: TYPE III B. SYSTEM
W/SINGLE EFFLUENT PUMP

Installer:

Specific System EZFLOW EZ 1203H-GEO

Installed:

STB: 858

PT:

Comments:

Certification #:

Septic Tank Date: 08/12/2021

Pump Tank Date: _____

This system has been installed in compliance with applicable NC General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: Ground absorption sewage treatment and disposal systems shall be checked, and the contents of the septic tank removed, periodically from all compartments, to ensure proper operation of the system. The contents shall be pumped whenever the solids level is found to be more than 1/3 of the liquid depth in any compartment.

Other:

Subsurface Operator Required: ☐ Yes ☒ No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

Operation:

Other:

Authorized State Agent: Stiles, Bailey

Date of Issue: 11/03/2021

Owner/Applicant: Genesis Building CO.

Granville - Vance District Health Department
Environmental Health

Pin 193000784150

Permit Number P-353927

Final Sketch

Genesis Building Co Inc
Applicants Name


Gresham Crossing - 34
Subdivision - Section - Lot
S-240645
W-240650

Physical Address: 4304 S. Greg Allen Way Number of Bedrooms 3

Five County Construction
System Installer

11-3-2021
Date

Drawing
NOT
to scale

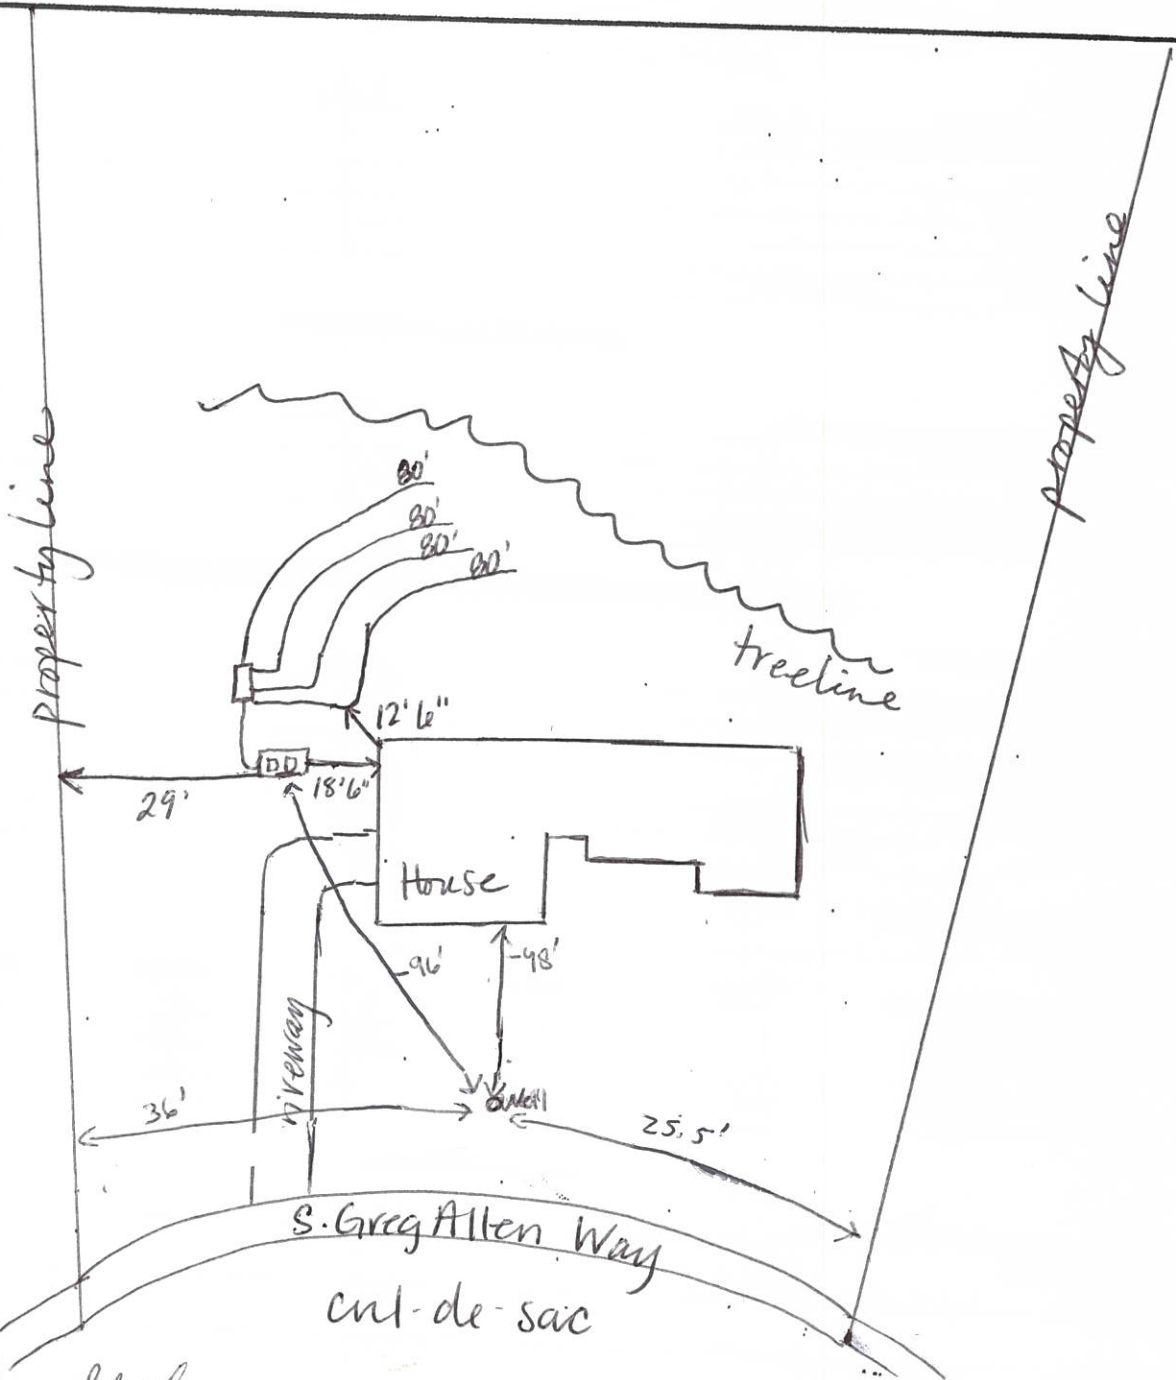

Bailey Stiles
Authorized Signature

11-3-2021
Date

SEWAGE DISPOSAL SYSTEM INSTALLATION REVIEW

SEPTIC AND PUMP TANK INSPECTION

SEPTIC TANK

Manufacturer MILS
 Date of Manufacture 8-17-2021
 Stamp STB 858
 Capacity 1000 gallons
 Tee ✓
 Baffle ✓
 Sealant ✓
 AIR GAP ✓, FILTER ✓, RISER ✓

INITIAL

KBS
 ↓

DATE

11-3-2021
 ↓

PUMP TANK

polylok 68
 Manufacture N/A
 Date of Manufacture N/A
 Stamp ✓
 Capacity ✓
 Sealant ✓
 Manhole ✓
 RISER ✓, SEALANT ✓

KBS
 ↓

11-3-2021
 ↓

MECHANICAL INSPECTION

PUMP

Manufacturer and Model # ✓
 Control Panel ✓
 Alarm ✓
 Electrical Connection ✓
 SEALANT AROUND CONDUIT ✓

KBS
 ↓

11-3-2021
 ↓

NITRIFICATION/DISTRIBUTION AND DRAINFIELD INSPECTION

DISTRIBUTION BOX

Level ✓
 Equal Distribution ✓
 Other ✓

DISTRIBUTION MANIFOLD

Pipe Size ✓
 Gate Valves ✓
 Other ✓

KBS
 ↓

11-3-2021
 ↓

OTHER DISTRIBUTION

Type ✓

NITRIFICATION LINES

Trench Width ✓
 Trench Length ✓
 Trench Grade ✓

EZFlow Depth

LINE 1

3'
 80'
 ✓

LINE 2

3'
 80'
 ✓

LINE 3

3'
 80'
 ✓

LINE 4

3'
 80'
 ✓

LINE 5

LINE 6

WELL INSPECTION

LOCATION OF WELL

COMMENTS:

N-G-Poly

No well drilled at
 the time of SF.

WR

tags

work

elec box

11-3-21

KBS

stigma

work