



IMPROVEMENT PERMIT

Franklin County Health Department
107 Industrial Drive
Louisburg, NC 27549
Phone:

For Office Use Only

*CDP File Number 413190 - 1

County ID Number:

Evaluated For: NEW

PERMIT VALID UNTIL: 05/07/2029

***NOTE TO INSPECTIONS DIVISION:** Building Permits cannot be issued with this Improvement Permit.

Applicant: LISA FERGUSON

Address: 4909 UNICORN DRIVE

City: WAKE FOREST

State/Zip: NC 27587

Phone #:

Property Owner: KEN HARVEY HOMES LLC

Address: 4909 UNICORN DRIVE

City: WAKE FOREST

State/Zip: NC. 27587

Phone #:

Property Location & Site Information

Address: 106 WICHITA WAY LOUISBURG,
NC 27549

Subdivision: LAKE ROYALE

Block/Phase: NEW

Lot: 2742

Directions

Road #:

106 WICHITA WAY

Structure: SINGLE FAMILY

of Bedrooms: 3

of People:

*Water Supply: COMMUNITY

System Specifications

Initial System

Usable Soil Depth: 32

Design Flow: 360

Soil Application Rate: 0.2750

Minimum Trench Depth: Inches

Maximum Trench Depth: 20 Inches

*System Classification/Description:

TYPE III B. SYSTEM W/SINGLE EFFLUENT PUMP

Septic Tank: 1000 Gallons

Pump Required ☒ Yes ☐ No ☐ May Be Required

*Proposed System:

25% REDUCTION

Pump Tank: 1000 Gallons

Repair System Required: ☐ Yes ☒ No ☐ No, but has Available Space

* 15A NCAC 18A. 1945 * Repair Area Exempt

No grading or construction activity is allowed in areas designated for system and repair without approval of Health Department.

*Site Modifications

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements.

*Permit Conditions

INSTALL SYSTEM AS DESIGNED BY CCSC.

The Department and Local Health Department may impose conditions on the issuance and may revoke the permits for failure of the system to satisfy the conditions, the rules, or this article. This permit is subject to revocation if the site plan, plat, or intended use changes (NCGS 130A-335(f)). The person owning or controlling the system location, installing, operation, maintenance, monitoring, reporting, and repair (per rule .0301(f)).

Authorized State Agent: Ennis, Crystal

Date of Issue: 05/07/2024

☐ Hand Drawing

☐ Import Drawing

****Site Plan/Drawing attached.****

Total Time: (HH:MM)

:



Construction Authorization

Franklin County Health Department
107 Industrial Drive
Louisburg, NC 27549
Phone: _____

For Office Use Only

*CDP File Number: 413190 - 1

County ID Number: _____

Evaluated For: NEW

PERMIT VALID UNTIL: 05/07/2029

☐ Open Pump System Sheet

Applicant: LISA FERGUSON
Address: 4909 UNICORN DRIVE
City: WAKE FOREST
State/Zip: NC 27587
Phone #: _____

Property Owner: KEN HARVEY HOMES LLC
Address: 4909 UNICORN DRIVE
City: WAKE FOREST
State/Zip: NC 27587
Phone #: _____

Property Location & Site Information

Address/Road #: 106 WICHITA WAY
LOUISBURG, NC 27549 Subdivision: LAKE ROYALE Phase: NEW Lot: 2742

Directions:

Structure: SINGLE FAMILY 106 WICHITA WAY

of Bedrooms: 3

of People: _____

*Water Supply: COMMUNITY

System Specifications

Usuable Soil Depth: 32

Minimum Trench Depth: _____ Inches

Design Flow: 360

Maximum Trench Depth: 20 Inches

Soil Application Rate: 0.2750

Minimum Soil Cover: _____ Inches

*System Classification/Description:

TYPE III B. SYSTEM W/SINGLE EFFLUENT PUMP

Maximum Soil Cover: _____ Inches

*Proposed System:

25% REDUCTION

*Distribution Type: PRESSURE MANIFOLD

Nitrification Field: _____ Sq. ft.

Septic Tank: 1,000 Gallons

No. Drain Lines: 5

Pump Required: ☒ Yes ☐ No ☐ May Be Required

Total Trench Length: 350 ft.

☐ Inches O.C.

Pump Tank: 1,000 Gallons

☐ Feet O.C.

Trench Spacing: _____ - _____

☐ Inches

Grease Trap: _____ Gallons

Trench Width: _____ - _____

☐ Feet

Aggregate Depth: _____ inches

Septic Tank Installer

Grade Level Required: ☐ I ☐ II ☐ III ☐ IV

The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements.

*Permit Conditions:

INSTALL SYSTEM AS DESIGNED BY CCSC.

The Authorization for Wastewater System Construction shall be valid for a period equal to the period of validity of the Improvement Permit and may be issued at the same time the Improvement Permit issued (NCGS 130A-336(b)). If the installation has not been completed during the period of validity of the Construction Permit, the information submitted in the application for a permit or Construction Authorization shall become invalid, and may be suspended or revoked (.0204(k)(1)). The person owning or controlling the system shall be responsible for assuring compliance with the laws, rules, and permit conditions regarding system location, installation, operation, maintenance, monitoring, reporting and repair (per rule .0301(a)).

Authorized State Agent: Ennis, Crystal Date of Issue: 05/07/2024

☐ Hand Drawing ☐ Import Drawing

Site Plan/Drawing attached.

Total Time : (HH:MM) _____



File# 413190 PIN# _____

Property Address: 106 Wichita Way

Applicant Or Owner Name: Lisa Ferguson

Environmental Health Septic/Well Permit Diagram

Building permits cannot be issued nor should construction begin without Construction Authorization issuance.

☒ Septic Improvement Permit ☒ Septic Construction Authorization (CA) ☐ CA Reissue** ☐ As Built

☐ Well Construction Authorization ☒ Additional Diagram/Specifications Attached

Diagram Date**: 5-7-24 EHS: Cynthia E...

****Any previously dated CA diagram is revoked and/or invalid. Confirm this is the valid diagram for the site before beginning any construction.**

Installation inspections may be scheduled the day before or the day of installation by 9am. Contact the Environmental Health office at 919 496-8100. A revisit fee may apply if installation is not ready for inspection at the time requested. SEPTIC OPERATIONS PERMITS will be issued after installation is approved, all permit conditions are met, and any outstanding fees are paid. WELL CERTIFICATE OF COMPLETION will be issued after well head approval, all permit conditions are met, and any outstanding fees are paid.

Septic Tank 1000 Pump Tank 1000 Drain field 3'x350' Type System PtoAcc Max trench depth 20"


Septic Contractor _____ Septic/Pump tank dates _____ PUMP FEE PAID _____

Well Contractor _____ Well Head Date: _____ PUMP FINAL: _____ N/A (CIRCLE)

** See attached layout and tap charts designed by CCSC*

System: Pressure Manifold
 Lines: 1-5, (350')
 Accepted Status System
 0.275 Soil LTAR
 20" Trench Bottom

System: ———

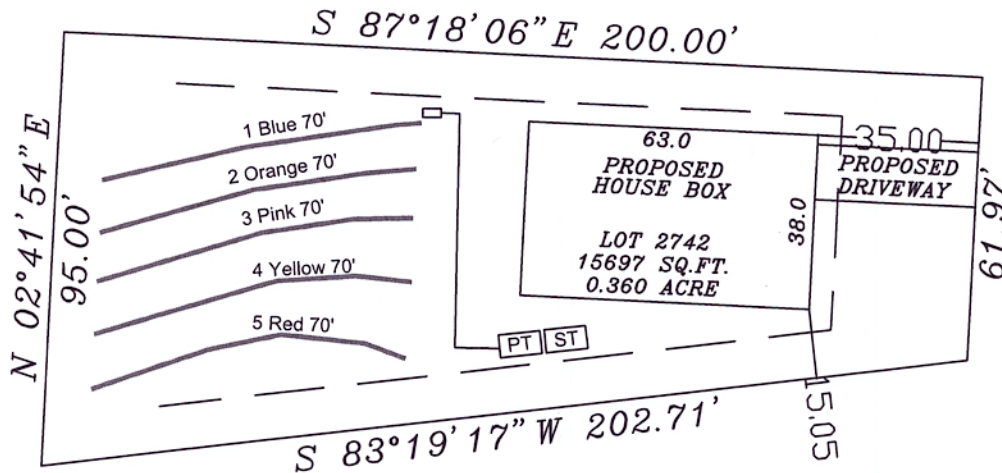

WICHITA WAY
 60' R/W

- *Keep tanks and drain lines 10' from property lines.
- *Not a survey.
- *Not a guarantee of a septic permit.
- *Keep supply lines >5' from property lines.
- *Some lines are flagged longer in the field than lengths indicate.
- *No grading septic area.

SCALE:
 1" = 40 ft.
 0 20 40



Central Carolina Soil Consulting, PLLC
 1900 South Main Street, Suite 110
 Wake Forest, North Carolina 27587
 Phone (919)569-6704 Fax (919)569-6703

3-Bedroom Septic Layout
 Lot 2742, Lake Royal Subdivision
 Franklin County, North Carolina

Job# : 4381

Drawn By : AH

Date : 6/6/2023

Revision:

Lake Royale Lot 2742 System Tap Chart

Bench Mark			Elevation Head							1.40
Pump tank elev.			100.00	Pump elev.	95.00	Manifold elev.			96.40	
line	color	rod read	Elevation	length	hole size	flow/tap	gal/day	trench area	LINE LTAR	
1	Blue	4.60	95.40	70	1/2in SCH 40	7.11	72.00	210	0.3429	
2	Orange	4.70	95.30	70	1/2in SCH 40	7.11	72.00	210	0.3429	
3	Pink	5.00	95.00	70	1/2in SCH 40	7.11	72.00	210	0.3429	
4	Yellow	5.70	94.30	70	1/2in SCH 40	7.11	72.00	210	0.3429	
5	Red	6.30	93.70	70	1/2in SCH 40	7.11	72.00	210	0.3429	
0										
		total	feet =	350	gal/min =	35.55	LTAR =		0.2750	
LTAR + %5									0.2888	
% of Dose Vol.		75	Des. Flow		360	(ltar W/ INOV)		0.3667		
Dose Volume		170.63	Pump Run=		10.13	(ltar W/ INOV + 5%		0.3850		
Dose Pump Time		4.80	Tank Gal/IN		19.65					
Drawdown in Inches		8.68								



Health Department
107 Industrial Drive, Suite C
Lenoir, NC 28649
Phone: 919-436-2333
Fax: 919-436-8122
www.franklincountync.us

FRANKLIN COUNTY ENVIRONMENTAL HEALTH SEPTIC SYSTEM PUMP REQUIREMENTS

PUMP SYSTEM FEE

An additional fee of fifty dollars (\$50.00) is assessed when a pump and related equipment are required for a new septic system. This fee must be paid prior to the Operations Permit being issued. Franklin County Environmental Health requests the fee be paid before beginning the septic installation to ensure the final inspection is successful. The septic permit will not be signed off and a CO cannot be achieved until this fee is paid. This fee may be paid in person or by mail at:

Franklin County Health Department
Environmental Health Section
107 Industrial Dr, Suite C
Lenoir NC 28649

When making payment, please provide the permit number and the applicant name to ensure the payment is applied to the correct permit.

PUMP TO GRAVITY DISTRIBUTION

Unless otherwise noted on your septic permit or related attachments, the minimum type distribution method for your septic system is by means of a distribution box (D-box). This is achieved by pumping the wastewater to a D-box and allowing gravity to naturally disperse the wastewater equally to each drain line. This type distribution may be used for up to four (4) drain line laterals. The D-box should be watertight. The supply line to be terminated in the D-box with a 90 degree elbow directed downwards to prevent "backflow" action of the wastewater. The D-box location should be marked on-site to make it easily identifiable and prevent damage.

REQUIREMENTS FOR PUMP SYSTEMS (Pump to conventional, pressure-manifold, or LPP)

The following requirements must be met, in addition to the requirements on the permit itself:

Tanks and Risers:

All tanks shall be constructed according to plans which have been approved by the Division of Environmental Health.
pump tanks shall have a riser which extends to at least 8" above the finished grade (riser is recommended on septic tank)
pump tanks should be of "one piece" construction; if not, it shall be tested for water tightness by the approved method (if a soil water test condition exists within 5' of the tank top) - tests must be properly sealed to the top of the tank.
pipes shall be properly sealed into the tank.
pipes and conduits must exit floor through "kick-out" provided vent shall be installed on pump tank if over 30' from facility.

Supply Line:

supply line shall be Schedule 40 PVC or stronger
supply line shall have a check-valve, gate valve, and a threaded union (in order to allow easy removal of pump) - corrosion resistant tops or chain steel also be connected to pump
supply line into box shall be allowed with a 90 and extended down to within 2" of the bottom of the distribution box
supply line shall be properly sealed at pump tank and box.

Electrical:

all connections, pump controllers, and alarm components shall be enclosed in a NEMA 4X (weatherproof) enclosure
enclosure shall be securely mounted on a treated 4x4 post, adjacent to the pump tank, and at least 12" above grade
wires from pumps and control floats shall be conveyed from the rear to the control panel through sealed electrical conduit (shall be sealed to be watertight and gas-tight)
outlet plugs shall be used, with no splices in the wire cable
control floats shall be sealed mercury type
control floats shall be suspended from a PVC arm or "Christmas Tree" foot from the supply line) for unrestricted movement.

Alarm System:

power to high-voltage alarm shall be on a separate circuit from power to the pump
alarm shall be audible and visible to system operator
alarm system shall be NEMA 4X or equivalent if mounted outside
NEMA 4X junction box, containing a means of disconnection for the alarm float, shall be provided adjacent to the pump tank. If the alarm panel is located inside the facility

****electrical service or a generator must be available for final inspection in order to check pump and alarm system