



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2023
MidTown Designs Inc.
All Rights Reserved


THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 EDITION (2021 IRC)
NC (2018 NRC) / AND - 118 - 120 rps

Summer Construction
LOT 13 PRESERVE
AT NORRICK CREEK
HATTERAS V
GARAGE RIGHT

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE
2/6/2024

PROJECT #
231103

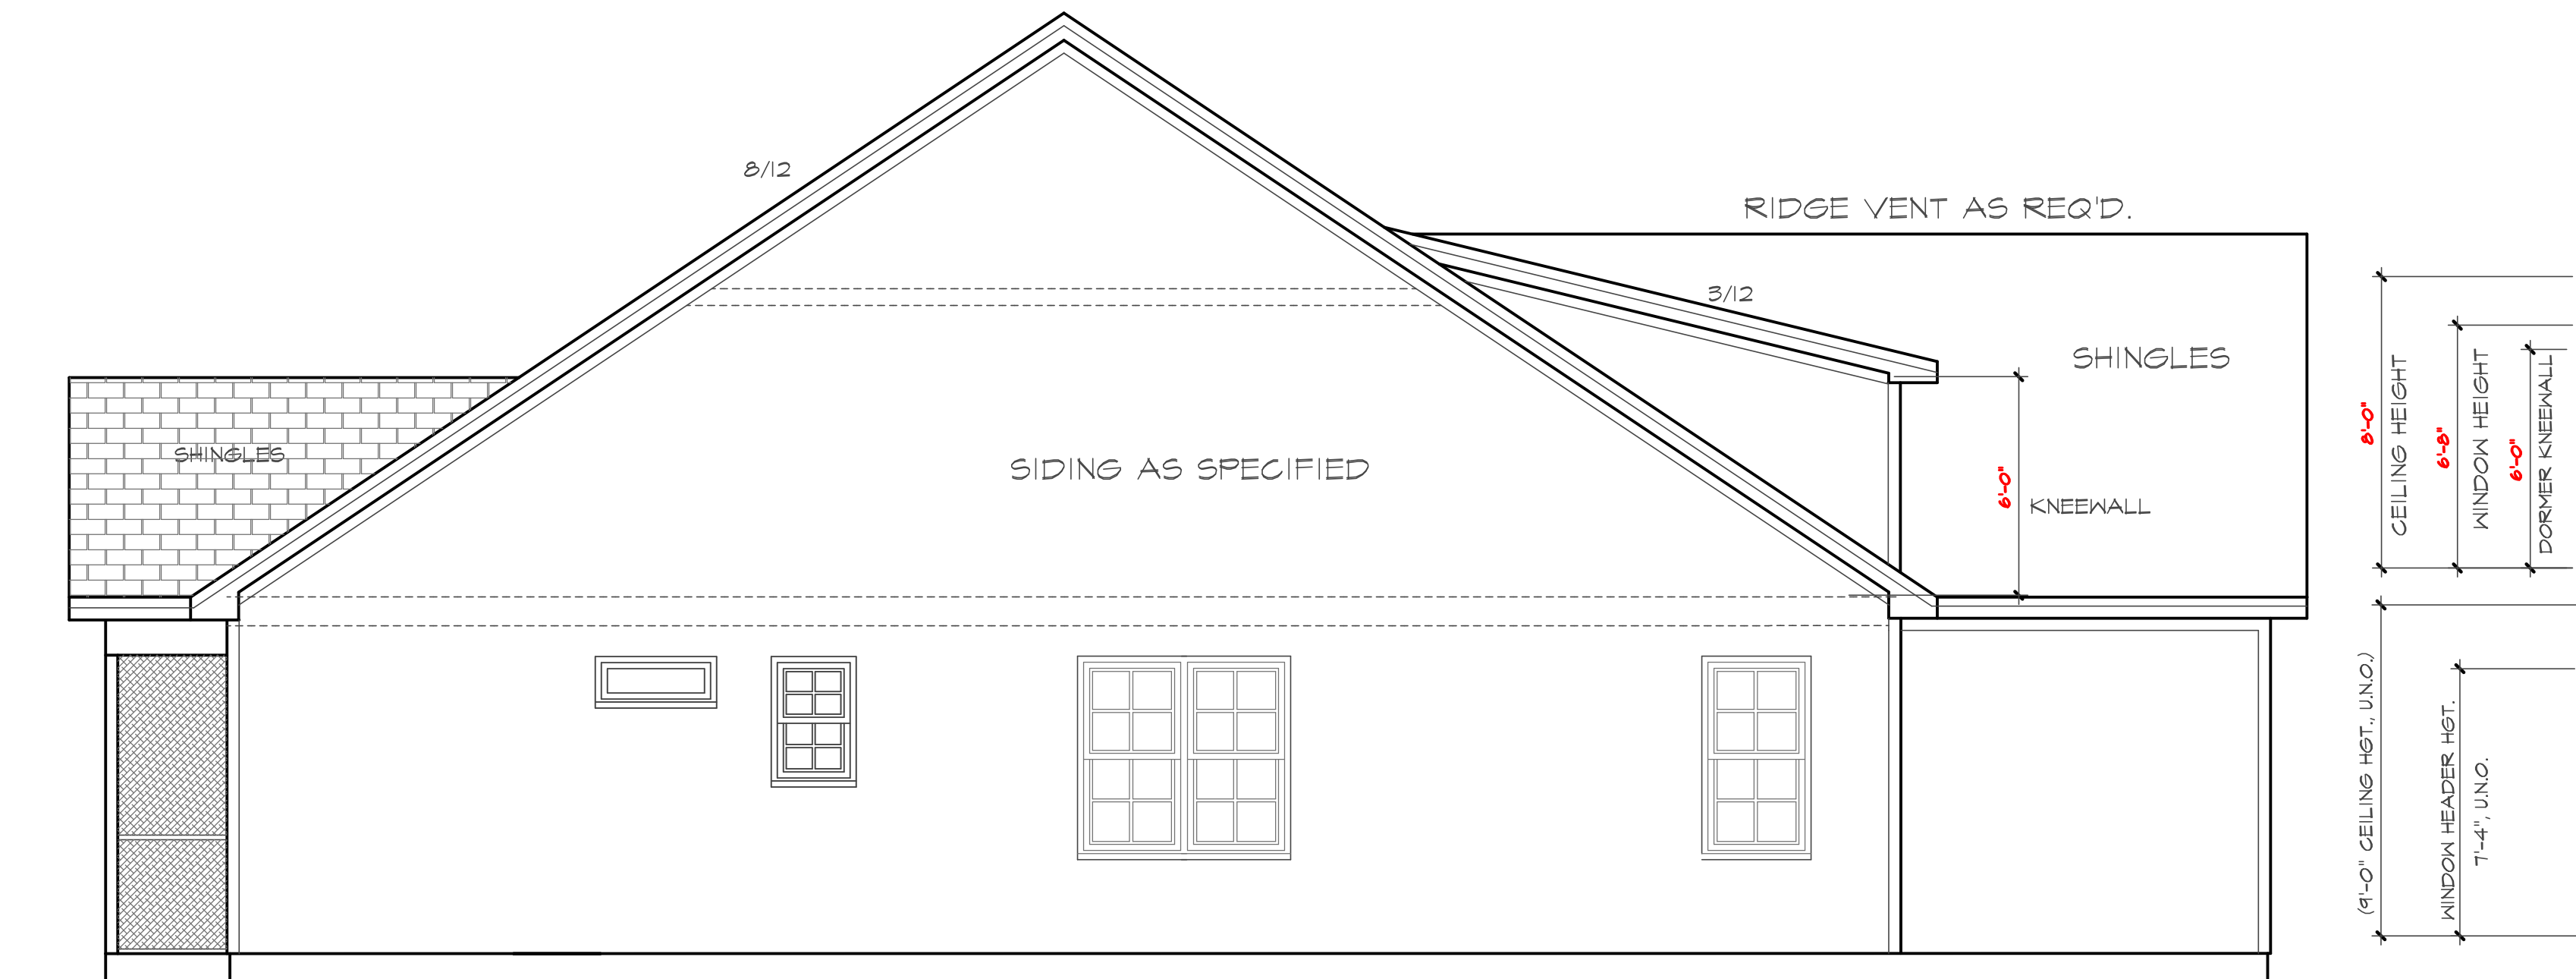


LEFT SIDE ELEVATION




FRONT ELEVATION
SCALE 1/4" = 10'

ATTIC VENTILATION
THE NET FREE VENTILATING AREA SHALL BE NOT LESS THAN 1 TO 150
OF THE AREA OF THE SPACE VENTILATED EXCEPT THAT THE AREA MAY
BE 1 TO 300 PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED
VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE
UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET
ABOVE THE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE
REQUIRED VENTILATION TO BE PROVIDED BY EAVE OR CORNICE VENTS.

ATTIC VENTILATION
GROSS ATTIC AREA TO BE VENTILATED - 1799 SQ. FT.
1799/300 = 5.99 SQ. FT. NET FREE AREA
50% OF VENTING MUST BE 3 FEET ABOVE THE EAVE OR SOFFIT VENTS

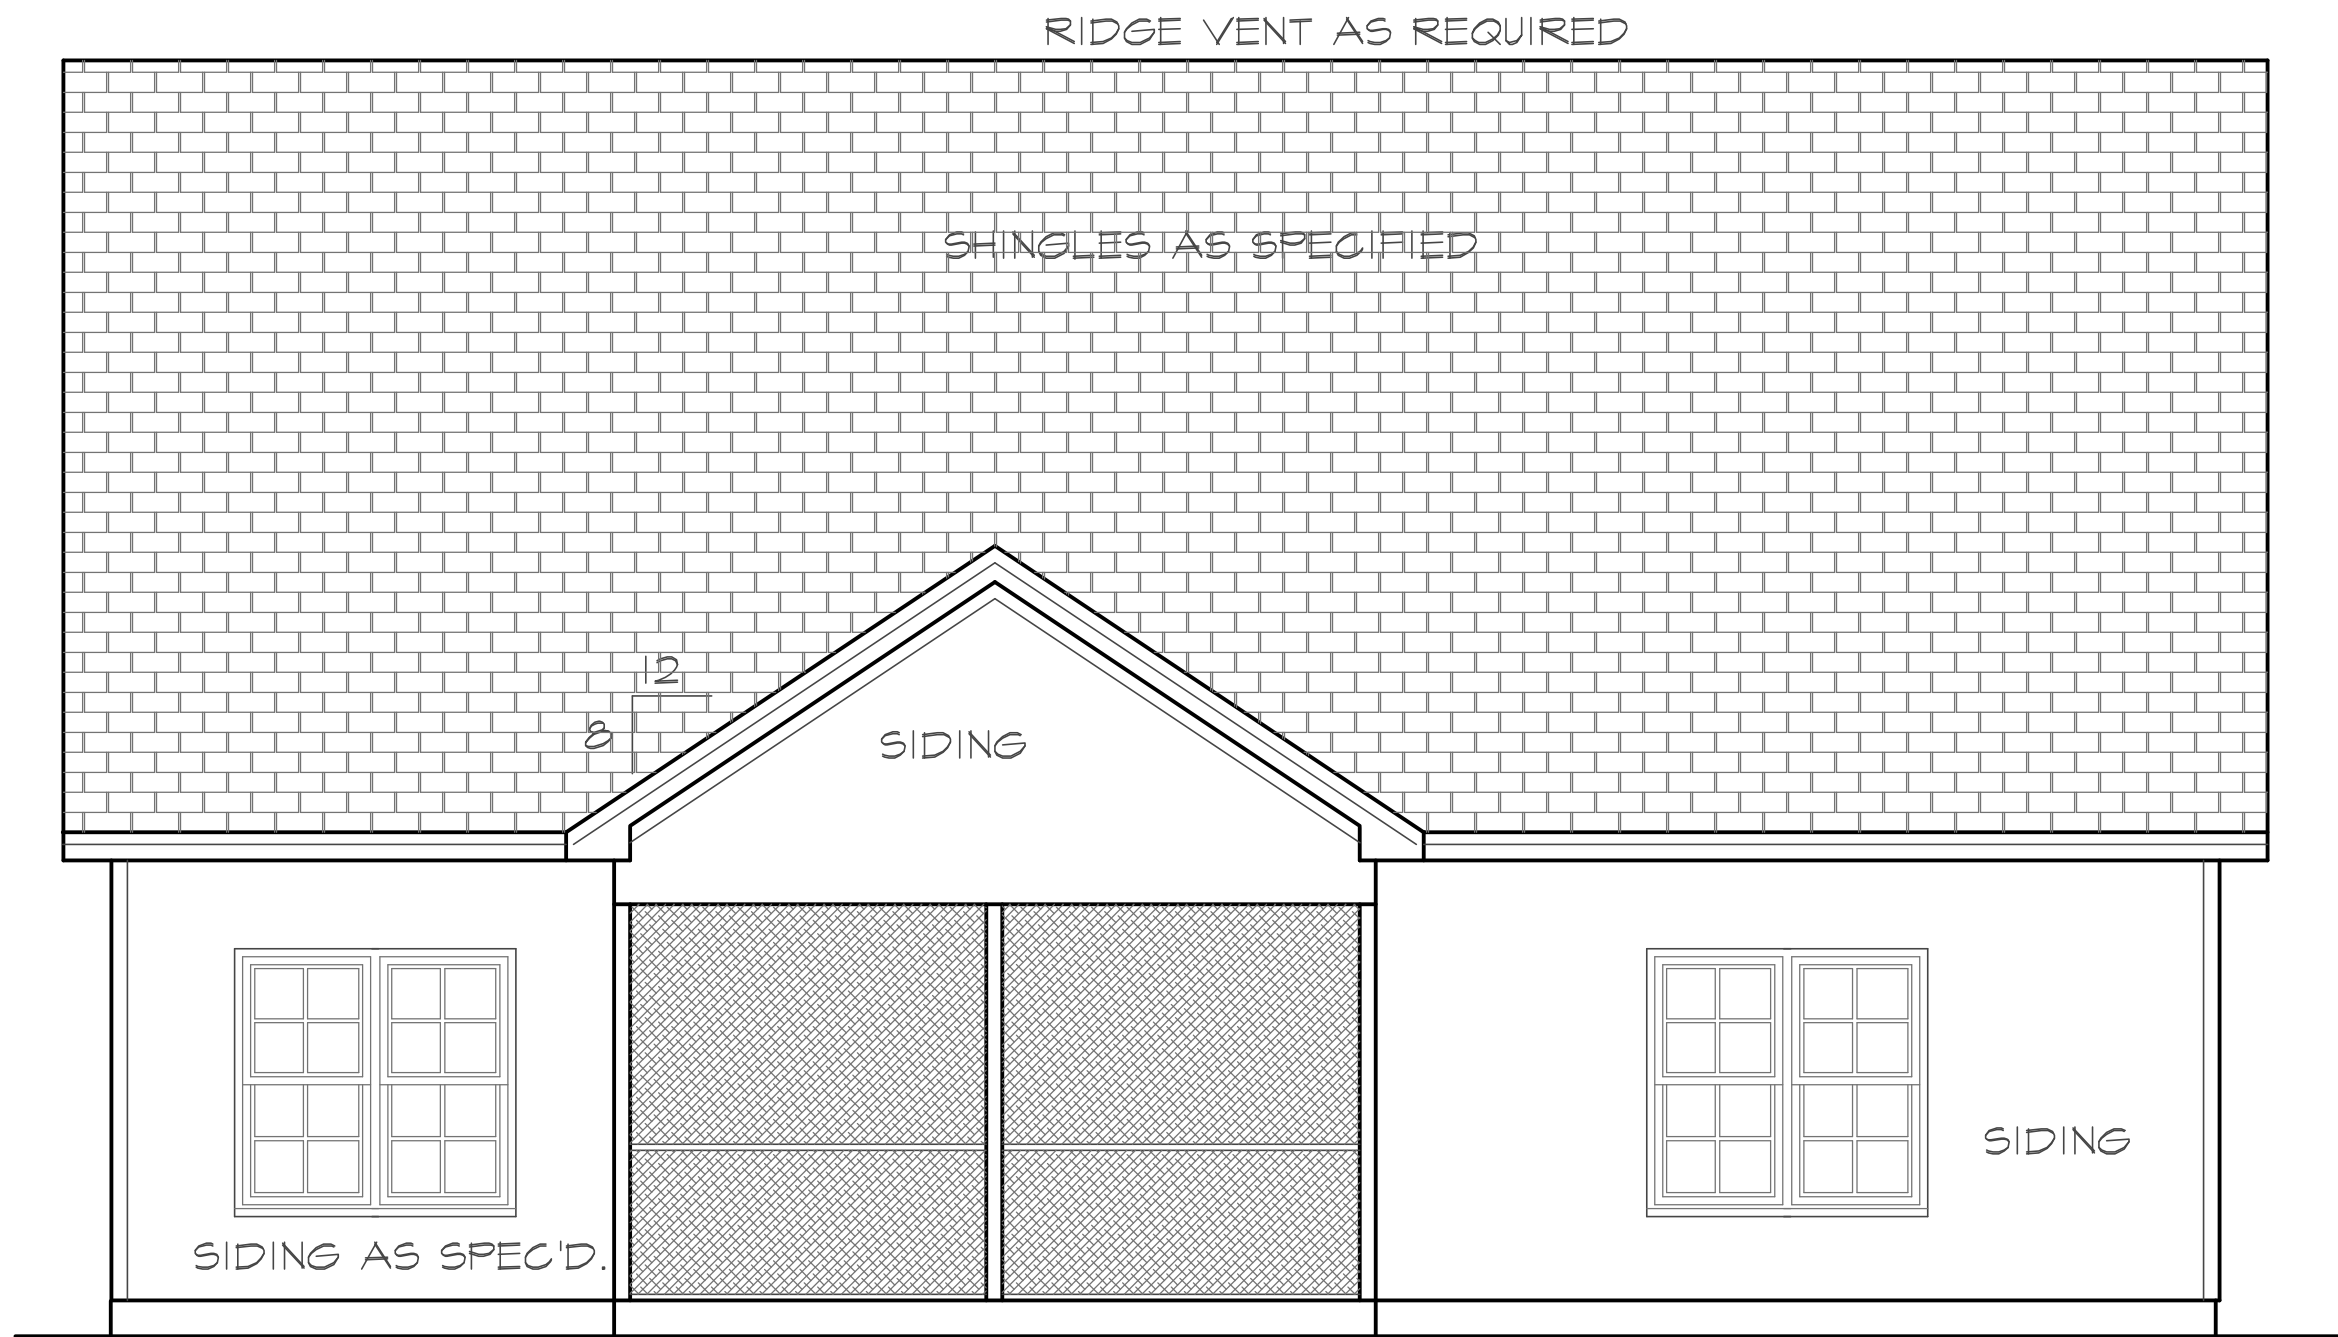

REAR ELEVATION

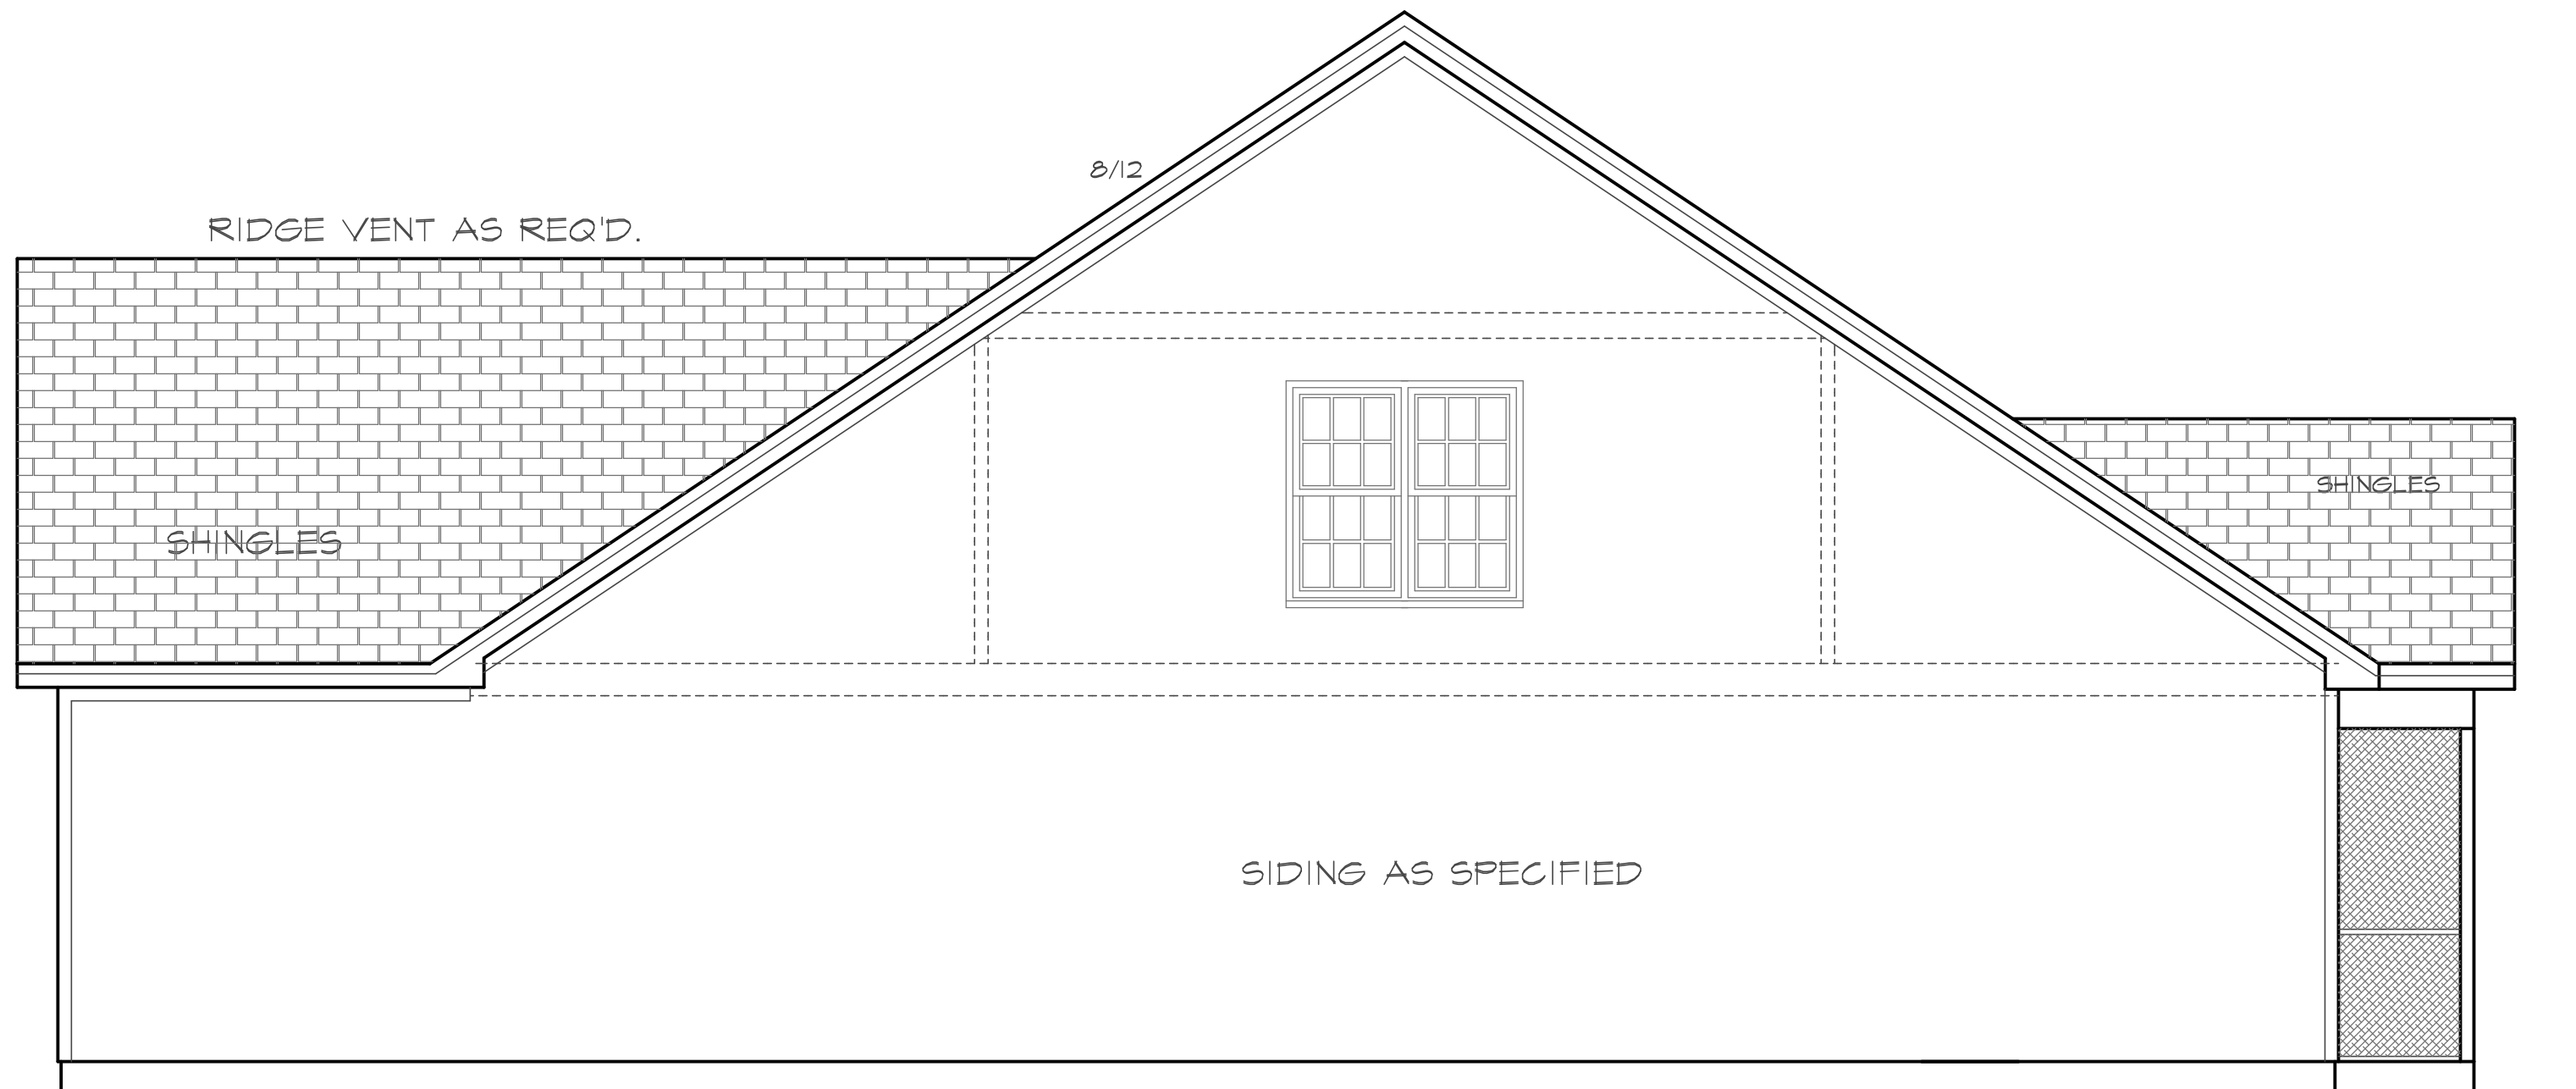

RIGHT SIDE ELEVATION



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

Copyright 2023
MidTown Designs Inc.
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 IRC
NC (2018 NRC) ; AM18 - 118 - 120 rps

Summer Construction
HATTERAS V
LOT 13 PRESERVE
AT NORRICK CREEK
GARAGE RIGHT

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE
2/6/2024



PROJECT #
231103

FOUNDATION STRUCTURAL NOTES:

- (1) (3) 2 x 10 SFF #2 GIRDER DROPPED, TYPICAL UNO.
- (2) CONCRETE BLOCK PIER SIZE SHALL BE:
SIZE HALLOW MASONRY SOLID MASONRY
8 x 16 UP TO 32" HIGH UP TO 5'-0" HIGH
12 x 16 UP TO 48" HIGH UP TO 9'-0" HIGH
16 x 16 UP TO 64" HIGH UP TO 12'-0" HIGH
24 x 24 UP TO 96" HIGH
WITH 50" x 50" x 10" CONCRETE FOOTINGS, UNO.
- (3) WALL FOOTING AS FOLLOWS:
DEPTH: 8" - UP TO 2-1/2 STORY
10" - 3 STORY
WIDTH: SIDING (OR EQUAL)
- 16" - UP TO 2-1/2 STORY
- 18" - 3 STORY
BRICK VENEER
- 16" - 1 STORY
- 20" - 2 STORY
- 24" - 3 STORY
FOR FOUNDATION WALL HEIGHT AND BACKFILL REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R404.1.1 (1 THRU 4)
NOTE: ASSUMED SOIL BEARING CAPACITY = 2000 PSF.
CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.
ATTACH SILL PLATE WITH 1/2"dia. ANCHOR BOLTS AT 6'-0" CENTERS (1" EMBEDMENT) AND 12" FROM EACH PLATE END. (SECTION R 403.1.6)
4 " " DESIGNATES A SIGNIFICANT POINT LOAD TO HAVE SOLID BLOCKING TO PIER, SOLID BLOCK ALL BEAM BEARING POINTS NOTED TO HAVE THREE OR MORE STUDS TO FND, TYPICAL.
5 ABBREVIATIONS:
"SJ" = SINGLE JOIST
"DJ" = DOUBLE JOIST
"TJ" = TRIPLE JOIST

FOUNDATION VENTING

SECTION R408 UNDER FLOOR SPACE
R408.1 Ventilation. The under-floor space between the bottom of the floor joists and the earth (except any building space occupied by a basement or cellar) shall be provided with ventilation openings through foundation walls or exterior walls. The minimum net area of ventilation openings shall not be less than 1 square foot for each 150 square feet (13.7 m squared) of under-floor space area. One such ventilating opening shall be within 3 feet (914 mm) of each corner of said building.
CRAWL AREA TO BE VENTED: 1384 SQ.FT.
1384/1500 = 9226 NET FREE VENTING AREA REQUIRED
R408.2 Ground Vapor Retarder
A minimum 6 mil. polyethylene vapor retarder shall be installed to cover all earth in the crawl space with joints lapped not less than 12"

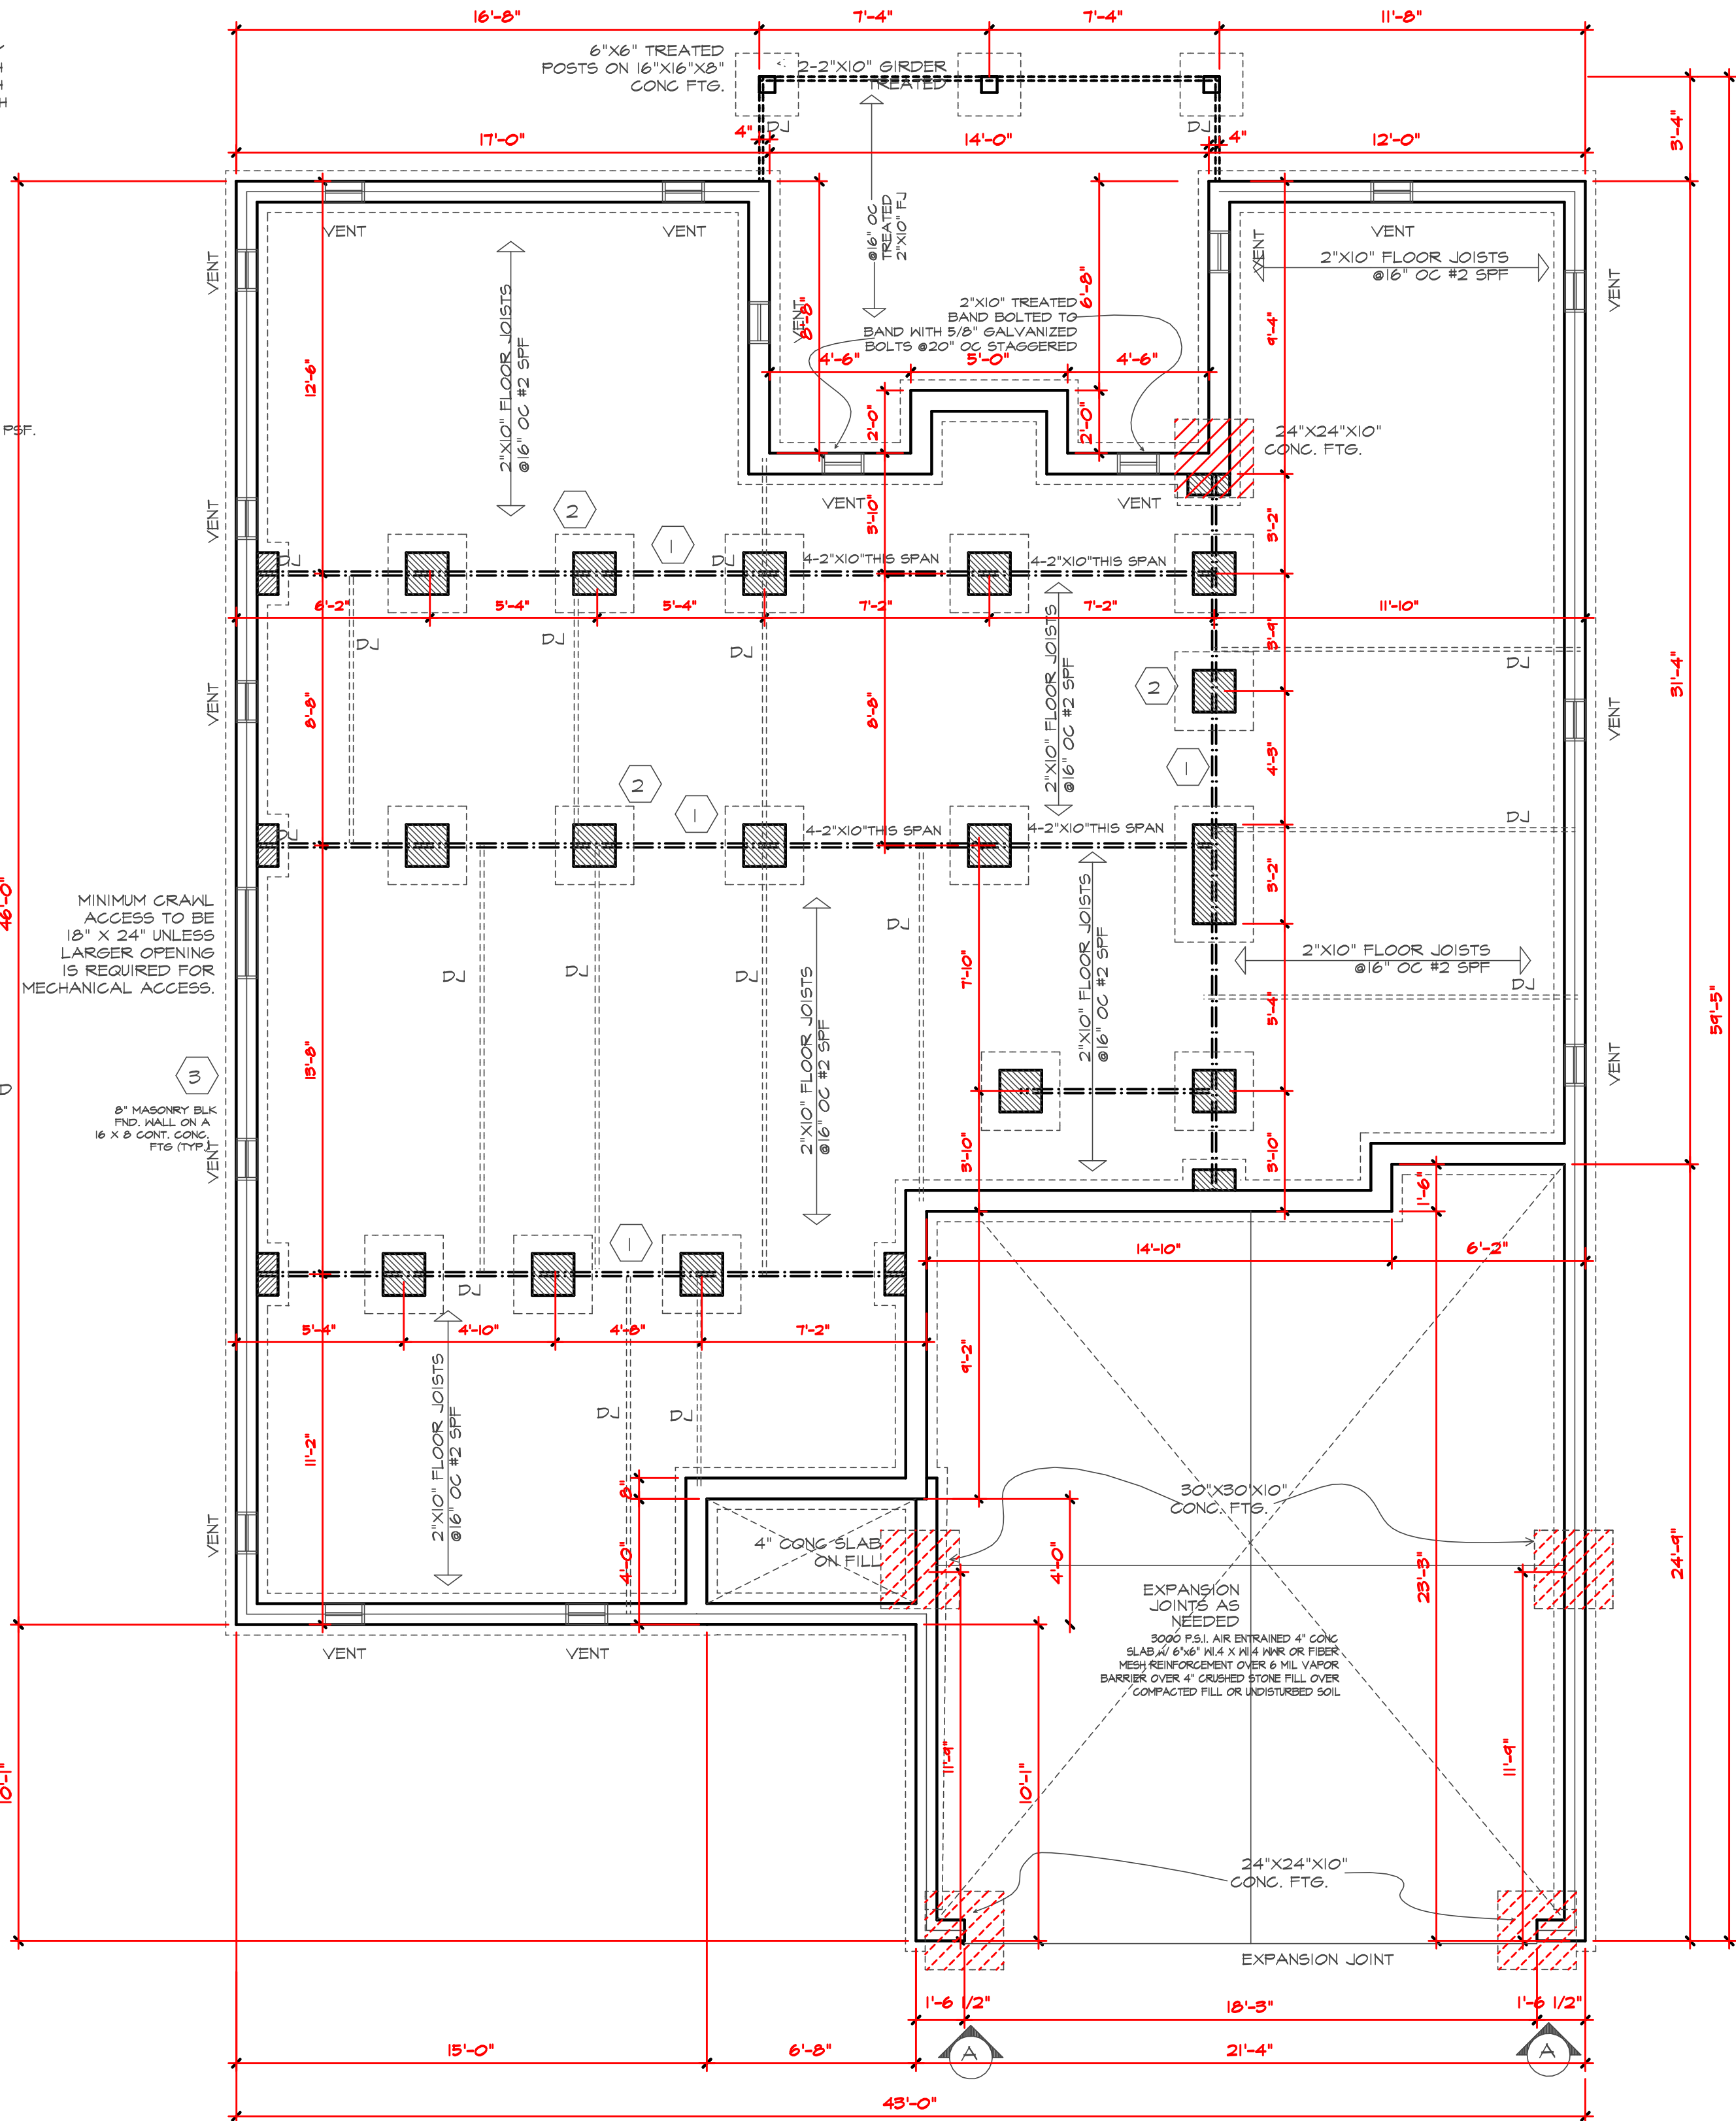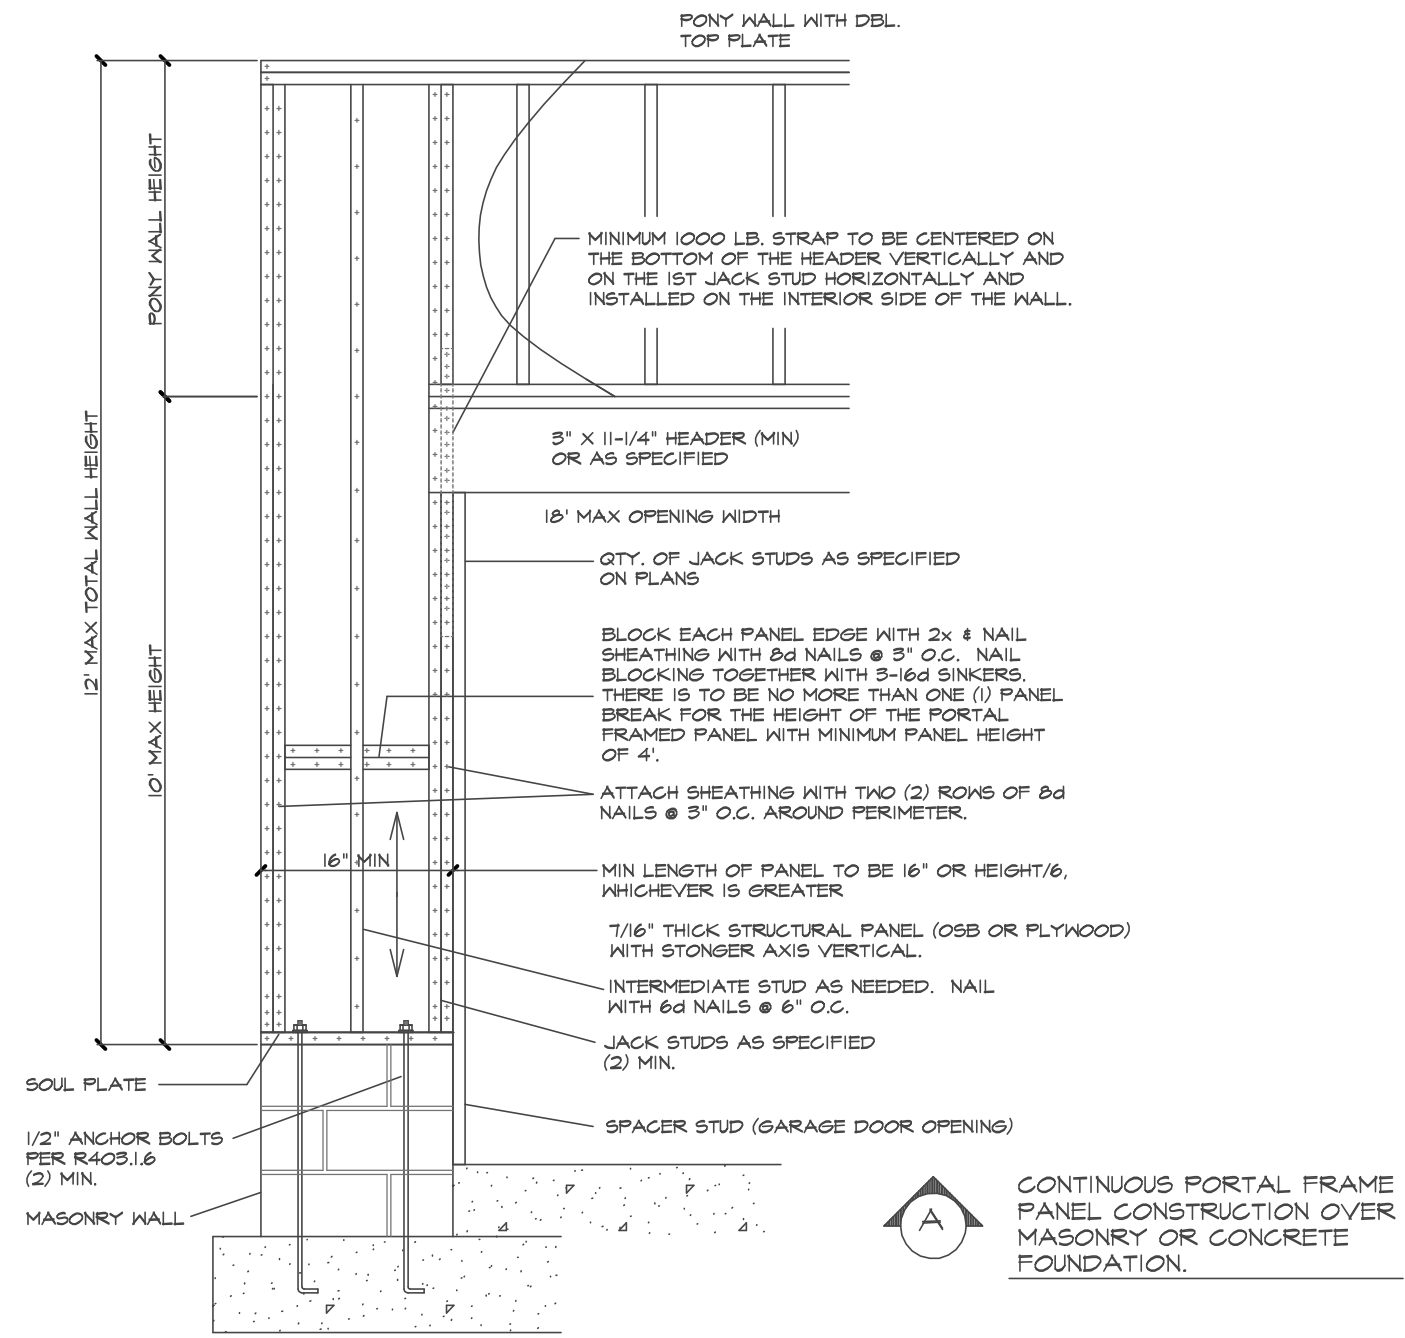

FOUNDATION PLAN
SCALE 1/4" = 1'-0"



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2023
MidTown Designs Inc.
All Rights Reserved





THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 EDITION (2021 IRC)

Summer Construction
LOT 13 PRESERVE
AT NORRICK CREEK
HATTERAS V
GARAGE RIGHT


DATE
2/6/2024

PROJECT #
231103

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

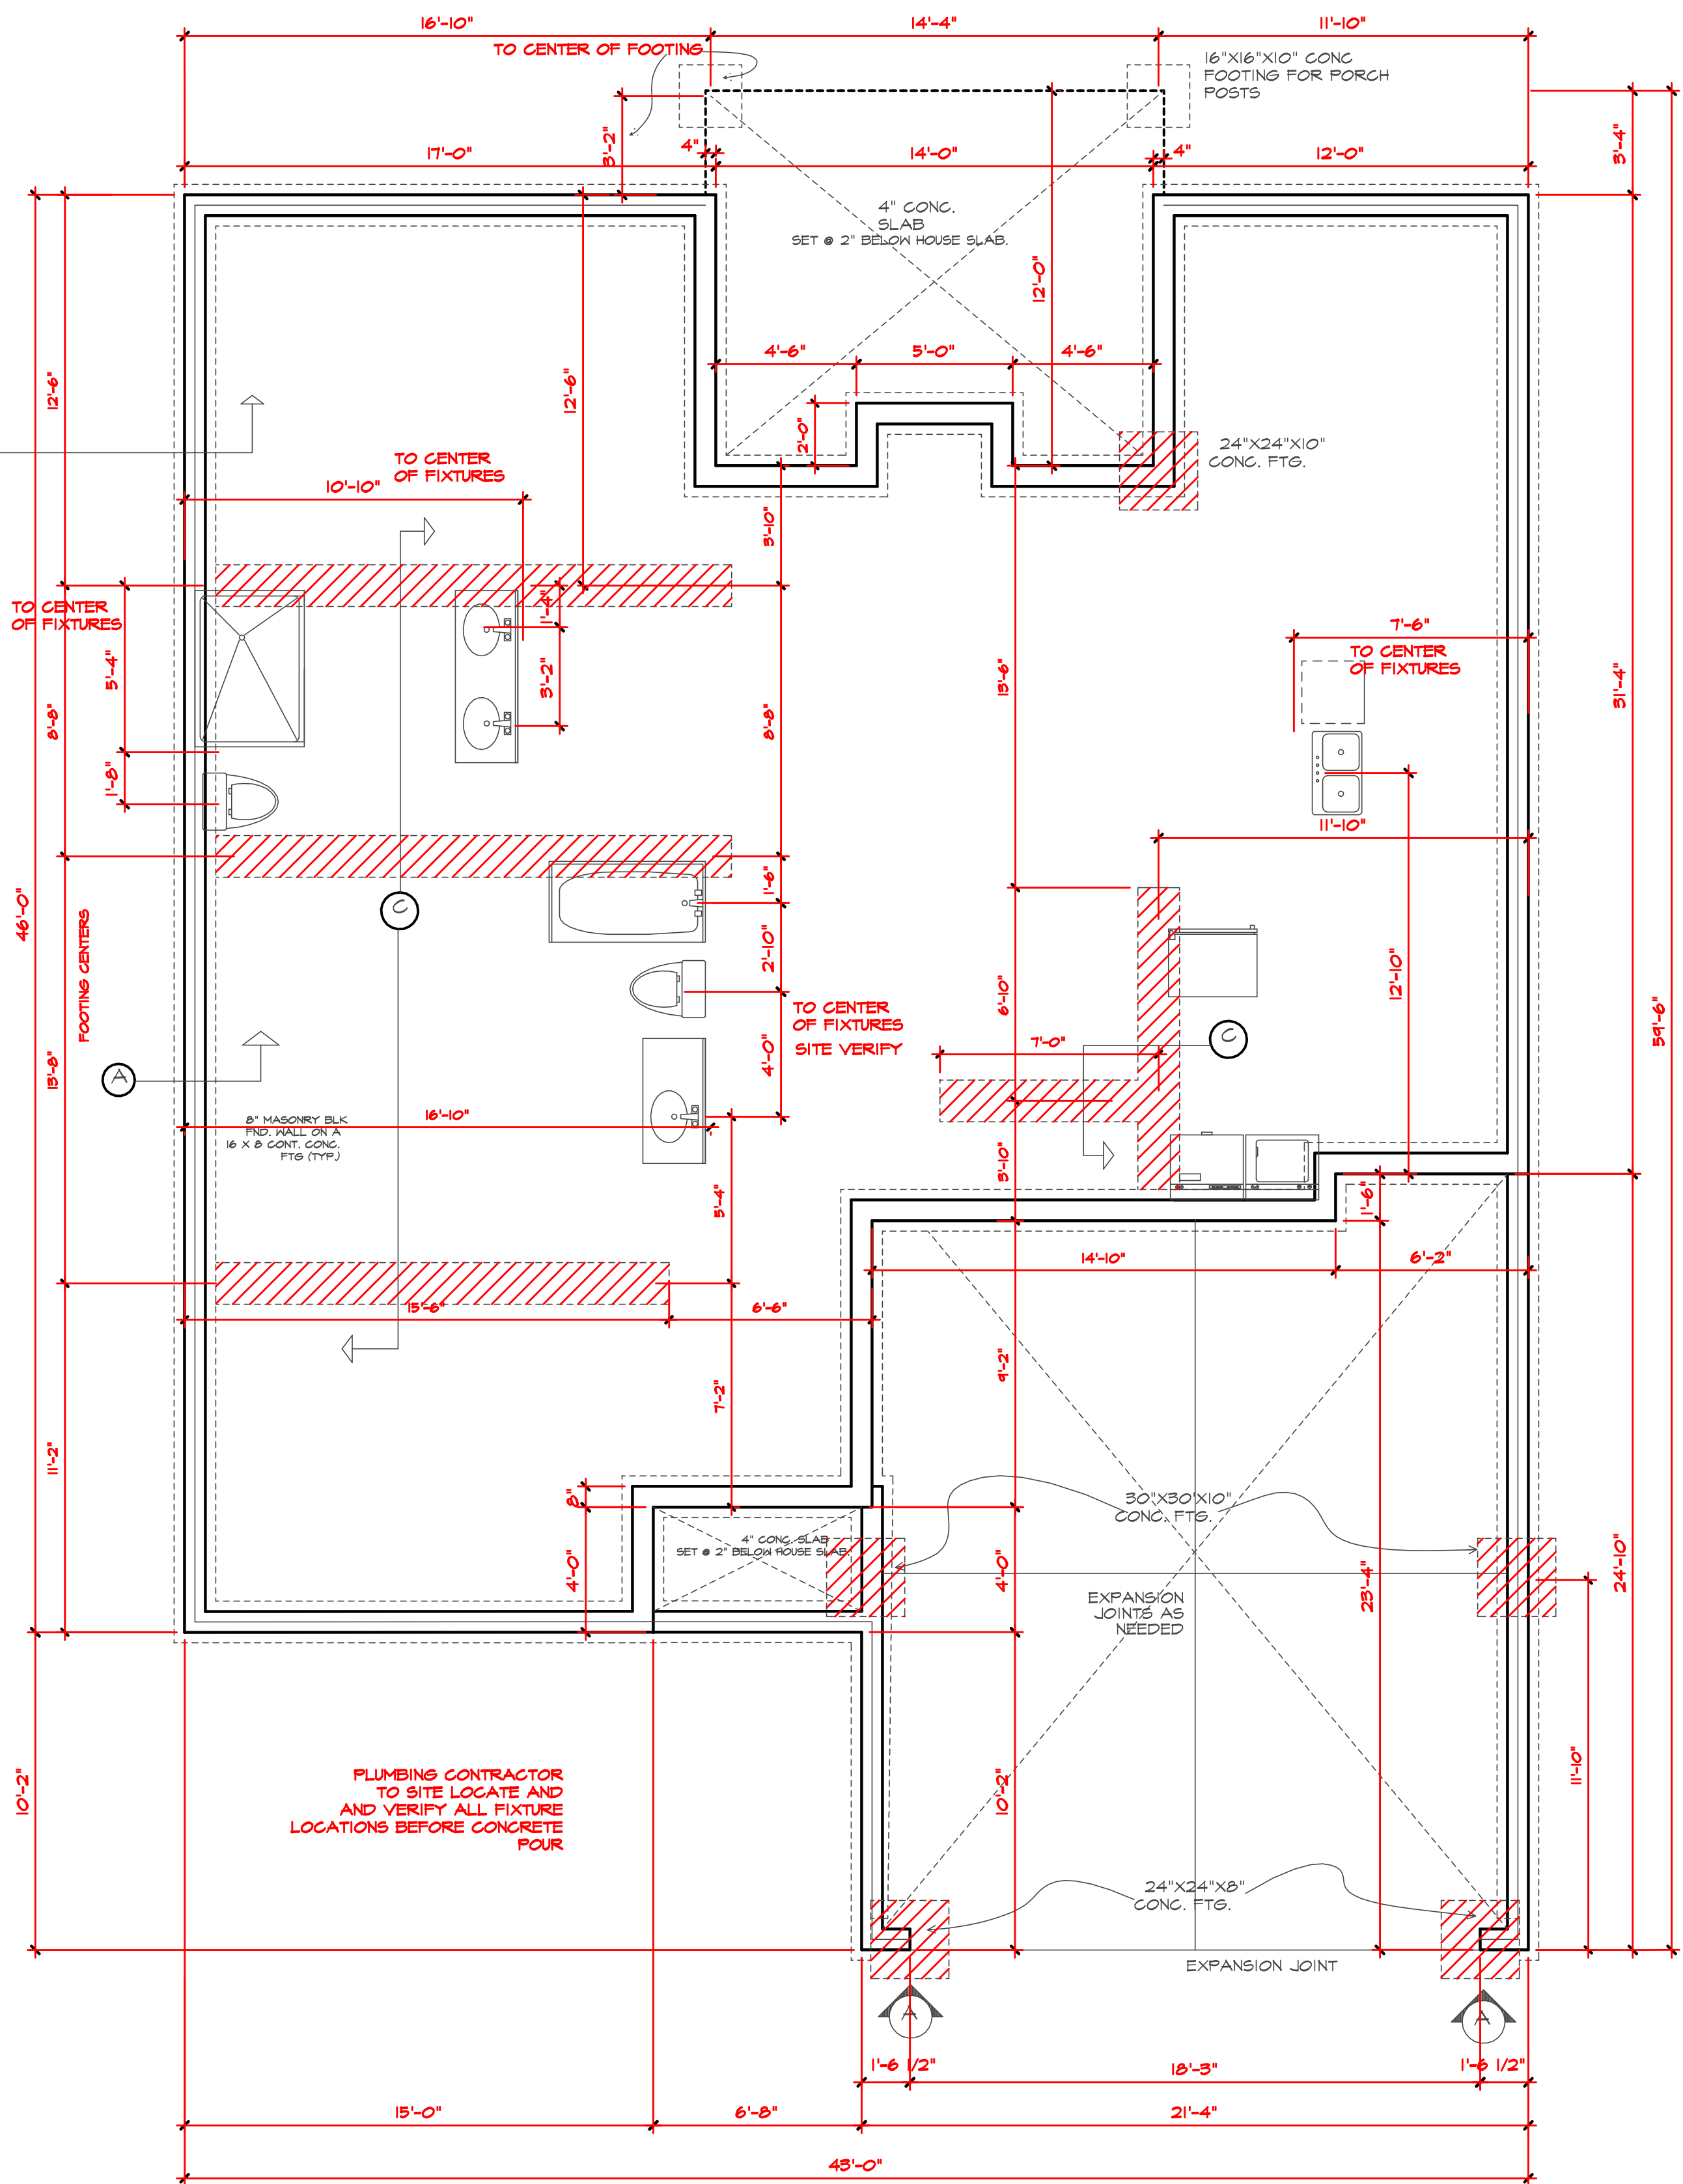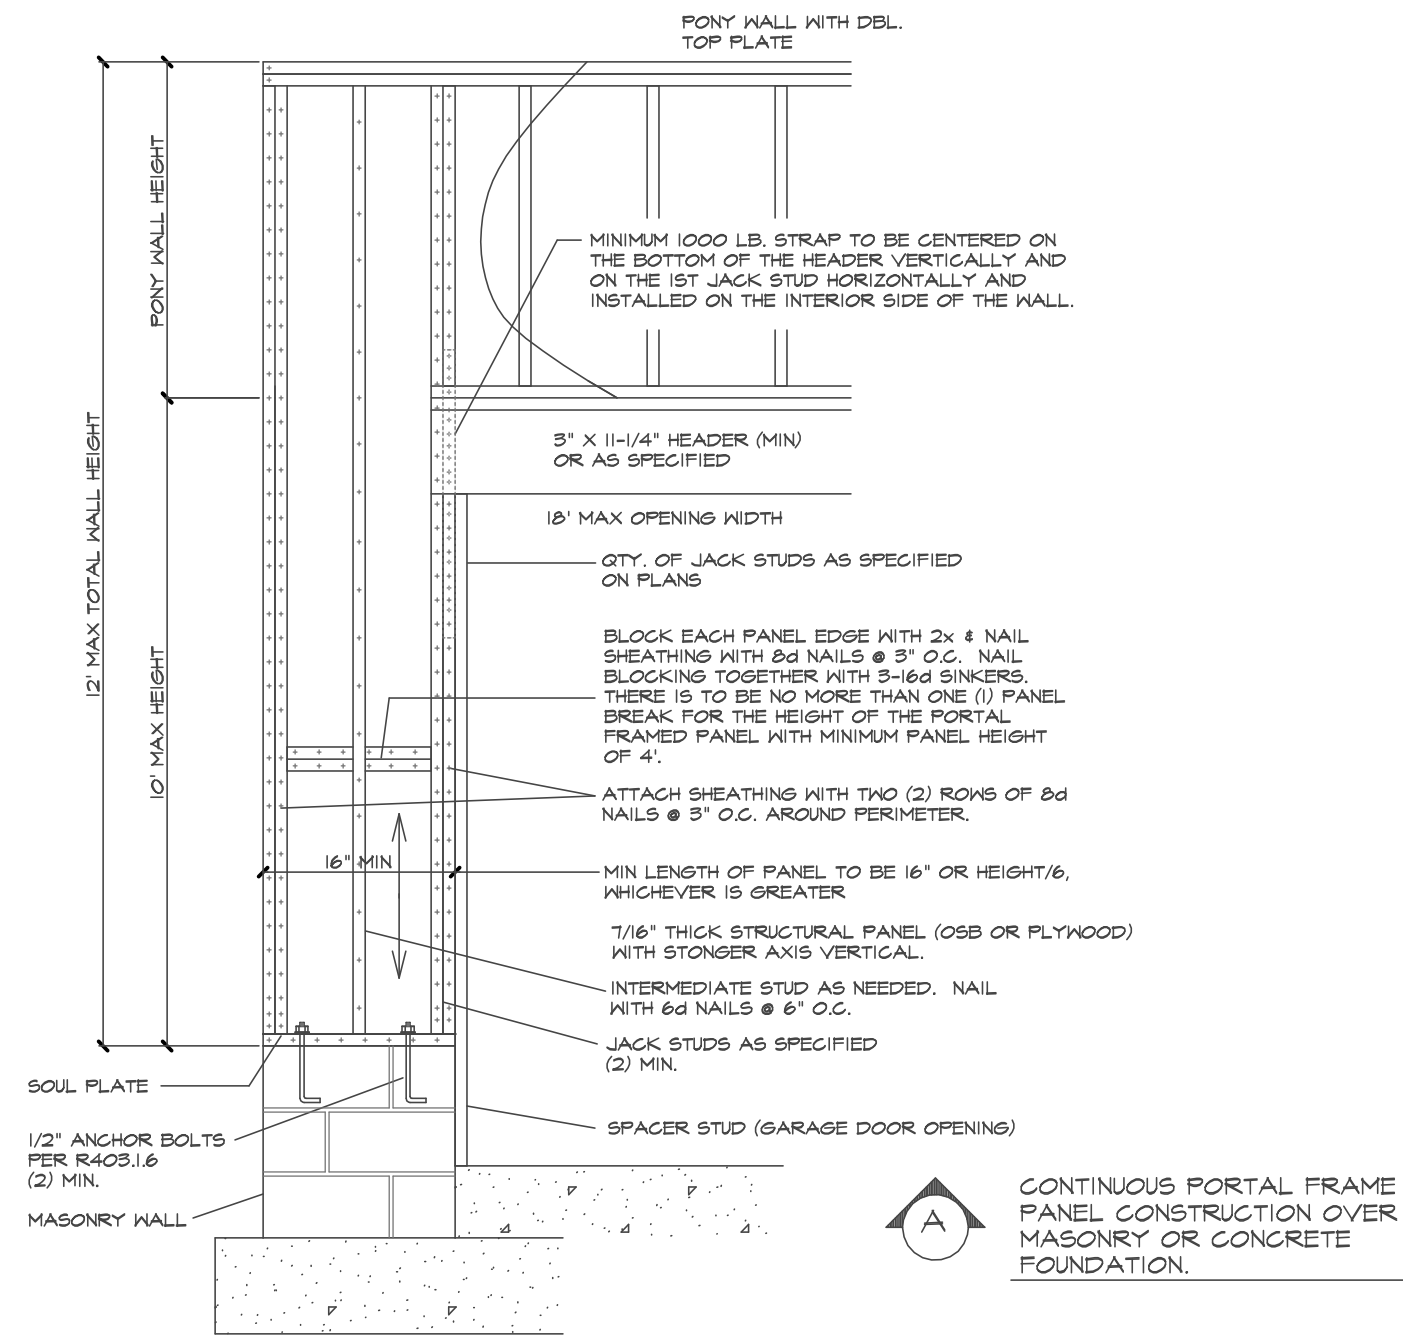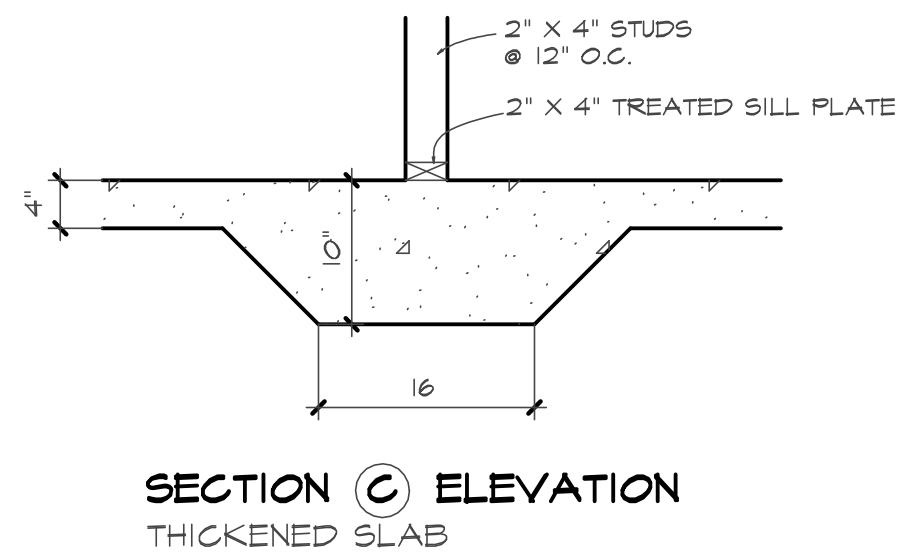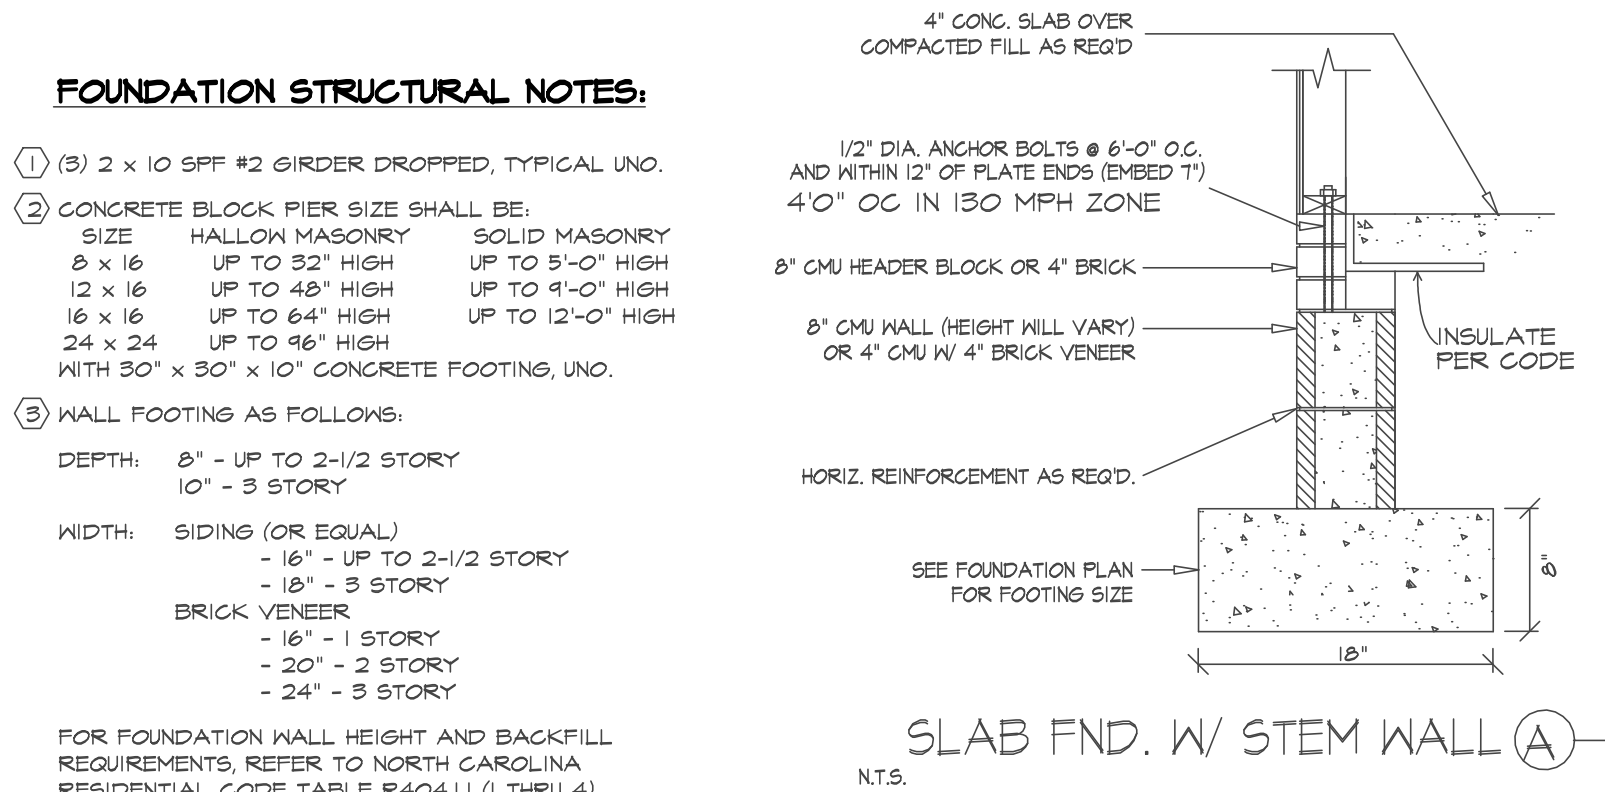

STEM-WALL & SLAB
FOUNDATION PLAN
SCALE 1/4" = 1'-0"



MidTown Designs Inc.
assumes no liability for
contractors practices and
procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2023
MidTown Designs Inc.
All Rights Reserved

**THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 EDITION (2021 IRC)**


NC (2018 NCRC) : Wind : 115 - 120 mph


Summer Construction
HATTERAS V
LOT 13 PRESERVE
AT NORRICK CREEK
GARAGE RIGHT

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE 2/6/2024

PROJECT #
231103

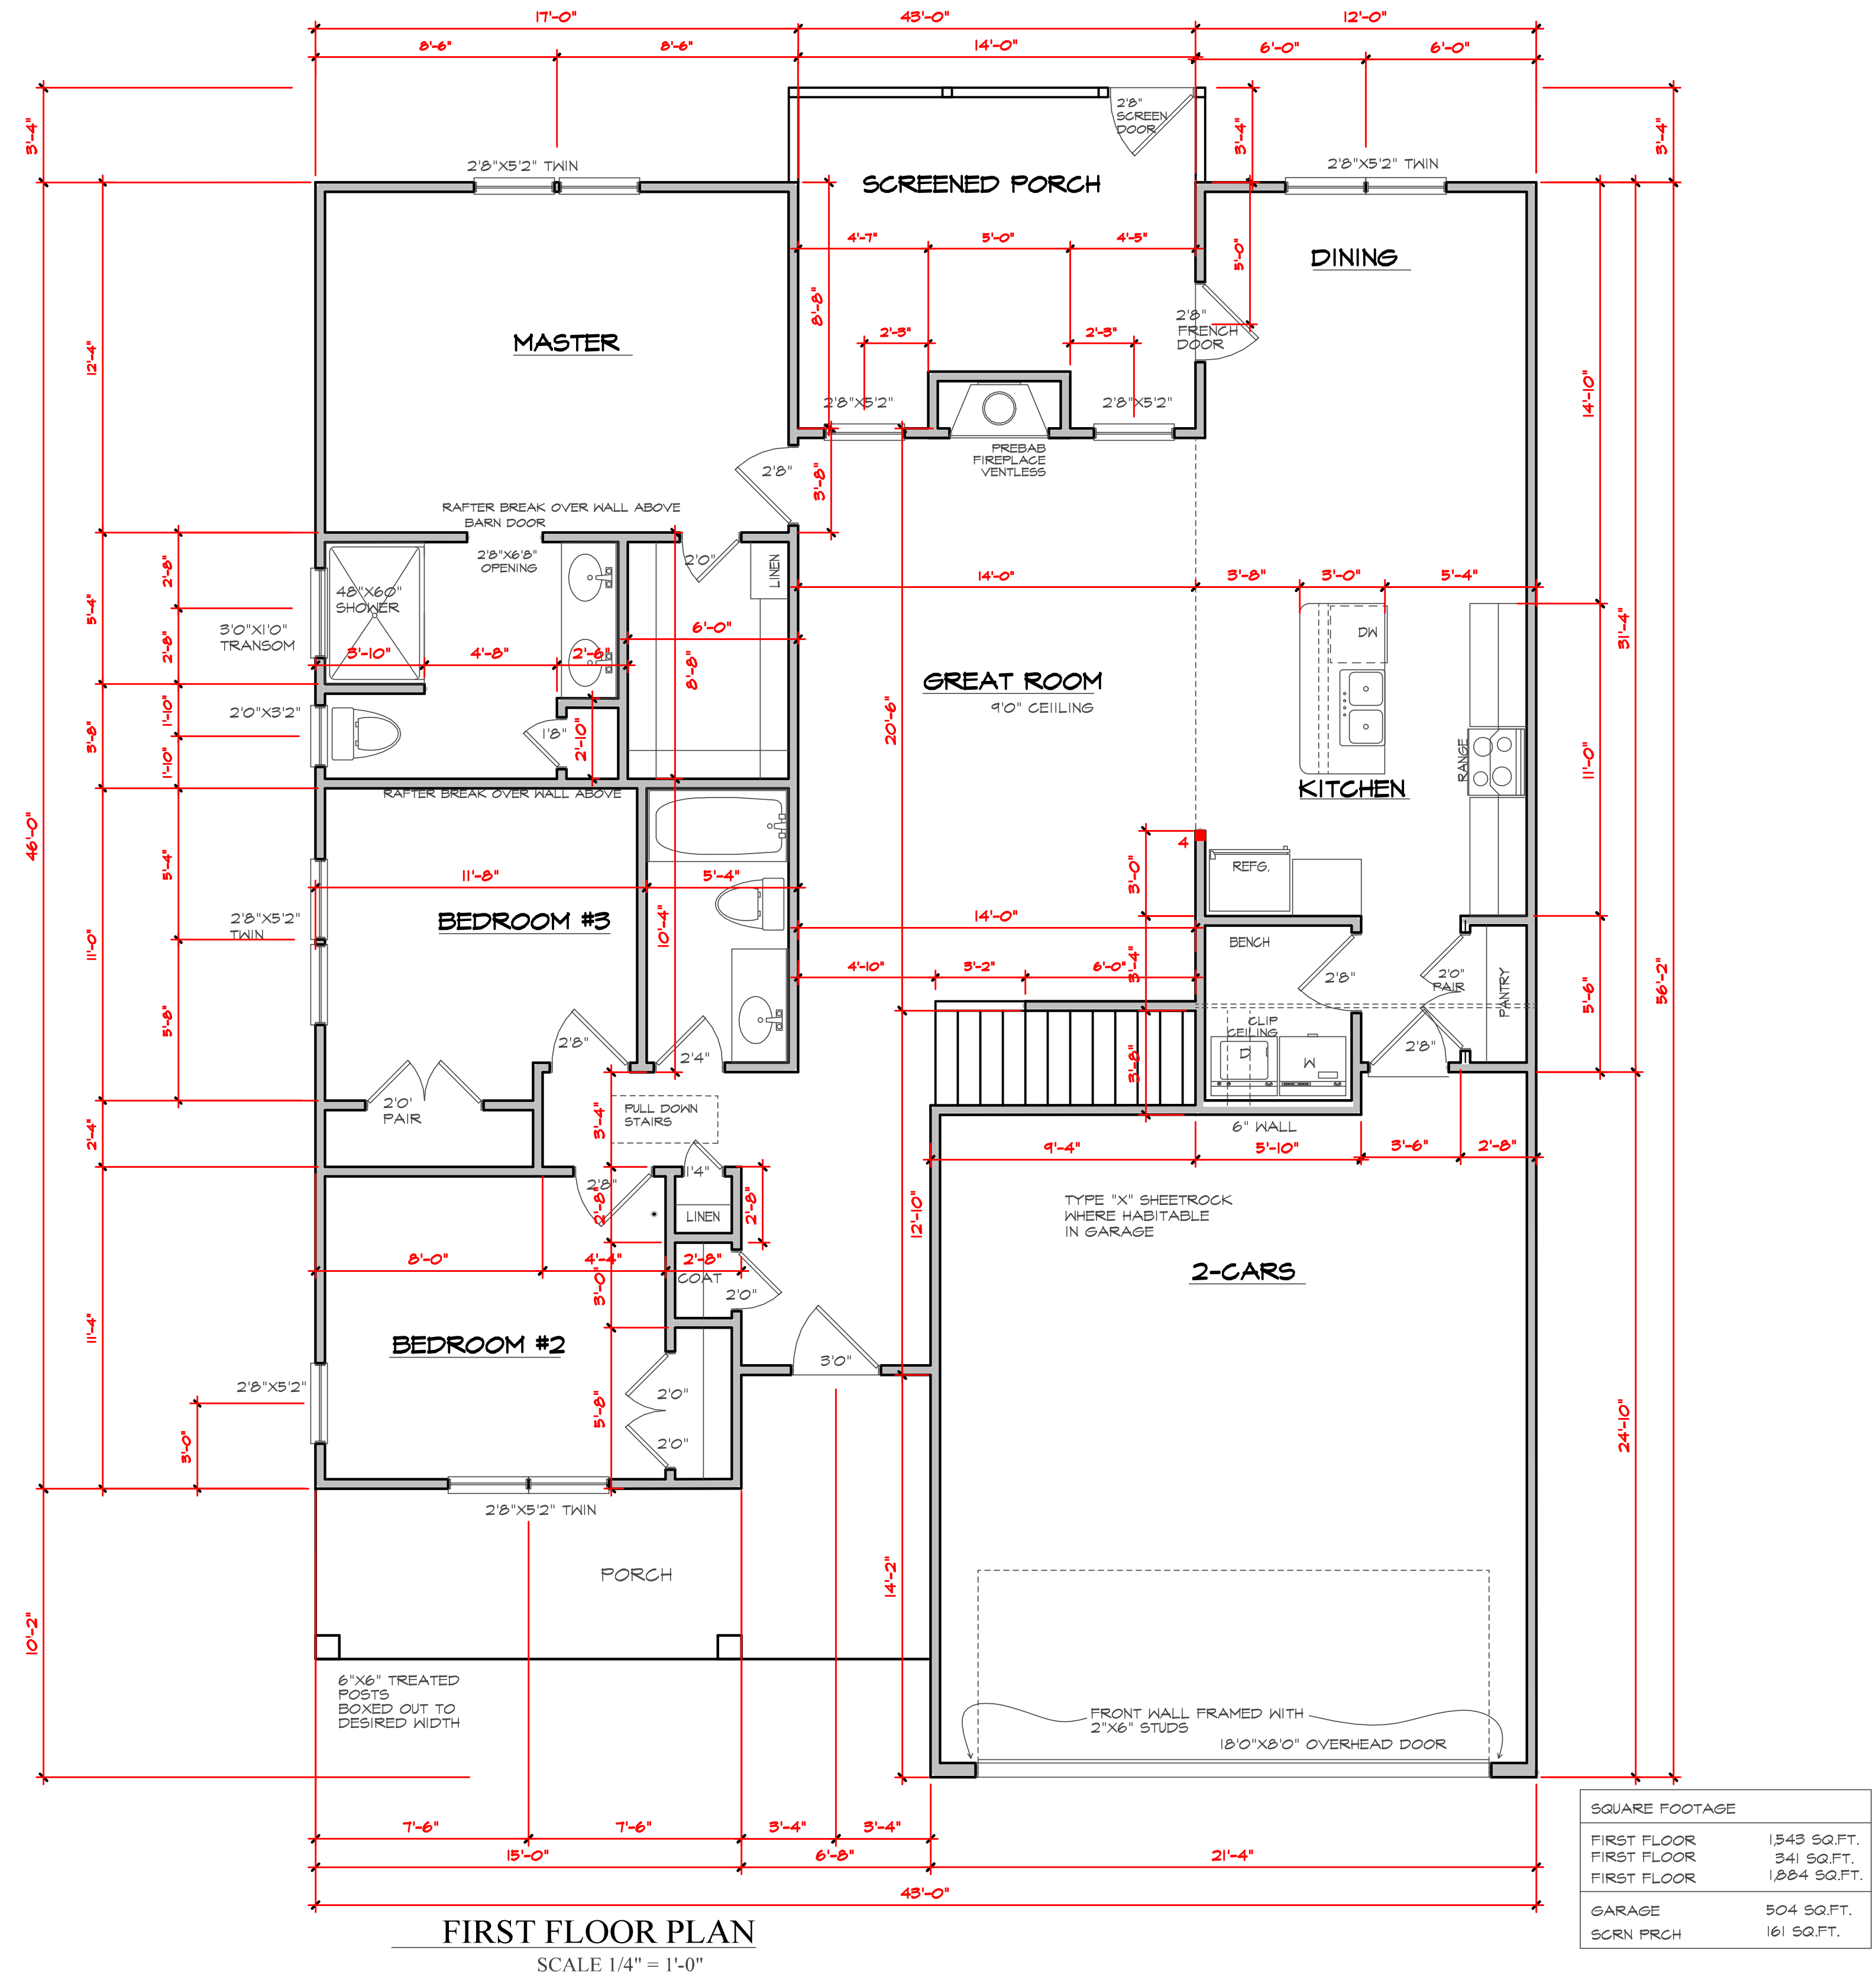



MidTown Designs Inc.
assumes no liability for
contractors practices and
procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2023

MidTown Designs Inc.
All Rights Reserved

**THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 EDITION (2021 IRC)**

NC (2018 NCRG) : Wind : 115 - 120 mph

Summer Construction
HATTERAS V
LOT 13 PRESERVE
AT NORRICK CREEK
GARAGE RIGHT

2/6/2024

PROJECT #
231103

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com



SCALE 1/4" = 1'-0"



Purchaser must verify all dimensions and conditions before beginning construction.

MidTown Designs Inc. assumes no liability for contractors practices and procedures

These drawings are instruments of service and as such shall remain property of the designer

© Copyright 2023

MidTown Designs Inc.
All Rights Reserved

THIS PLAN DESIGNED UNDER NORTH CAROLINA
RESIDENTIAL CODE 2018 EDITION (2021 IRC)
NC (2018 NRC) ; Wind - 115 - 120 mph

Summer Construction
LOT 13 PRESERVE
AT NORRIS CREEK
HATTERAS V
GARAGE RIGHT

MidTown Designs Inc. 1732 Deacon Falls Way, Wendell NC 27591 Phone: 919-783-8626 www.midtowndesigns.com

DATE
2/6/2024

PROJECT #
231103

ROOF FRAMING NOTES:


NC (2018 NRC) ; WIND: 115-120 MPH

- ① ALL RAFTERS TO BE 2" X 8" @ 16" O.C. WITH 2" X 10" RIDGE, UNO.
- ② (2) 2" X 10" OR 1.75" X 12" HIP, (2) 2" X 10" HIP MAY BE SPLICED WITH A MIN. 6'-0" OVERLAP AT CENTER.
- ③ (2) 2" X 10" OR 1.75" X 12" LVL VALLEY, DO NOT SPLICE VALLEYS.
- ④ 1.75" X 12" VALLEY
- ⑤ FALSE FRAME VALLEY ON 2" X 10" FLAT PLATE.
- ⑥ 2" X 6" RAFTERS @ 16" O.C. W/ 2" X 8" RIDGE.
- ⑦ 2" X 10" RAFTERS @ 16" O.C. W/ 2" X 12" RIDGE.

"SR" = SINGLE RAFTER
"DR" = DOUBLE RAFTER
"TR" = TRIPLE RAFTER
"RS" = ROOF SUPPORT FOR RAFTER SPLICE
"■" = (3) STUD POST OR 4" X 4" POST FOR ROOF SUPPORT

FIR DOWN 2" X 8" RAFTERS OR USE 2" X 10" AT CATHEDRAL CEILINGS.

ATTACH VAULTED RAFTERS WITH HURRICANE CLIPS, SIMPSON "H-S" OR EQUAL.

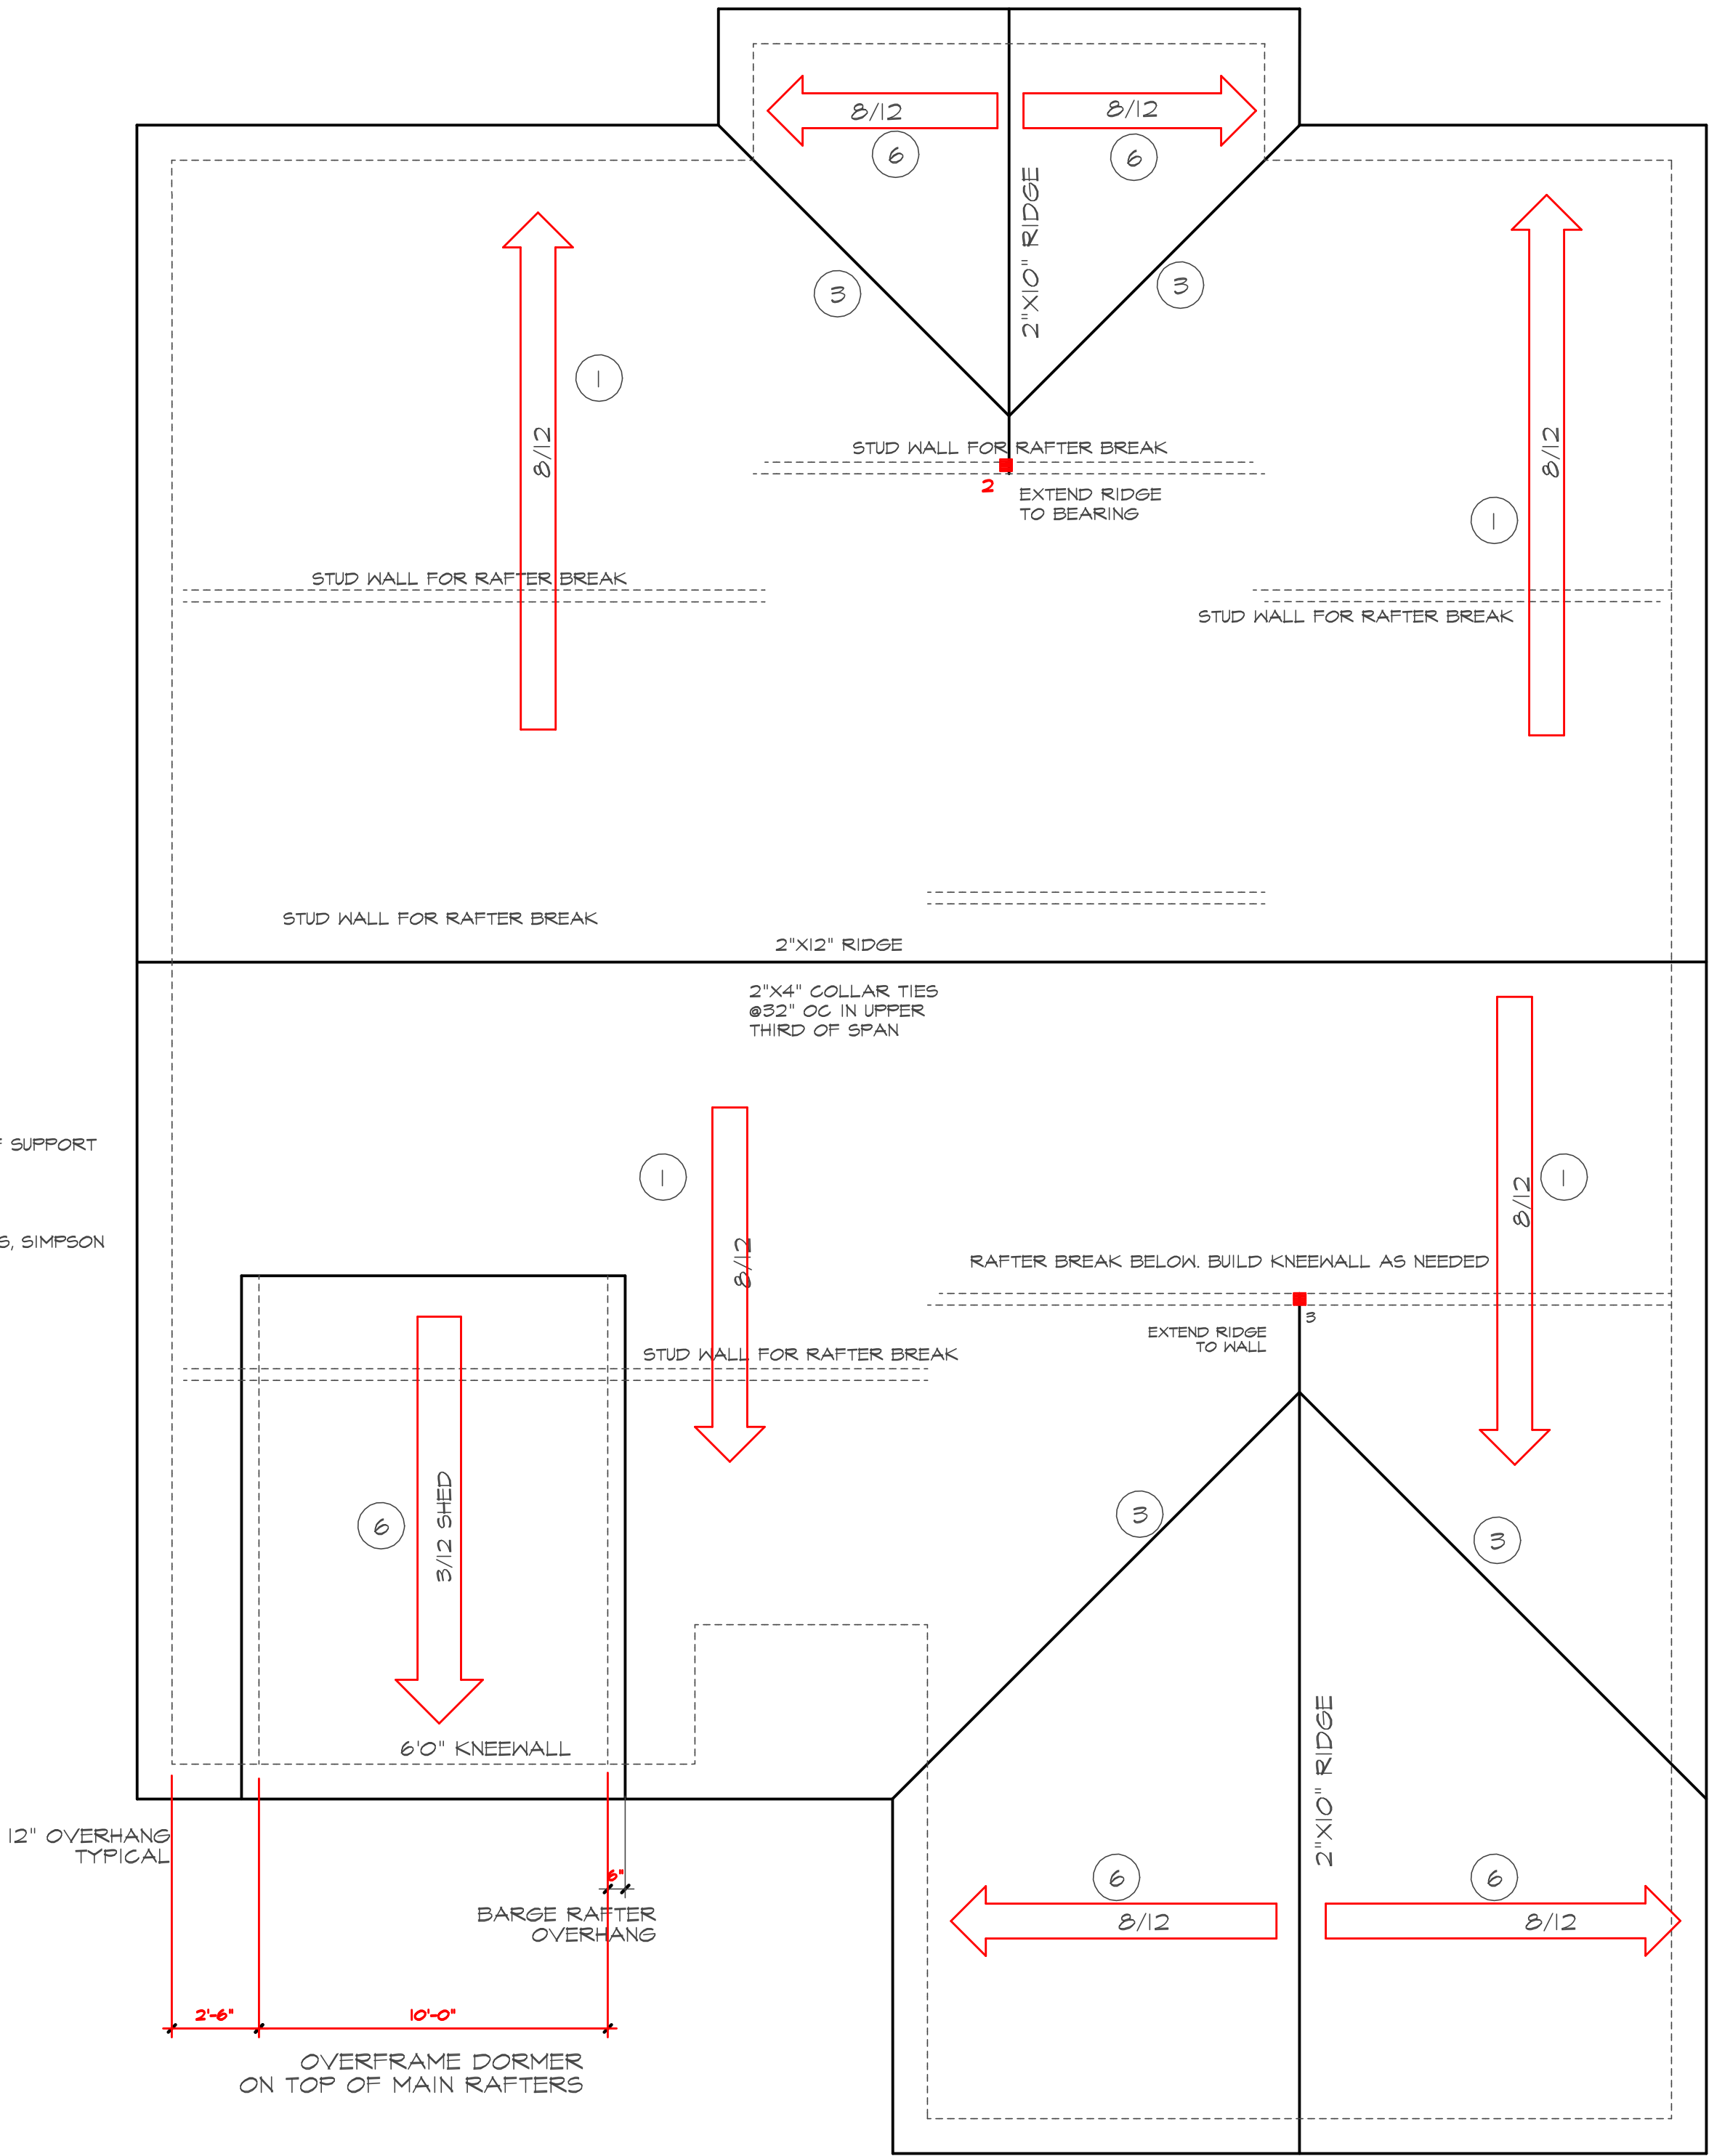

ROOF PLAN
SCALE 1/4" = 1'-0"

STRUCTURAL NOTES

1) ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA STATE RESIDENTIAL CODE - 2018 EDITION (2018 IRC), PLUS ALL LOCAL CODES AND REGULATIONS.

ALL MEMBERS SHALL BE FRAMED, ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.

2) DESIGN LOADS SEE TABLE R301.5

WIND SPEED: (REFER TO TABLE R301.2.4)
VERIFY ZONE BEFORE CONSTRUCTION.

3) WALL BRACING: WALLS SHALL BE BRACED ALONG BRACED WALL LINES ACCORDING TO SECTION R602.10. THE AMOUNT, LOCATION AND CONSTRUCTION OF BRACING SHALL COMPLY WITH R602.10. NOTE THAT THE BRACING SHOWN ON THE PLANS IS BASED ON THE PRESCRIPTIVE BRACING REQUIREMENTS OF THE CODE AND SHALL BE VERIFIED AND/OR APPROVED BY THE CODE OFFICIAL.

4) CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (NO). AIR ENTRAINMENT PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED AND PLACED IN ACCORDANCE WITH ACI STANDARDS. ALL SAMPLES FOR PUMPING SHALL BE TAKEN FROM THE EXIT END OF THE PUMP.

5) ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST CONTACT A GEOTECHNICAL ENGINEER AND THE STRUCTURAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE, AND SHALL BE GRADED SO AS TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS.

6) ALL FRAMING LUMBER SHALL BE SPF #2 (FB = 875 PSI) UNLESS NOTED OTHERWISE (NO). ALL TREATED LUMBER SHALL BE SYP #2 (FB=475 PSI). PLATE MATERIAL MAY BE SPF #3 OR SYP #3 (FC/PERP) = 425 PSI - MIN).

7) ALL WOODEN BEAMS AND HEADERS SHALL HAVE THE FOLLOWING END SUPPORTS: (1) 2X4 STUD COLUMN FOR 6'-0" MAX. BEAM SPAN (NO), (2) 2X4 STUDS FOR BEAM SPAN GREATER THAN 6'-0" (NO).

8) L.V.L. SHALL BE LAMINATED VENEER LUMBER, FB=2600 PSI, FV=285 PSI, E=1,900,000 PSI. P.S.L. SHALL BE PARALLEL STRAND LUMBER, FB=2400 PSI, FV=240 PSI, E=2,000,000 PSI. L.S.L. SHALL BE LAMINATED STRAND LUMBER, FB=2250 PSI, FV=400 PSI, E=1,950,000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S INSTRUCTIONS.

9) ALL ROOF TRUSS AND I-JOIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH THE SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOISTS SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS.

10) ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2 INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER X 4" LONG). LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDED THE JOIST ARE TOE NAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. ALL STEEL TUBING SHALL BE ASTM A500.

11) REBAR SHALL BE DEFORMED STEEL, ASTM615, GRADE 60.

12) FLITCH BEAMS SHALL BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A307) WITH WASHERS PLACED UNDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX). AND STAGGERED AT THE TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.

13) BRICK LINTELS SHALL BE 3 1/2"x3 1/2"x1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"x4"x5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 9'-0" (NO).

14) THE POSITIVE AND NEGATIVE DESIGN PRESSURE FOR DOORS AND WINDOWS SEE R301.2(6)

DWELLING / GARAGE SEPARATION

REFER TO SECTIONS R302.5, R302.6, AND R302.7

WALLS: A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.

STAIRS: A minimum of 1/2" gypsum board must be installed on the underside and exposed sides of all stairways.

CEILING: A minimum of 1/2" gypsum must be installed on the garage ceiling if there are no habitable room above the garage. If there are habitable room above the garage a minimum of 5/8" type X gypsum board must be installed on the garage ceiling.

OPENING PENETRATIONS: Openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches (35 mm) in thickness, solid or noncombustible core steel doors not less than 1 3/8 inches (35 mm) thick, or 20-minute fire-rated doors.

DUCT PENETRATIONS: Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.

OTHER PENETRATIONS: Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

ATTIC ACCESS

SECTION R207

R207.1 Attic access. An attic access opening shall be provided to attic areas that exceed 400 square feet (37.16 m²) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 30-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M105.13 for access requirements where mechanical equipment is located in attic.

Exceptions:

1. Concealed areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc., are not required to have access.

2. Pull down stair breads, stringers, handrails, and hardware may protrude into the net clear opening.

STAIR DETAIL

NO SCALE

STAIR NOTES:

1. STAIRS RISERS MUST BE UNIFORM AND NOT EXCEED 8 1/4".

2. TREADS SHALL NOT BE LESS THAN 10" DEEP A 1" PROJECTION OVER RISER IS PERMITTED.

3. A MINIMUM OF 6'8" HEADROOM MUST BE MAINTAINED AT ALL PLACES ON STAIR.




4. THE WIDTH OF THE STAIR SHALL BE A MINIMUM OF 3'0". HANDRAIL MAY PROJECT FROM EACH SIDE OF STAIR A DISTANCE OF 3 1/2" INTO THE REQUIRED WIDTH.

5. WINDERS MUST BE A MINIMUM OF 4'1" IN WIDTH AT 12" FROM THE NARROWEST SIDE. TREAD SHALL BE NO NARROWER THAN 4" AT ANY POINT AND AVERAGE NO LESS THAN 4 INCHES.

6. HANDRAILS SHALL BE NO LESS THAN 34" AND NO MORE THAN 38" ABOVE TREAD NOSING.


7. WINDERS AND SPIRAL STAIRS SHALL HAVE THE HANDRAIL LOCATED ON THE OUTSIDE RADIUS.

8. ALL REQUIRED HANDRAILS SHALL BE CONTINUOUS THE FULL LENGTH OF THE STAIRS.

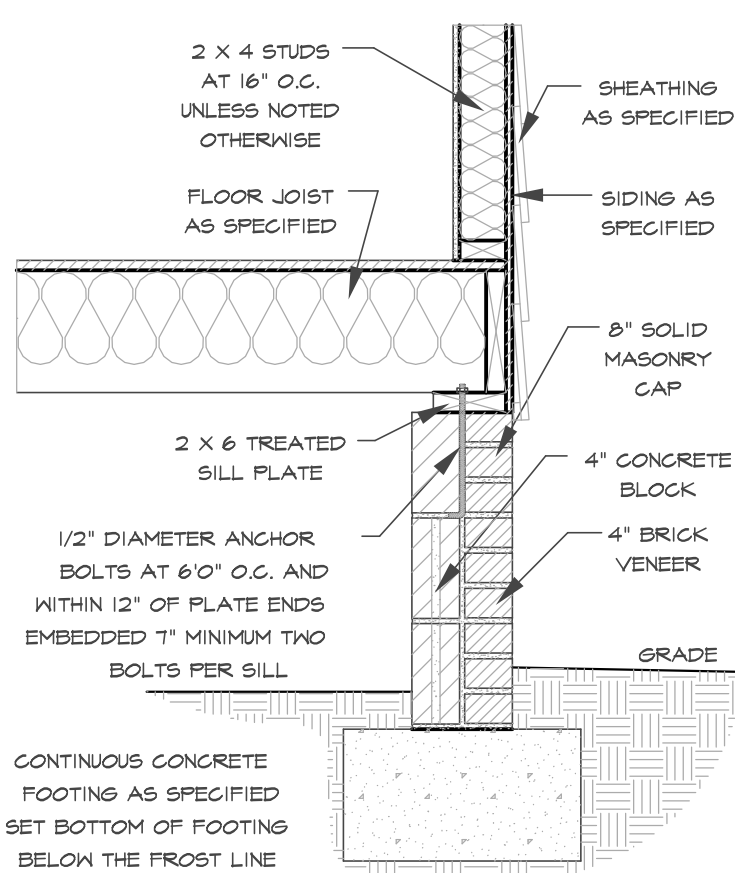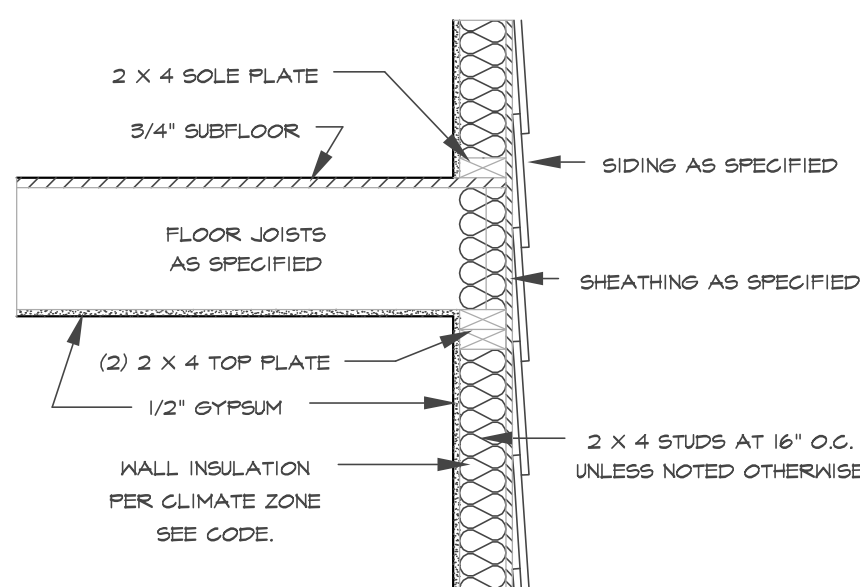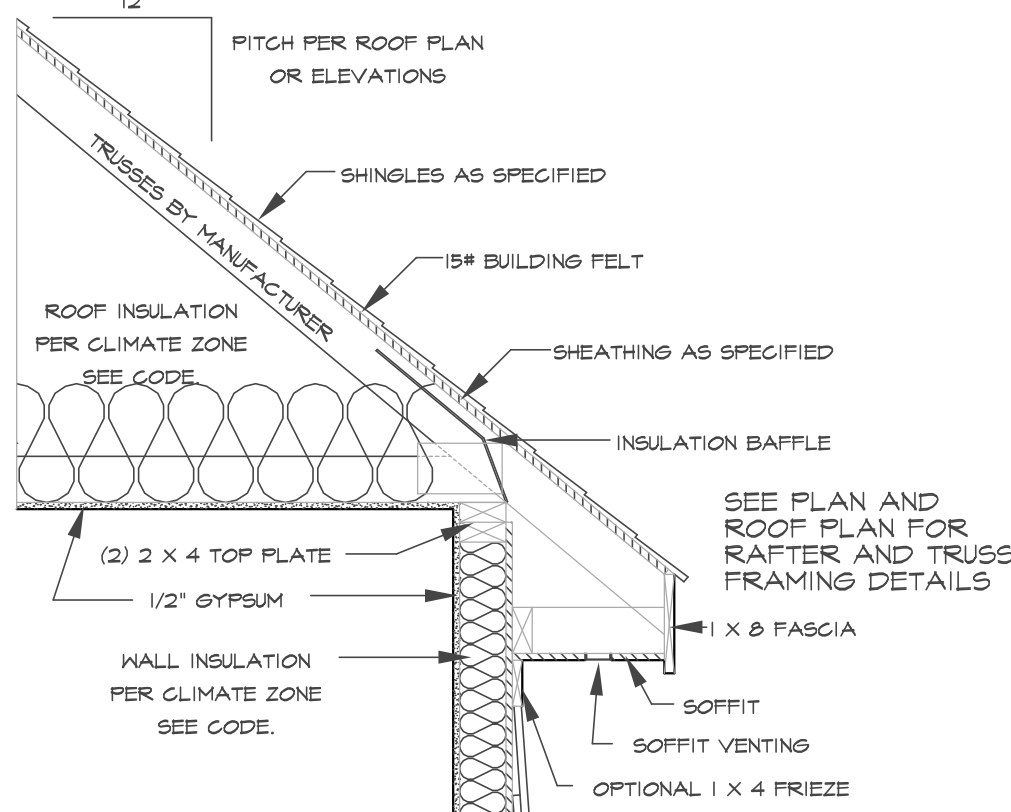


TYPICAL WALL SECTION

SCALE 3/4" = 1'-0"

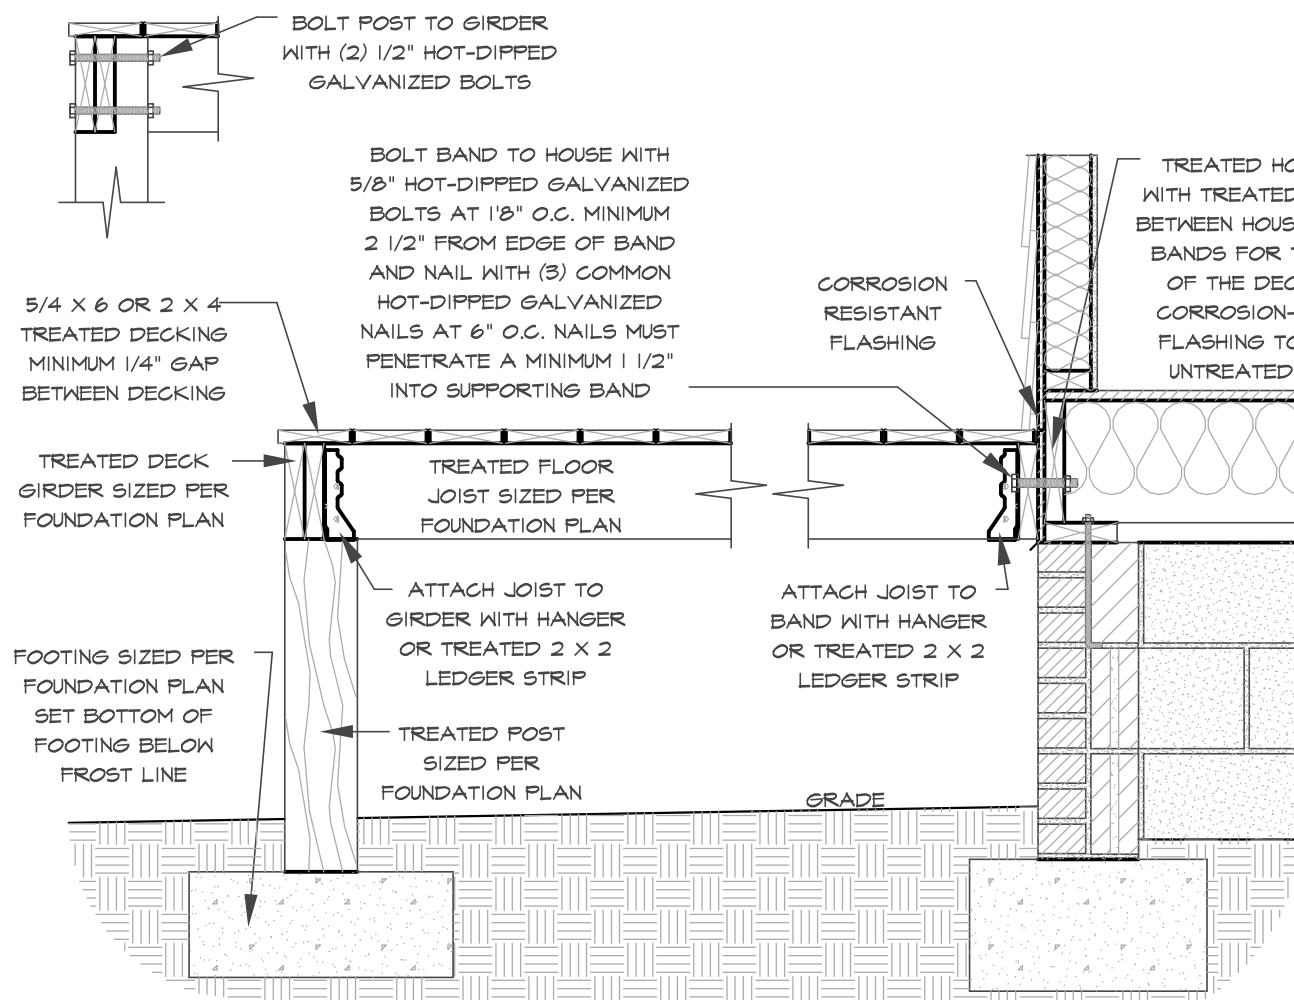


DECK ATTACHMENT DETAIL TO FRAMED WALL

SCALE 3/4" = 1'-0"

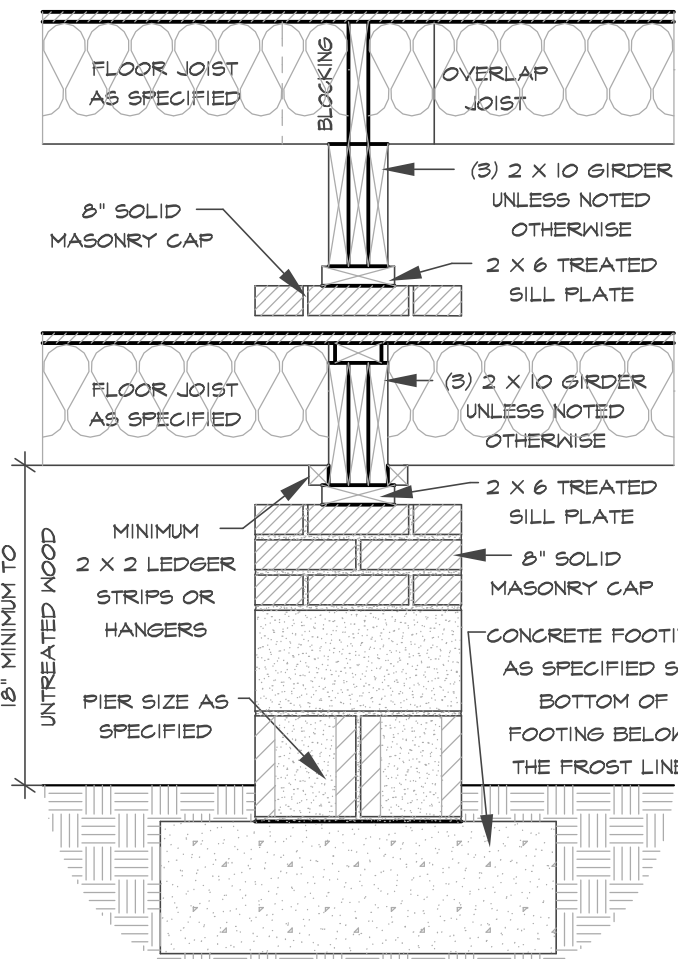


DROPPED/ FLUSH PIER

SCALE 3/4" = 1'-0"

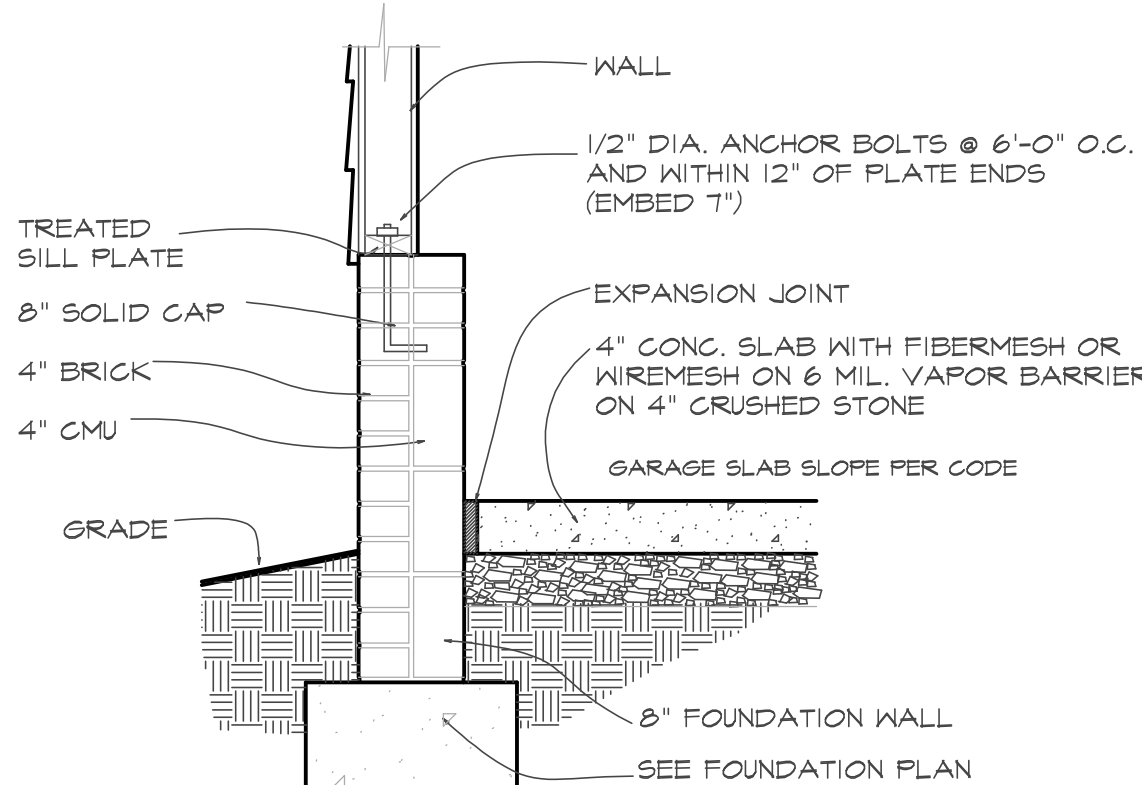

SECTION AT GARAGE SLAB

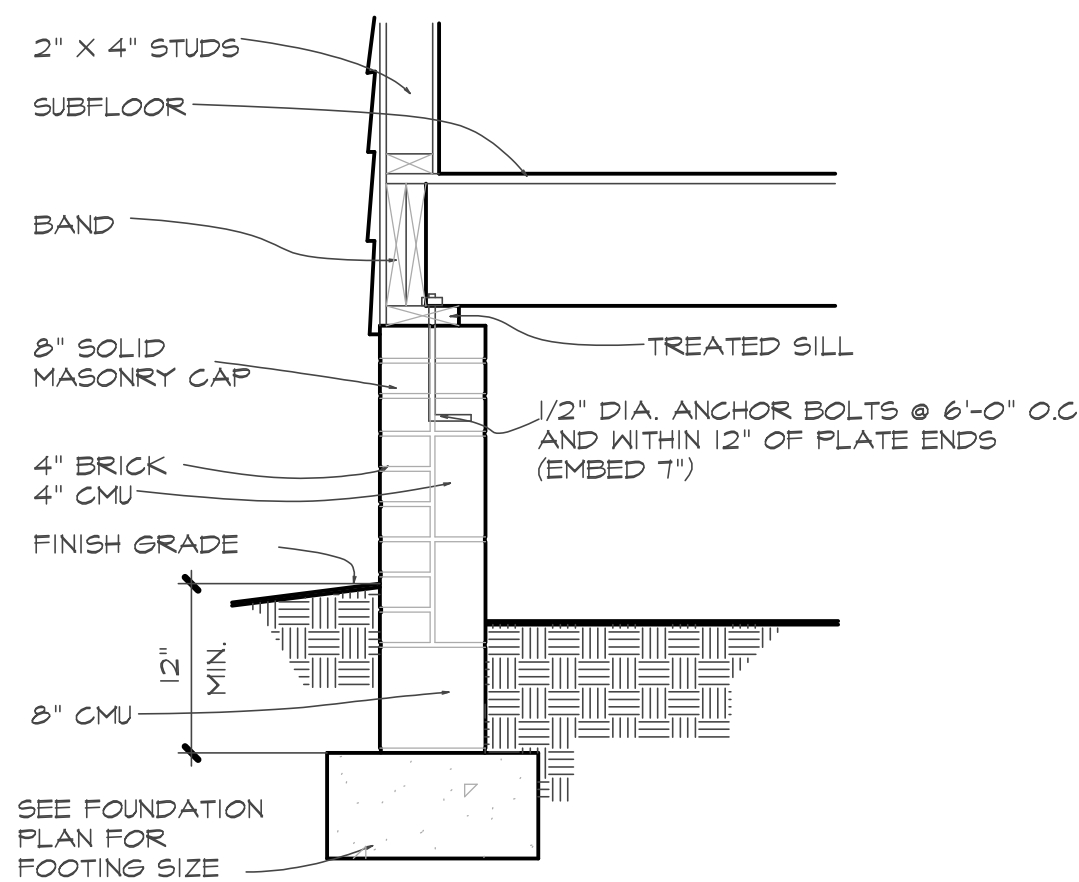

SECTION AT CRAWL

TABLE R602.1.2 INSULATION AND PENETRATION REQUIREMENTS BY COMPONENT ^a											
CLIMATE ZONE	PENETRATION U-FACTOR ^b	SKYLIGHT U-FACTOR ^b	CEILING FLOOR PENETRATION U-FACTOR ^b	CEILING FRAME WALL U-FACTOR ^b	CEILING WALL U-FACTOR ^b	FLOOR U-FACTOR ^b	BASEMENT WALL U-FACTOR ^b	SLAB U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b
3	0.35	0.55	0.30	38 or 30x7	15 or 15-25 or 30x7	5/13 or 30x7	19	5/19	0	5/13	
4	0.35	0.55	0.30	38 or 30x7	15 or 15-25 or 30x7	5/13 or 30x7	19	10/15	10	10/15	
5	0.35	0.55	NR	38 or 30x7	15 or 15-25 or 30x7	13/17 or 13-25 or 13-25	30	10/15	10	10/19	

TABLE R602.1.4 EQUIVALENT U-FACTORS ^a											
CLIMATE ZONE	PENETRATION U-FACTOR ^b	SKYLIGHT U-FACTOR ^b	CEILING FLOOR U-FACTOR ^b	CEILING WALL U-FACTOR ^b	FLOOR U-FACTOR ^b	BASEMENT WALL U-FACTOR ^b	SLAB U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b	GRAVEL SPACE U-FACTOR ^b
3	0.35	0.55	0.30	0.077	0.141	0.047	0.099	0.136			
4	0.35	0.55	0.30	0.077	0.141	0.047	0.099	0.136			
5	0.35	0.55	0.30	0.061	0.082	0.033	0.055	0.065			

a. Nonpenetration U-factors shall be obtained from measurement, calculation or an approved source.
b. When more than half the insulation is on the interior, the mean wall U-factor shall be a maximum of 0.027 in Climate Zone 3, 0.027 in Climate Zone 4 and 0.025 in Climate Zone 5.
c. Basement wall U-factor of 0.060 is for walls located as defined by Figure R301.1 and Table R301.1.
d. A maximum of one glazed fenestration product assembly, having a U-factor no greater than 0.25 and a SHGC no greater than 0.70 shall be permitted to be substituted for minimum code compliant fenestration product assemblies without penalty. When applying this rule, and using the R301.1 "U-factor" compliance method to allow certified use of the software, the fenestration product shall be modeled as meeting the U-factor of 0.25 and the SHGC of 0.70, as applicable, but the fenestration product actual U-factor and actual SHGC shall be noted in the common section of the software for documentation. If application of this rule to the applicable product, compliance for these substitution products shall be verified compared to the software substituted maximum U-value requirement and maximum SHGC requirement, as applicable.