

HERITAGE HOME DESIGNS, LLC

3206 HERITAGE TRADE DR. SUITE. 116
WAKE FOREST, NC 27587
OFFICE - (919) 556-6032
TIM-HSD@NC.RR.COM

ABBREVIATIONS

@	AT
A.F.F.	ABOVE FINISHED FLOOR
BRD.	BOARD
CAB.	CABINET
CABS.	CABINETS
COL.	COLUMN
COLS.	COLUMNS
CONC.	CONCRETE
CONT.	CONTINUOUS
DBL.	DOUBLE
DIA.	DIAMETER
DSP.	DOUBLE STUD POCKET
DW.	DISHWASHER
D.	DRYER
ELEV.	ELEVATION
FT.	FEET
F.F.	FINISHED FLOOR
FLR.	FLOOR
FR.	FREEZER
HDR.	HEADER
HT.	HEIGHT
HTS.	HEIGHTS
HORIZ.	HORIZONTAL
IN.	INCHES
INCL.	INCLUDE
INSUL.	INSULATION
LT.	LIGHT
LIN.	LINEN
MAX.	MAXIMUM
MIN.	MINIMUM
O.H.D.	OVERHEAD DOOR
O.C.	ON CENTER
OPT.	OPTIONAL
PAN.	PANTRY
REF.	REFRIGERATOR
REQ'D	REQUIRED
SCR.	SCREEN
SHLVs.	SHELVES
SHWR.	SHOWER
S.L.	SIDE LIGHT
SPECS.	SPECIFICATIONS
SQ.	SQUARE
TR.	TRANSOM
TYP.	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
VAN.	VANITY
VERT.	VERTICAL
WH.	WATER HEATER
W.	WASHER
WIN.	WINDOW
W.	WITH



*THIS PICTURE DESIGN MAY NOT REFLECT ACTUAL CHARACTERISTICS OF FINISHED HOME.
THIS PICTURE IS FOR ILLUSTRATIVE PURPOSES ONLY AND MAY VARY. CONTRACTOR TO
VERIFY ALL COLORS AND CHARACTERISTICS OF THIS PLAN.

TABLE N1102.1.2 (R402.1.2) INSULATION AND FENESTRATION REQUIREMENTS BY COMPONENT

*SEE N.C. RESIDENTIAL CODE, 2018 ED.
FOR ADDITIONAL NOTES

CLIMATE ZONE	FENESTRATION U-FACTOR	SKYLIGHT	GLAZED FENESTRATION SHGC	CEILING R-VALUE	WOOD FRAME WALL R-VALUE	MASS WALL R-VALUE	FLOOR R-VALUE	BASEMENT WALL R-VALUE	SLAB R-VALUE & DEPTH	CRAWL SPACE WALL R-VALUE
3	0.35	0.55	0.30	38 or 30ci	15 or 13 + 2.5	5/13 or 5/10ci	19	5/13	0	5/13
4	0.35	0.55	0.30	38 or 30ci	15 or 13 + 2.5	5/13 or 5/10ci	19	10/15	10	10/15
5	0.35	0.55	NR	38 or 30ci	19 or 13 + 5 or 15 + 3	13/17 or 13/12.5ci	30	10/15	10	10/19

THE BUILDING THERMAL ENVELOPE SHALL MEET THE REQUIREMENTS OF TABLE N1102.1.2 BASED ON THE CLIMATE ZONE SPECIFIED IN SECTION N1101.7

SHEET INDEX:

- COVER SHEET
- FRONT & RIGHT SIDE ELEVATION
- REAR & LEFT SIDE ELEVATION
- FIRST FLOOR PLAN
- SECOND FLOOR PLAN
(STRUCTURAL SHEETS PER ENGINEER)

THESE PLANS ARE DESIGNED TO MEET THE REQUIREMENTS OF THE NORTH CAROLINA STATE RESIDENTIAL BUILDING CODE - 2018 EDITION. IT IS THE RESPONSIBILITY OF THE BUILDER/ CONTRACTOR TO REVIEW AND VERIFY THESE PLANS PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHALL BE REPORTED TO THE DESIGNER FOR CLARIFICATION.

CRAWL SPACE VENTILATION

REQUIRED

2,374 SQ. FT. / 150 15.83 SQ. FT. OF VENTILATION

PROVIDED

.65 SQ. FT. / VENT x 25 VENTS = 16.25 (SQ. FT. OF VENTILATION)

A 6 MIL. VAPOR RETARDER SHALL BE INSTALLED TO COVER 100% OF CRAWL SPACE AREA REDUCING VENTS BY 50%. VENTS SHALL BE PLACED TO PREVENT DEAD AIR.

ATTIC VENTILATION

REQUIRED

3,637 SQ. FT. OF ATTIC/600= 6.06 SQ. FT. EACH OF INLET & OUTLET

PROVIDED

INLET .07 SQ. FT. PER LINEAR FT. OF VENT. 88 LINEAR FT. = 6.16 SQ. FT. OF VENT.

OUTLET .11 SQ. FT. PER LINEAR FT. OF VENT. 56 LINEAR FT. = 6.16 SQ. FT. OF VENT.

-CALCULATION SHOWN, CONSIDER VENTILATORS USED AT LEAST 3 FEET ABOVE THE CORNICE VENTS
-CATHEDRAL CEILINGS SHALL HAVE A 1" MINIMUM CLEARANCE BETWEEN THE BOTTOM OF THE ROOF DECK AND THE INSULATION.



Corp. License
Number C-2550

Copyright © 2025
Heritage Home
Designs, LLC.
All rights reserved.

All drawings and copies thereof are instruments of service and as such remain the property of Heritage Home Designs, LLC. They are produced for one-time use only with respect to the project. Heritage Home Designs, LLC reserves the right to use these plans at its own discretion. Approval from a licensed building inspector will be the responsibility of the consumer if requested. Normal dimensions may be used. Do not scale drawings.

HW CUSTOM HOMES

LOT 58 PILOT RIDGE

DRAWN BY: TMB

CHECKED BY: TBH

ISSUE DATE: 2-28-2025

REVISION NO. REVISION DATE

CONTENT:

COVER SHEET

SHEET:

1



FRONT ELEVATION

SCALE: 1/4" = 1'-0"



RIGHT SIDE ELEVATION

SCALE: 1/4" = 1'-0"

REVISION NO.	REVISION DATE

CONTENT:
FRONT ELEVATION
RIGHT ELEVATION

REVISION NO.	REVISION DATE




REAR ELEVATION

SCALE: 1/4" = 1'-0"



LEFT SIDE ELEVATION

SCALE: 1/4" = 1'-0"

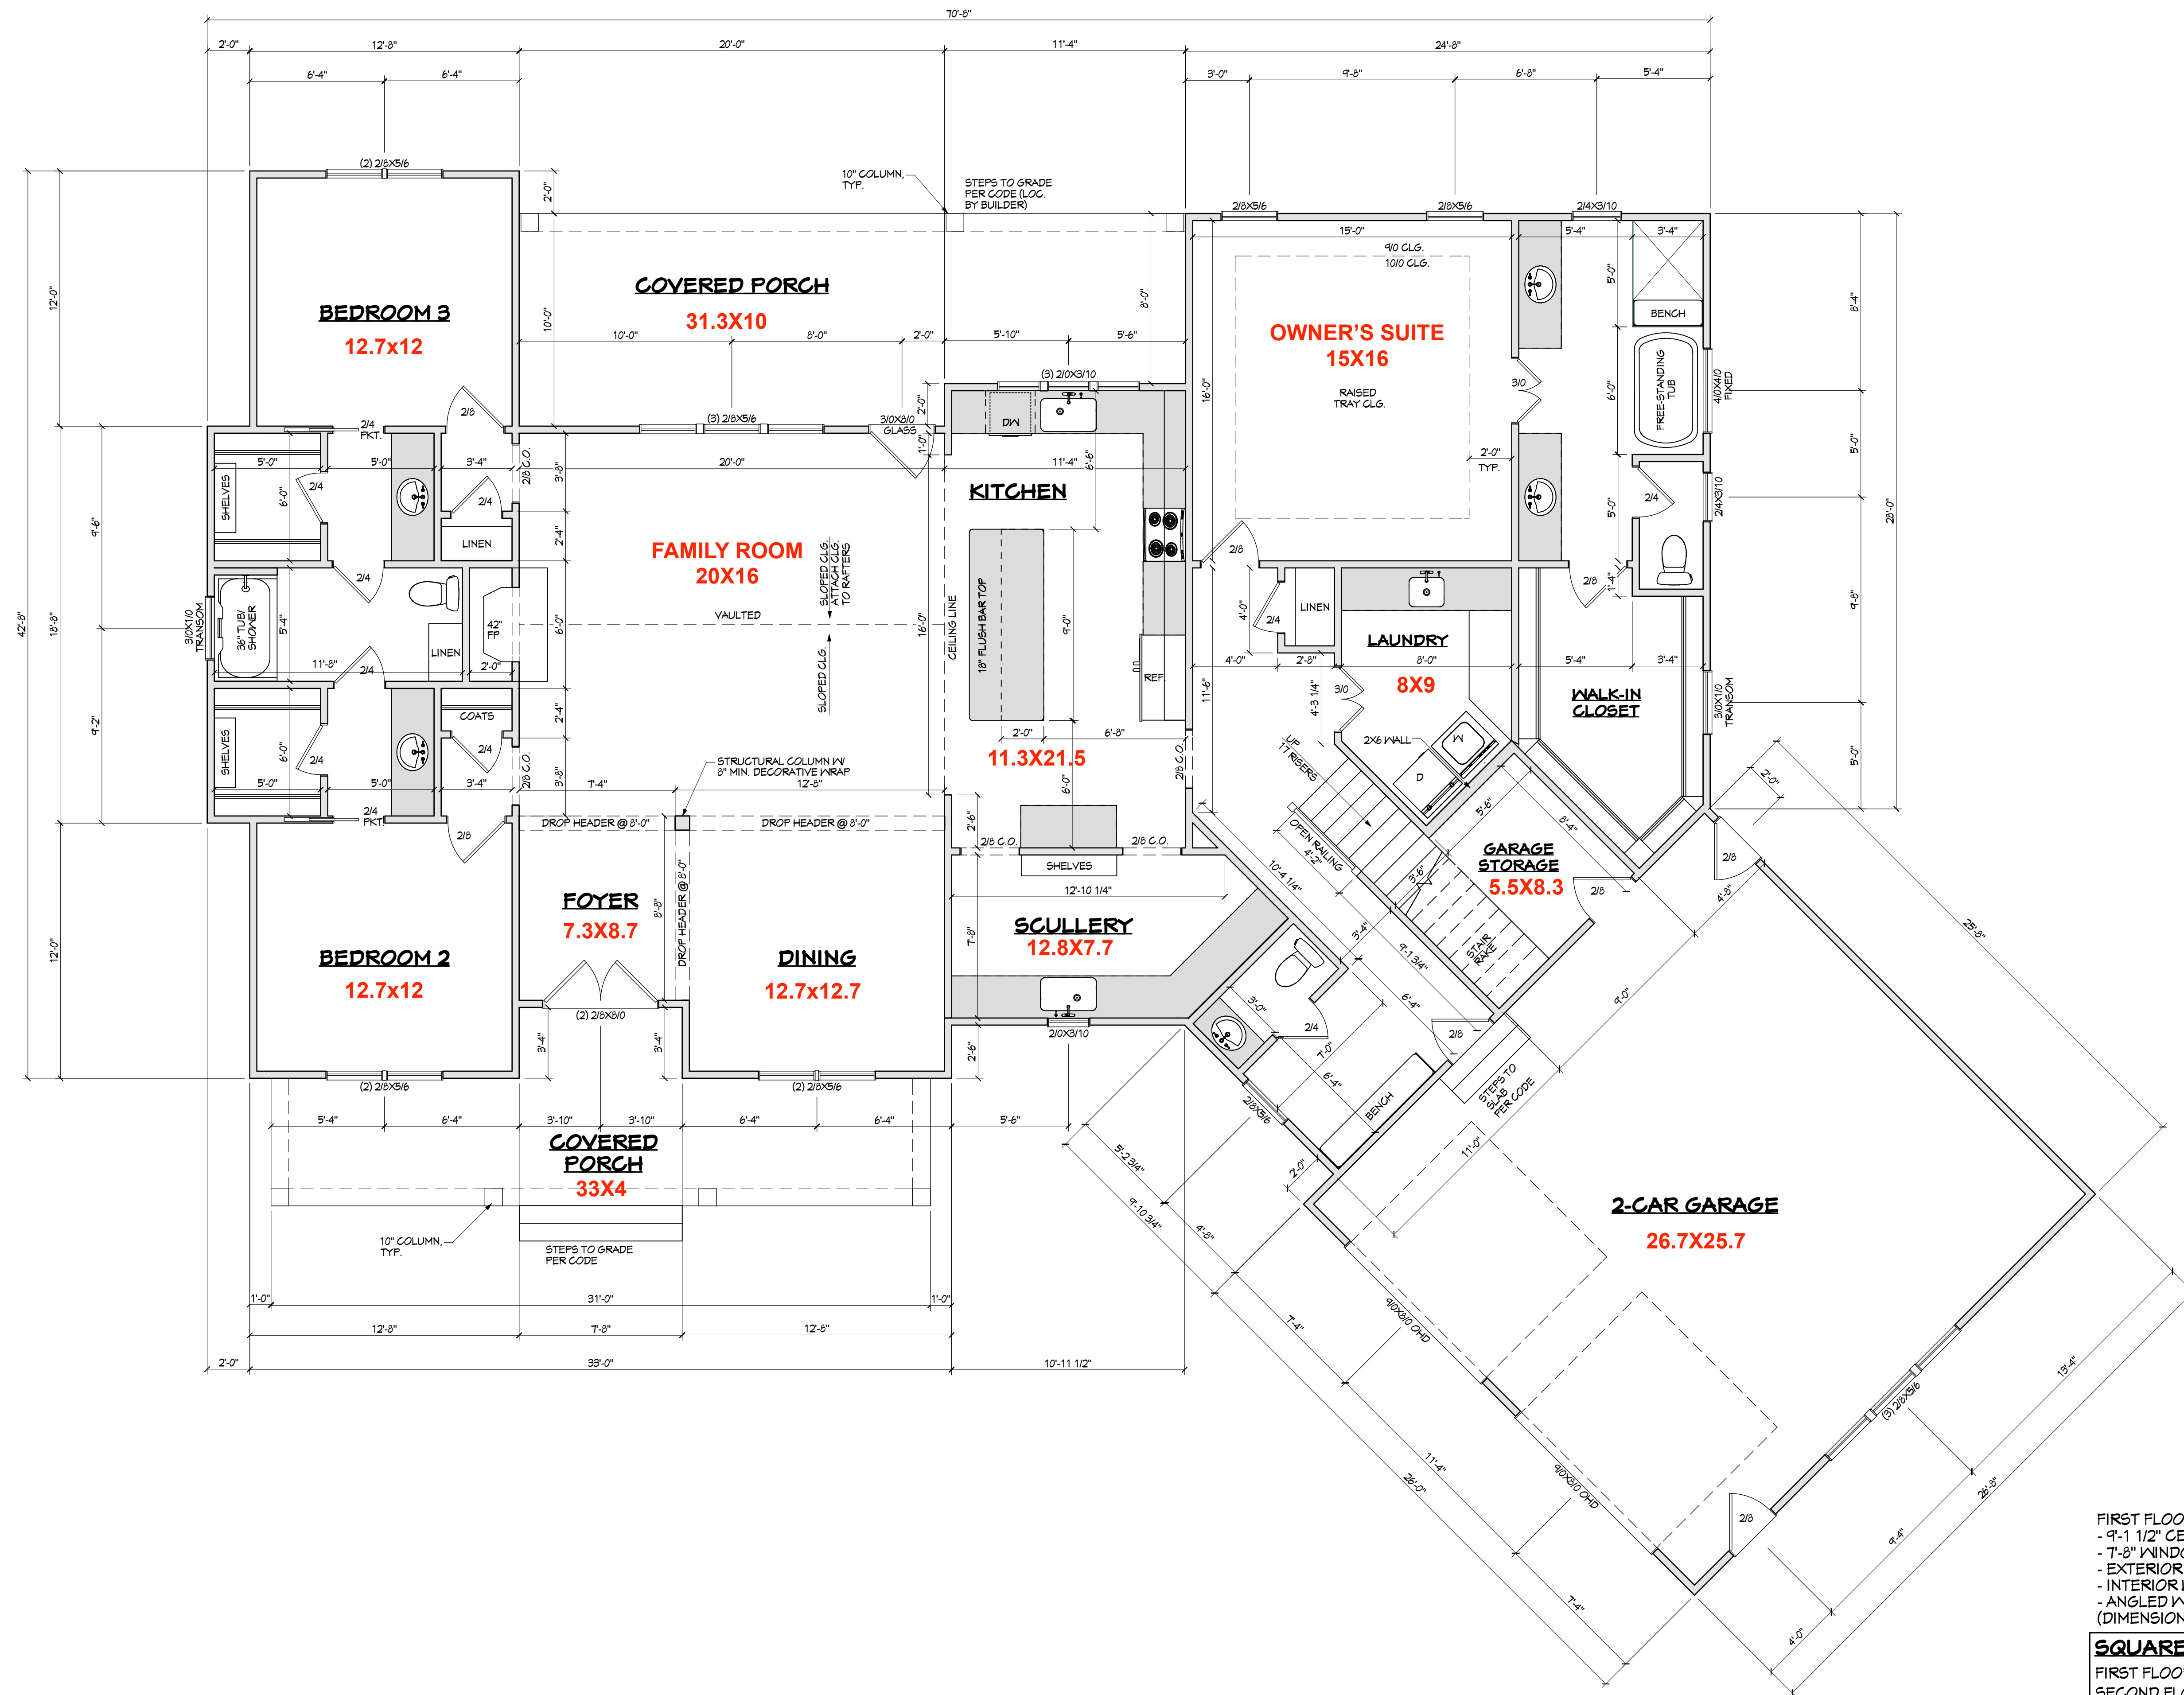

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"

FIRST FLOOR NOTES:	
- 9'-1 1/2" CEILING HEIGHT U.N.O.	
- 7'-8" WINDOW HEAD HEIGHT U.N.O.	
- EXTERIOR WALLS ARE 4" THICK U.N.O.	
- INTERIOR WALLS ARE 4" THICK U.N.O.	
- ANGLED WALLS ARE 45 DEG. U.N.O.	
(DIMENSIONS ARE NOMINAL)	
SQUARE FOOTAGE	
FIRST FLOOR HEATED	2,374 SQ. FT.
SECOND FLOOR HEATED	460 SQ. FT.
TOTAL HEATED	2,834 SQ. FT.
2-CAR GARAGE + STORAGE	760 SQ. FT.
FRONT COVERED PORCH	212 SQ. FT.
REAR COVERED PORCH	241 SQ. FT.



Corp. License
Number C-2550


Copyright © 2025
Heritage Home
Designs, LLC.
All rights reserved.
All drawings and copies thereof are
instruments of service and as such
remain the property of Heritage Home
Designs, LLC. They are produced for
one-time use only with respect to this
project. Heritage Home Designs, LLC
reserves the right to use these plans
at its own discretion. Approval from a
licensed building inspector will be the
responsibility of the consumer if required.
Normal dimensions may be used. Do not
scale drawings.

HW CUSTOM HOMES
LOT 58 PILOT RIDGE

<u>DRAWN BY: TWB</u>	
<u>CHECKED BY: TBH</u>	
<u>ISSUE DATE: 2-25-2025</u>	
<u>REVISION NO.</u>	<u>REVISION DATE</u>


CONTENT:
FIRST FLOOR

SHEET:
4

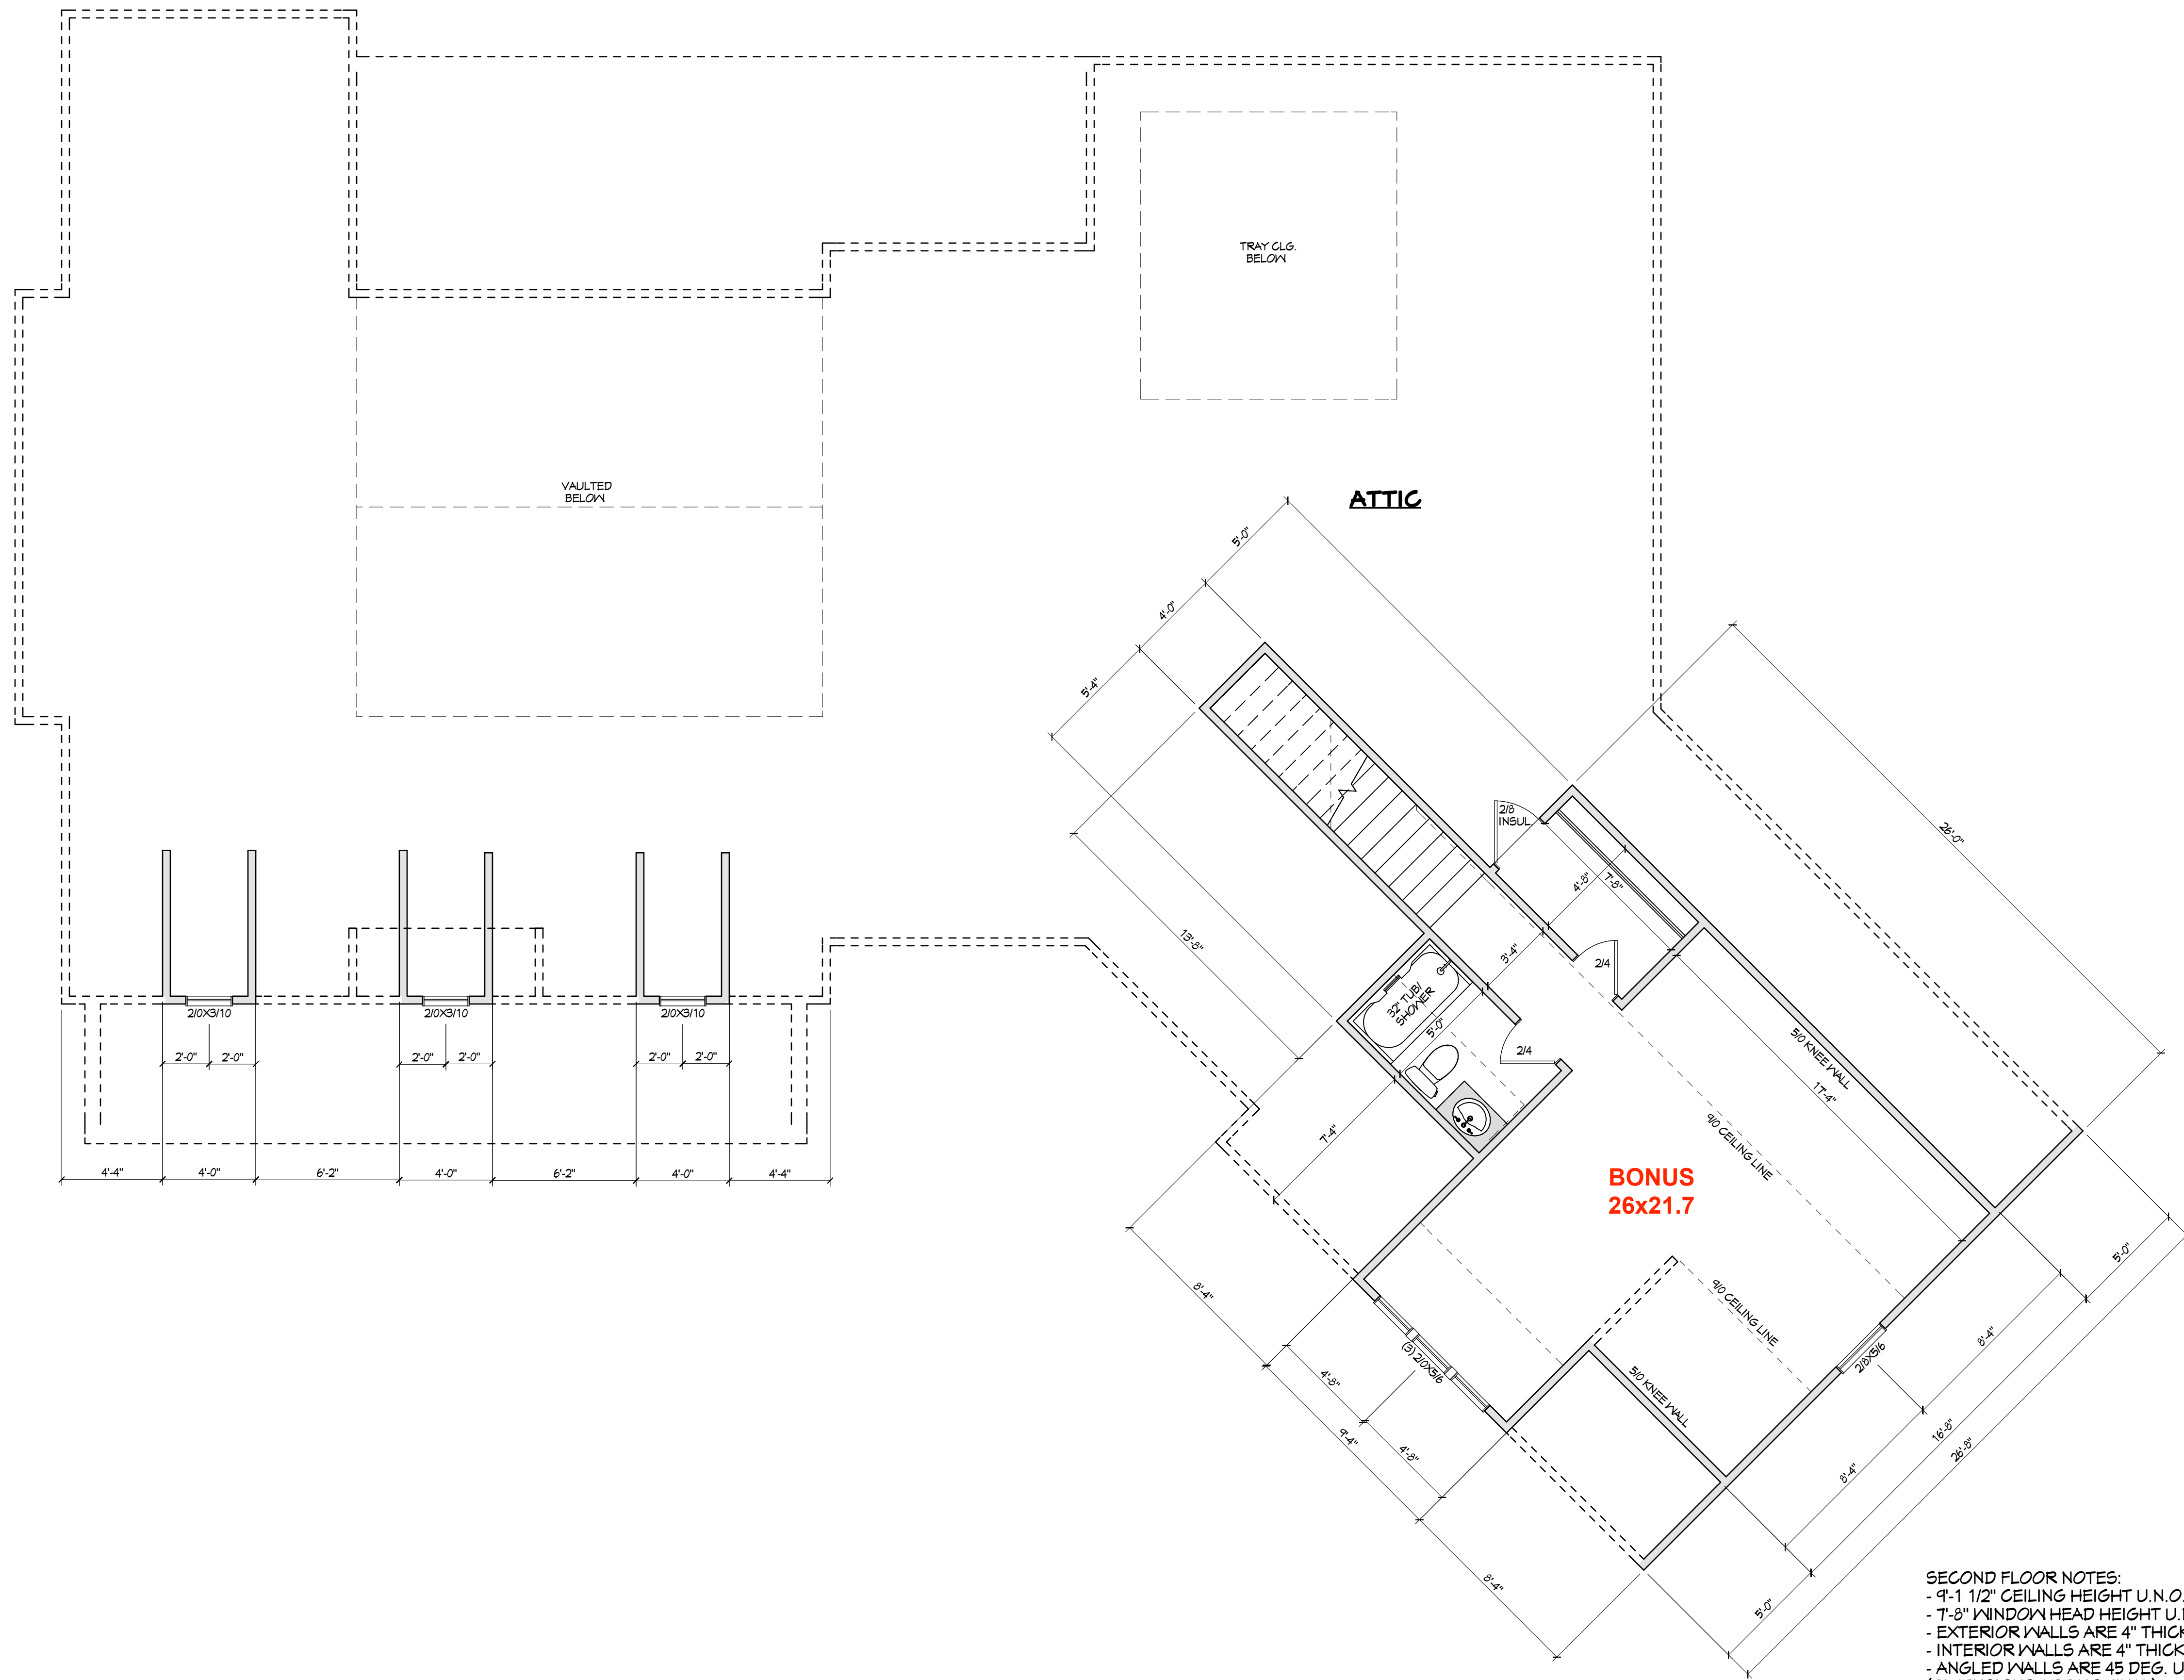

SECOND FLOOR PLAN

SCALE: 1/4" = 1'-0"

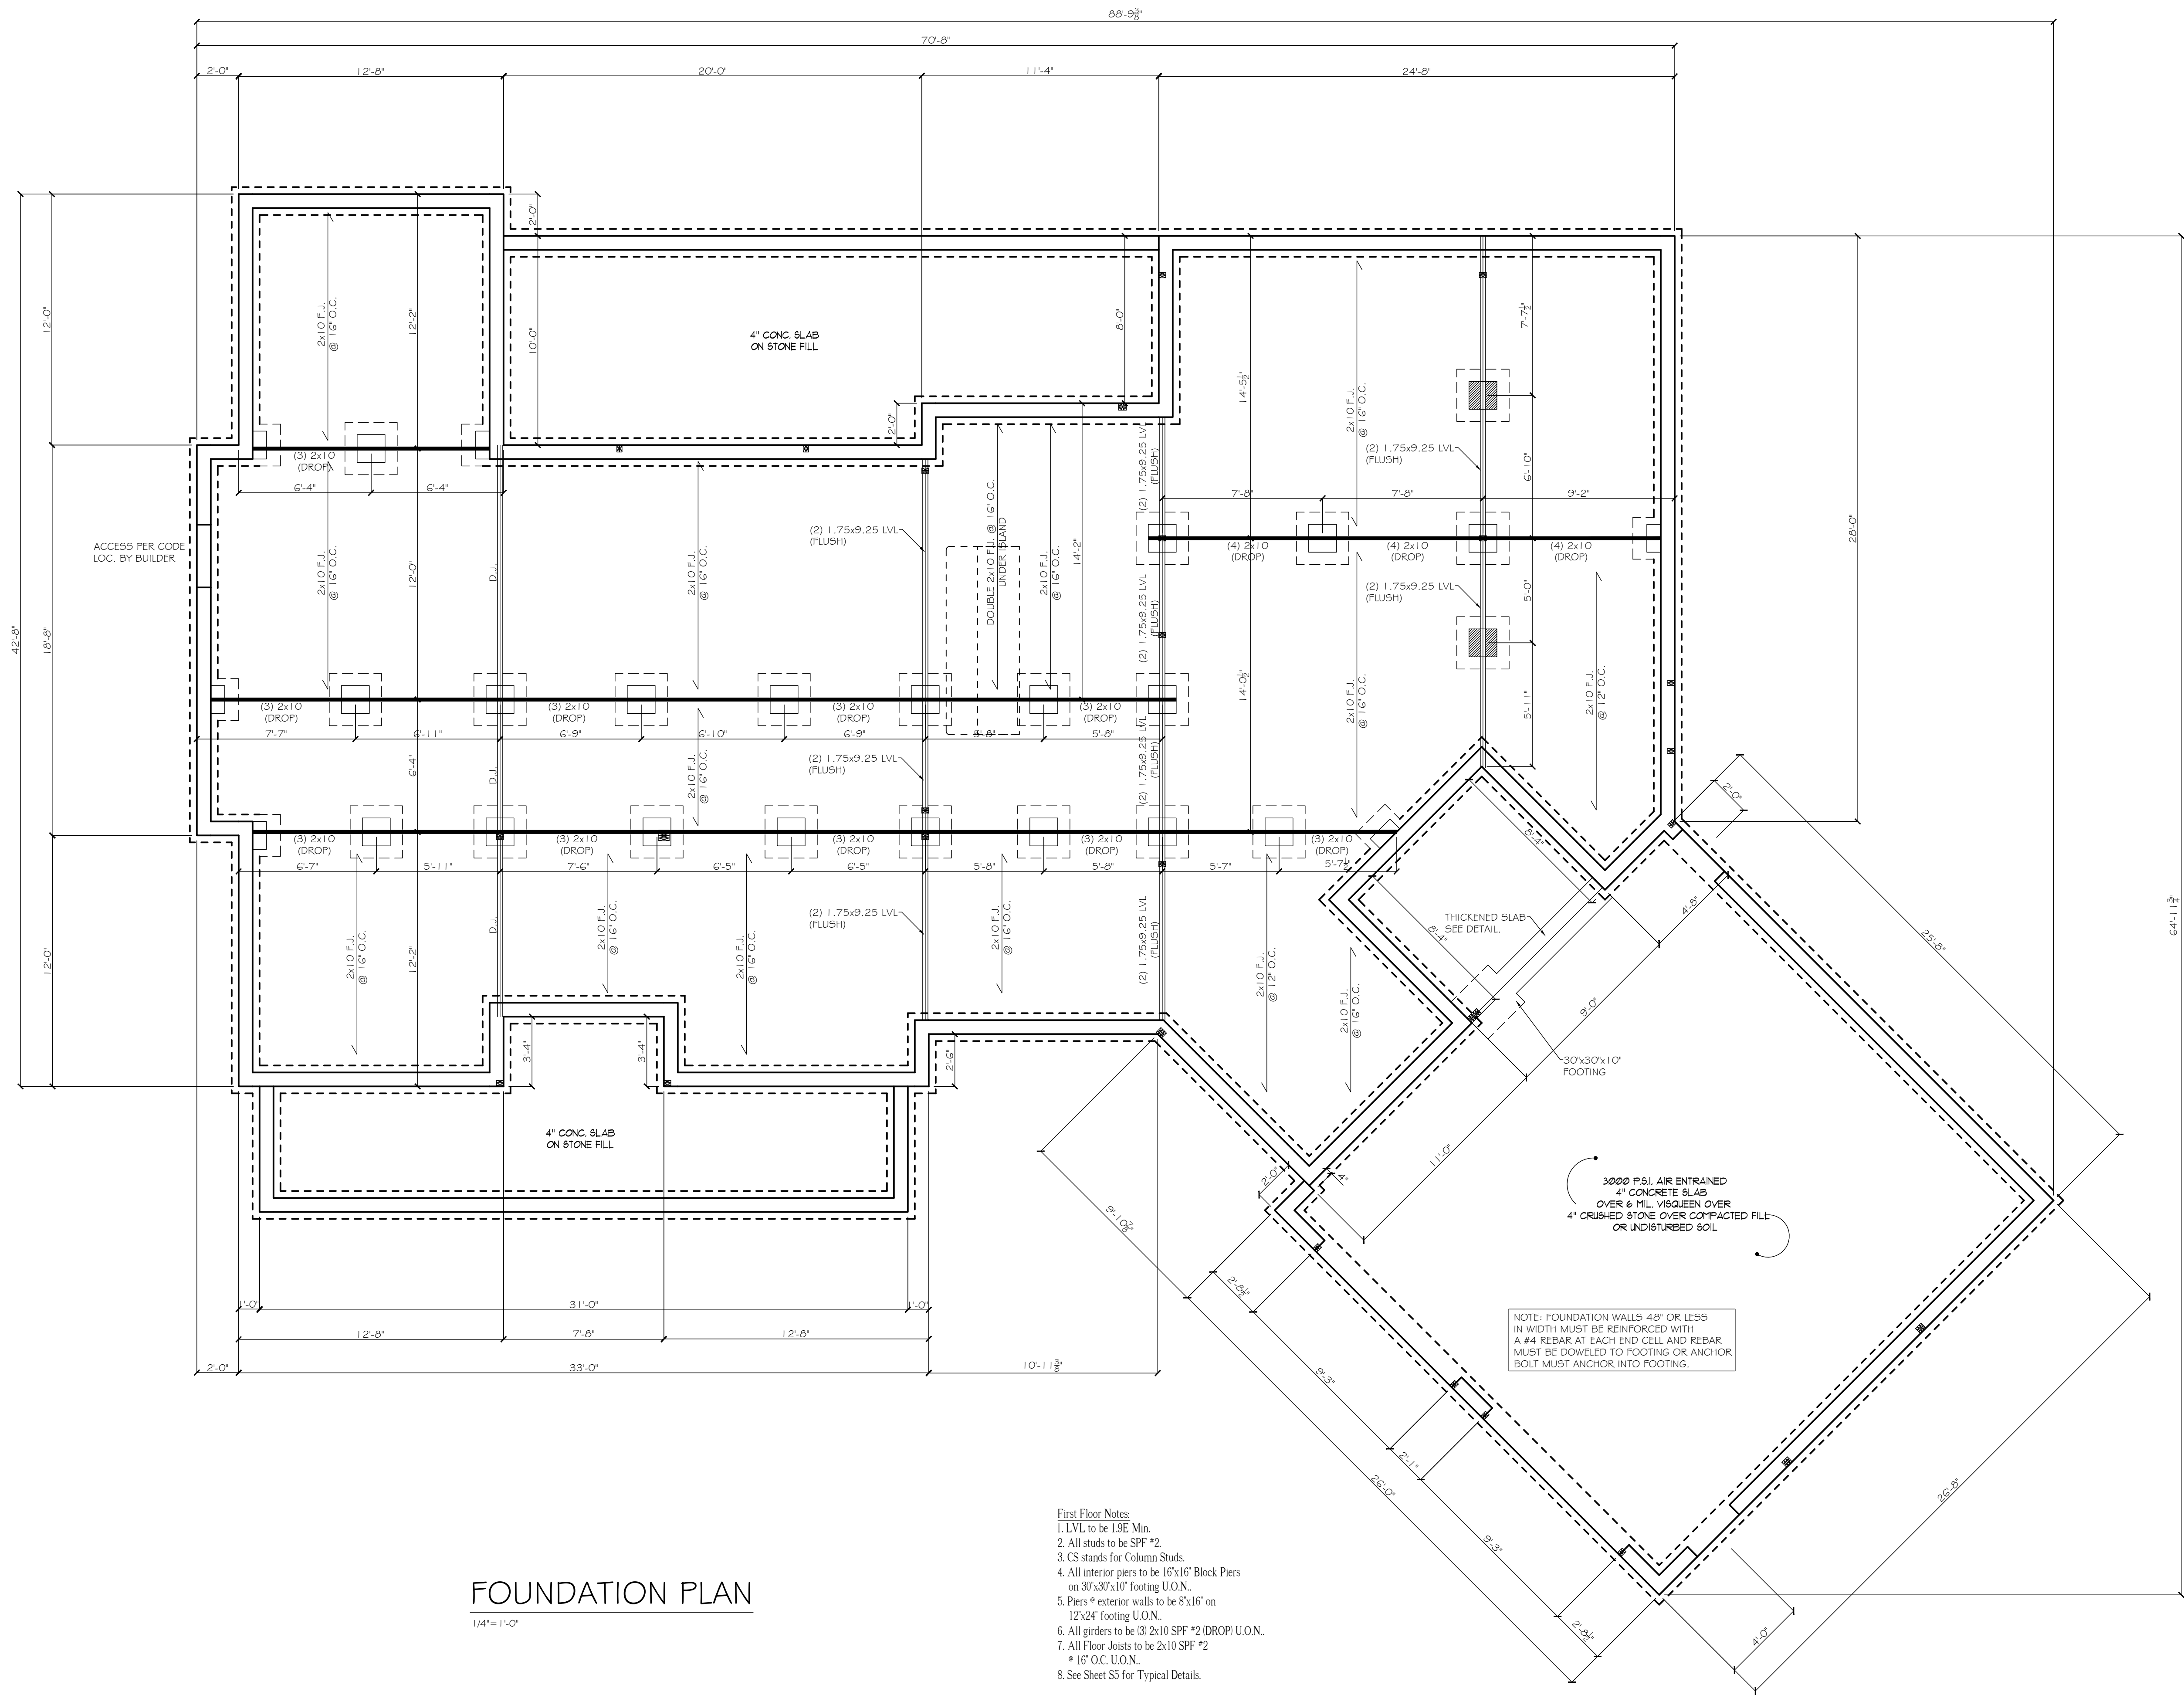

- First Floor Notes:
1. LVL to be 1.9E Min.
 2. All studs to be SPF #2
 3. CS stands for Column Studs.
 4. All interior piers to be 16"x16" Block Piers on 30"x30"x10" footing U.O.N.
 5. Piers * exterior walls to be 8"x16" on 12"x24" footing U.O.N.
 6. All girders to be (3) 2x10 SPF #2 (DROP) U.O.N.
 7. All Floor Joists to be 2x10 SPF #2 * 16" O.C. U.O.N.
 8. See Sheet S5 for Typical Details.




HERITAGE
HOME DESIGNS, Inc.
EMAIL: tim-hsd@nc.rr.com



HARRIS
STRUCTURAL DESIGN, PA
PH: (919) 556-6032
FAX: (919) 556-6032
CELL: (919) 946-0798
3206 Heritage Trade Dr. Ste. 116
Wake Forest, NC 27587
EMAIL: thomas-hsd@nc.rr.com

Corp. License Number C-2550

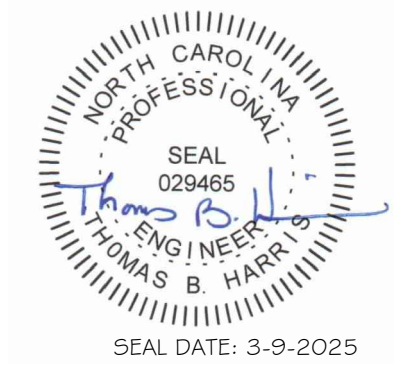

SEAL
029485
ENGINEER
THOMAS S. HARRIS
SEAL DATE: 3-9-2025

HW CUSTOM HOMES
LOT 58 PILOT RIDGE

Copyright © 2025 by
Harris Structural
Design, PA.
All rights reserved.


All drawings and copies thereof are
instruments of service and as such
remain the property of Harris Structural
Design, PA. They are produced for
one-time use only with respect to this
project. Harris Structural Design, PA
reserves the right to use these plans
at its own discretion. Approval from a
licensed building inspector will be the
responsibility of the consumer if required.
Nominal dimensions may be used. Do not
scale drawings.

issue date:

dwg. by TWB
ckd. by TBH

content
FOUNDATION PLAN

sheet
S1

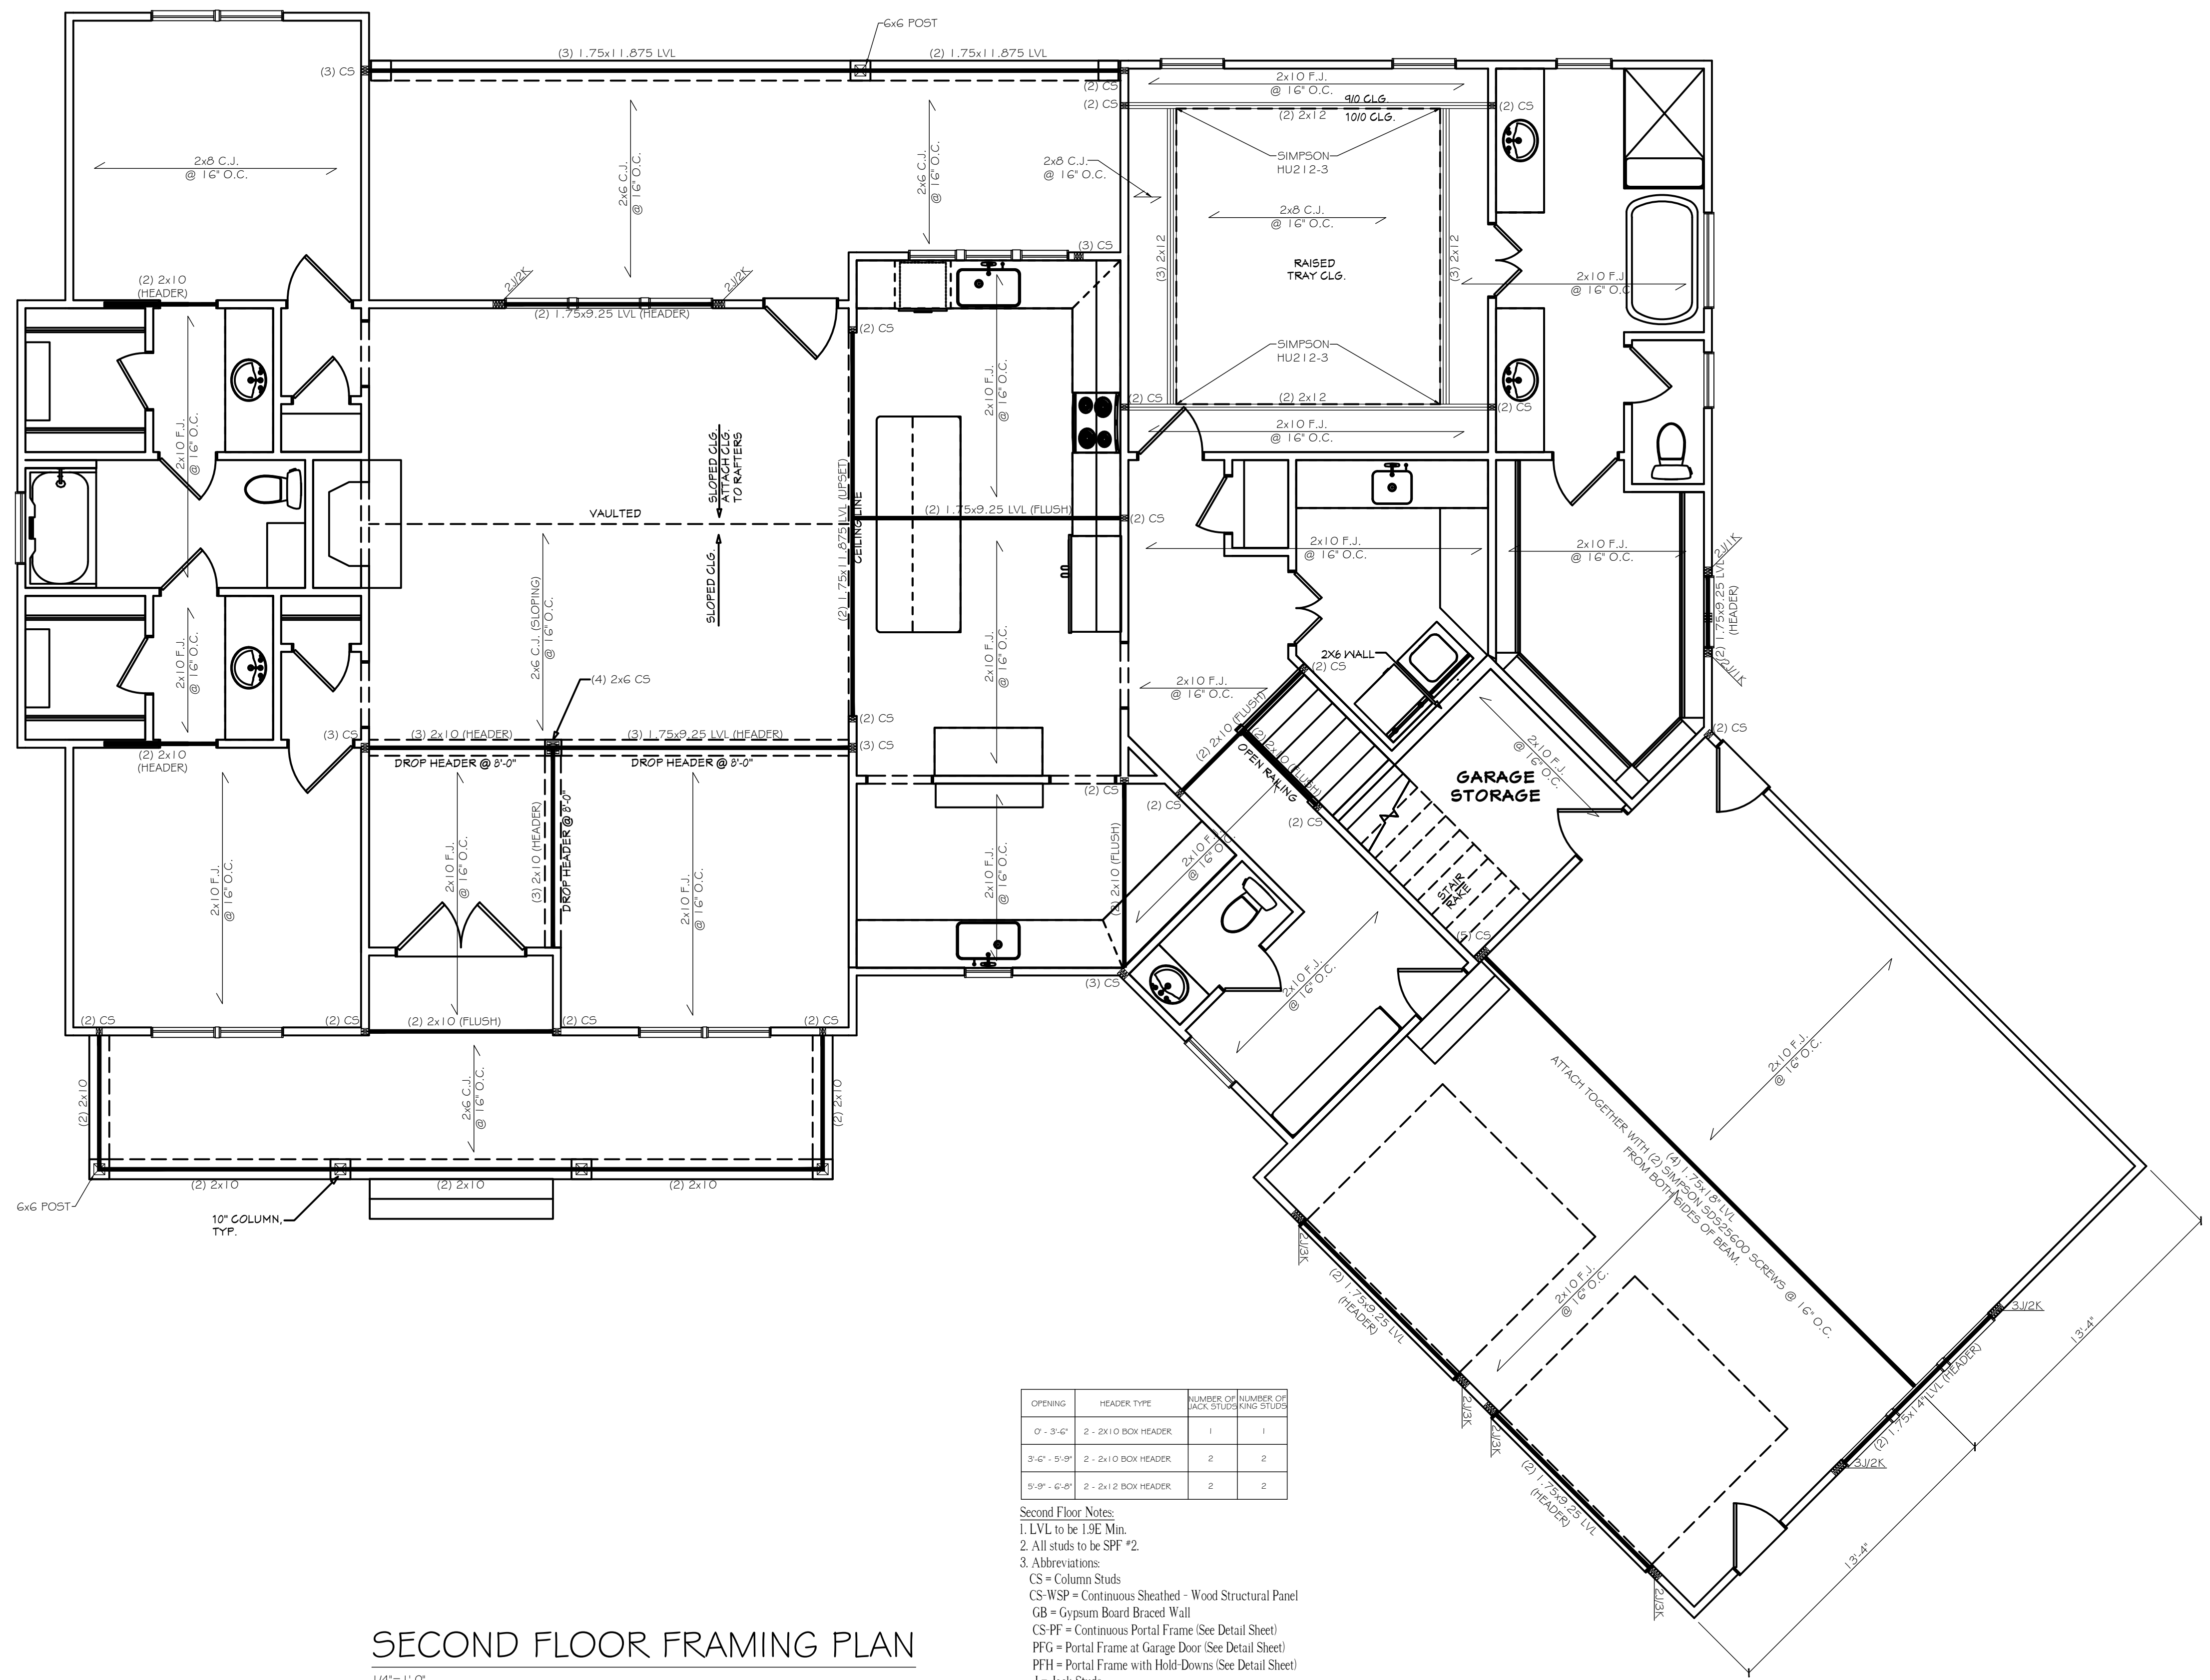

SECOND FLOOR FRAMING PLAN

1/4"=1'-0"

OPENING	HEADER TYPE	NUMBER OF JACK STUDS	NUMBER OF KING STUDS
0' - 3'-6"	2 - 2x10 BOX HEADER	1	1
3'-6" - 5'-9"	2 - 2x10 BOX HEADER	2	2
5'-9" - 6'-0"	2 - 2x12 BOX HEADER	2	2

- Second Floor Notes:
1. LVL to be 1.9E Min.
2. All studs to be SPF #2.
3. Abbreviations:
CS = Column Studs
WSP = Continuous Sheathed - Wood Structural Panel
GB = Gypsum Board Braced Wall
CS-PF = Continuous Portal Frame (See Detail Sheet)
PFG = Portal Frame at Garage Door (See Detail Sheet)
PFH = Portal Frame with Hold-Downs (See Detail Sheet)
J = Jack Studs
K = King Studs (Full Height)
4. All Floor Joists to be 2x10 SPF #2
* 16" O.C. U.O.N.
5. See Sheet S5 for Typical Details.



HARRIS

STRUCTURAL DESIGN, PA

3206 Heritage Trade Dr., Ste. 116
Wake Forest, NC 27587
EMAIL: thomas-hsd@nc.rr.com
PH: (919) 556-6032
FAX: (919) 556-6032
CELL: (919) 946-0798

Corp. License Number C-2550



HW CUSTOM HOMES
LOT 58 PILOT RIDGE

Copyright © 2025 by
Harris Structural
Design, PA.
All rights reserved.

All drawings and copies thereof are instruments of service and as such remain the property of Harris Structural Design, PA. They are produced for one-time use only with respect to this project. Harris Structural Design, PA reserves the right to use these plans at its own discretion. Approval from a licensed building inspector will be the responsibility of the consumer if required. Nominal dimensions may be used. Do not scale drawings.

issue date:


dwg. by TWB
ckd. by TBH

content

CEILING FRAMING PLAN

sheet

S3

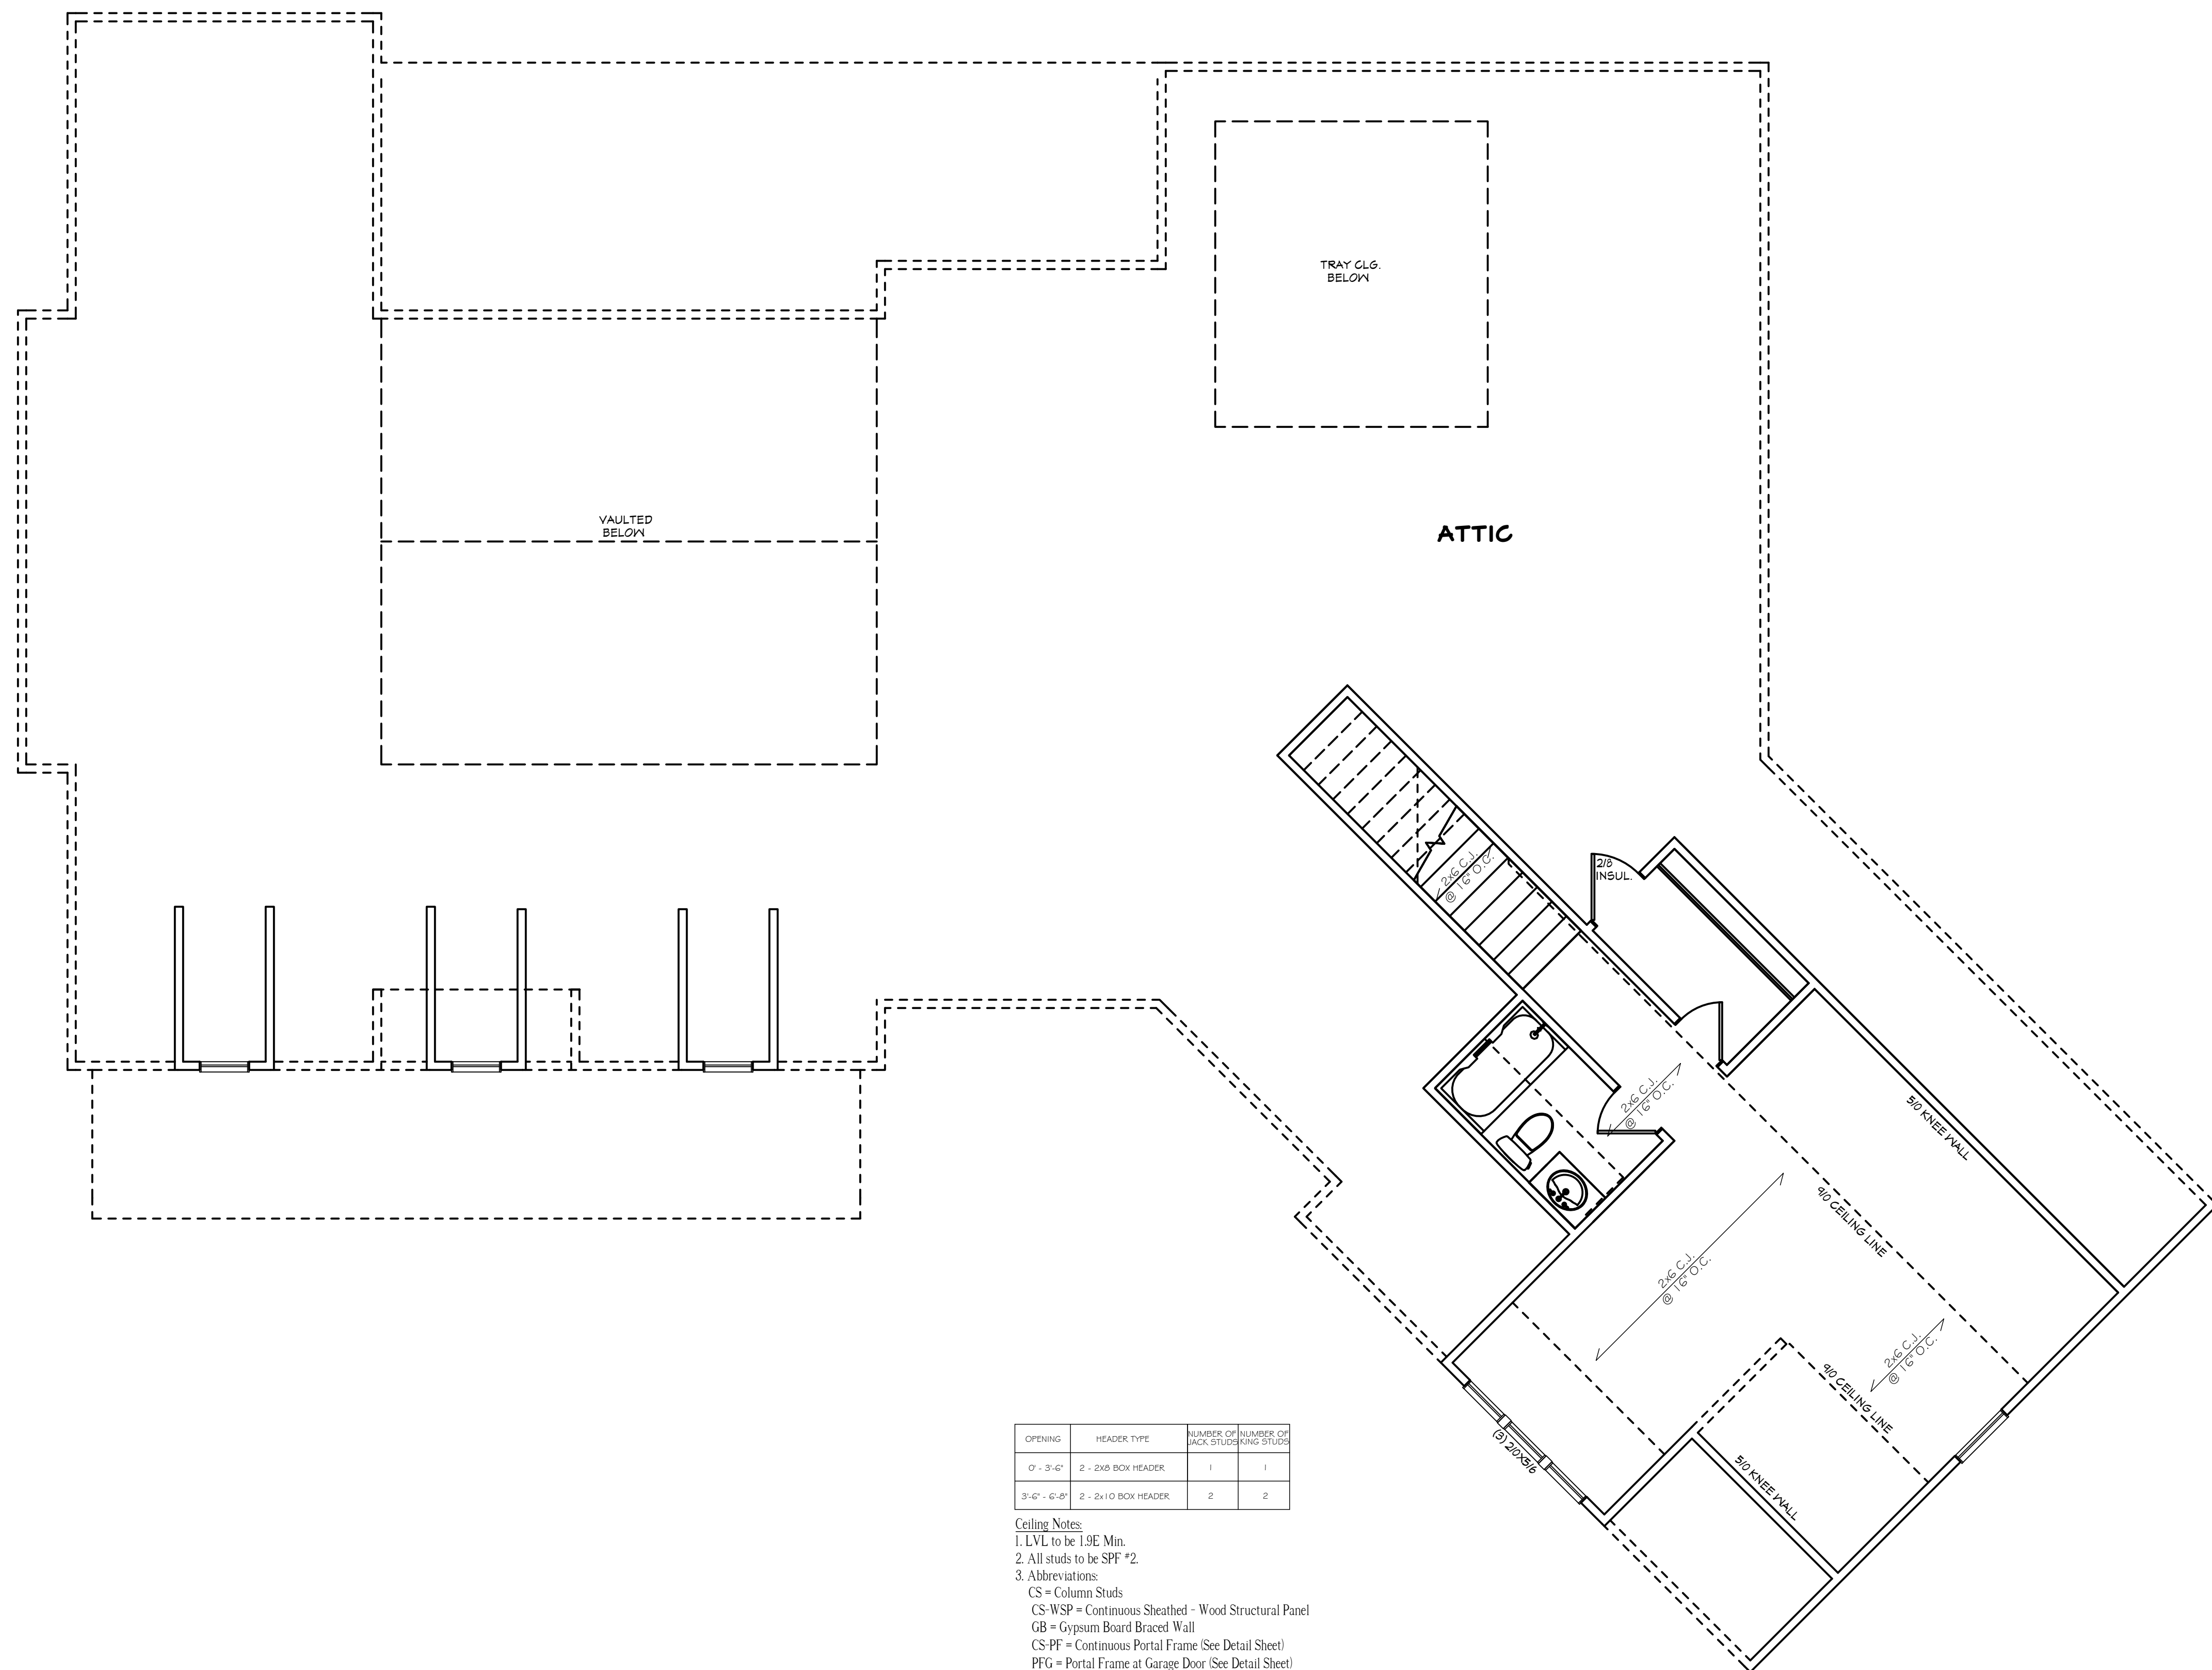


CEILING FRAMING PLAN

$$1/4'' = 1' - 0$$

OPENING	HEADER TYPE	NUMBER OF JACK STUDS	NUMBER OF KING STUDS
0' - 3'-6"	2 - 2X8 BOX HEADER	1	1
3'-6" - 6'-0"	2 - 2X10 BOX HEADER	2	2

Ceiling Notes:

- 1. LVL to be 1.9E Min.
- 2. All studs to be SPF #2.
- 3. Abbreviations:
 - CS = Column Studs
 - CS-WSP = Continuous Sheathed - Wood Structural Panel
 - GB = Gypsum Board Braced Wall
 - CS-PF = Continuous Portal Frame (See Detail Sheet)
 - PFG = Portal Frame at Garage Door (See Detail Sheet)
 - PFH = Portal Frame with Hold-Downs (See Detail Sheet)
 - J = Jack Studs
 - K = King Studs (Full Height)
- 4. All ceiling joists to be SPF #2 U.O.N..
- 5. See Sheet S5 for Typical Details.

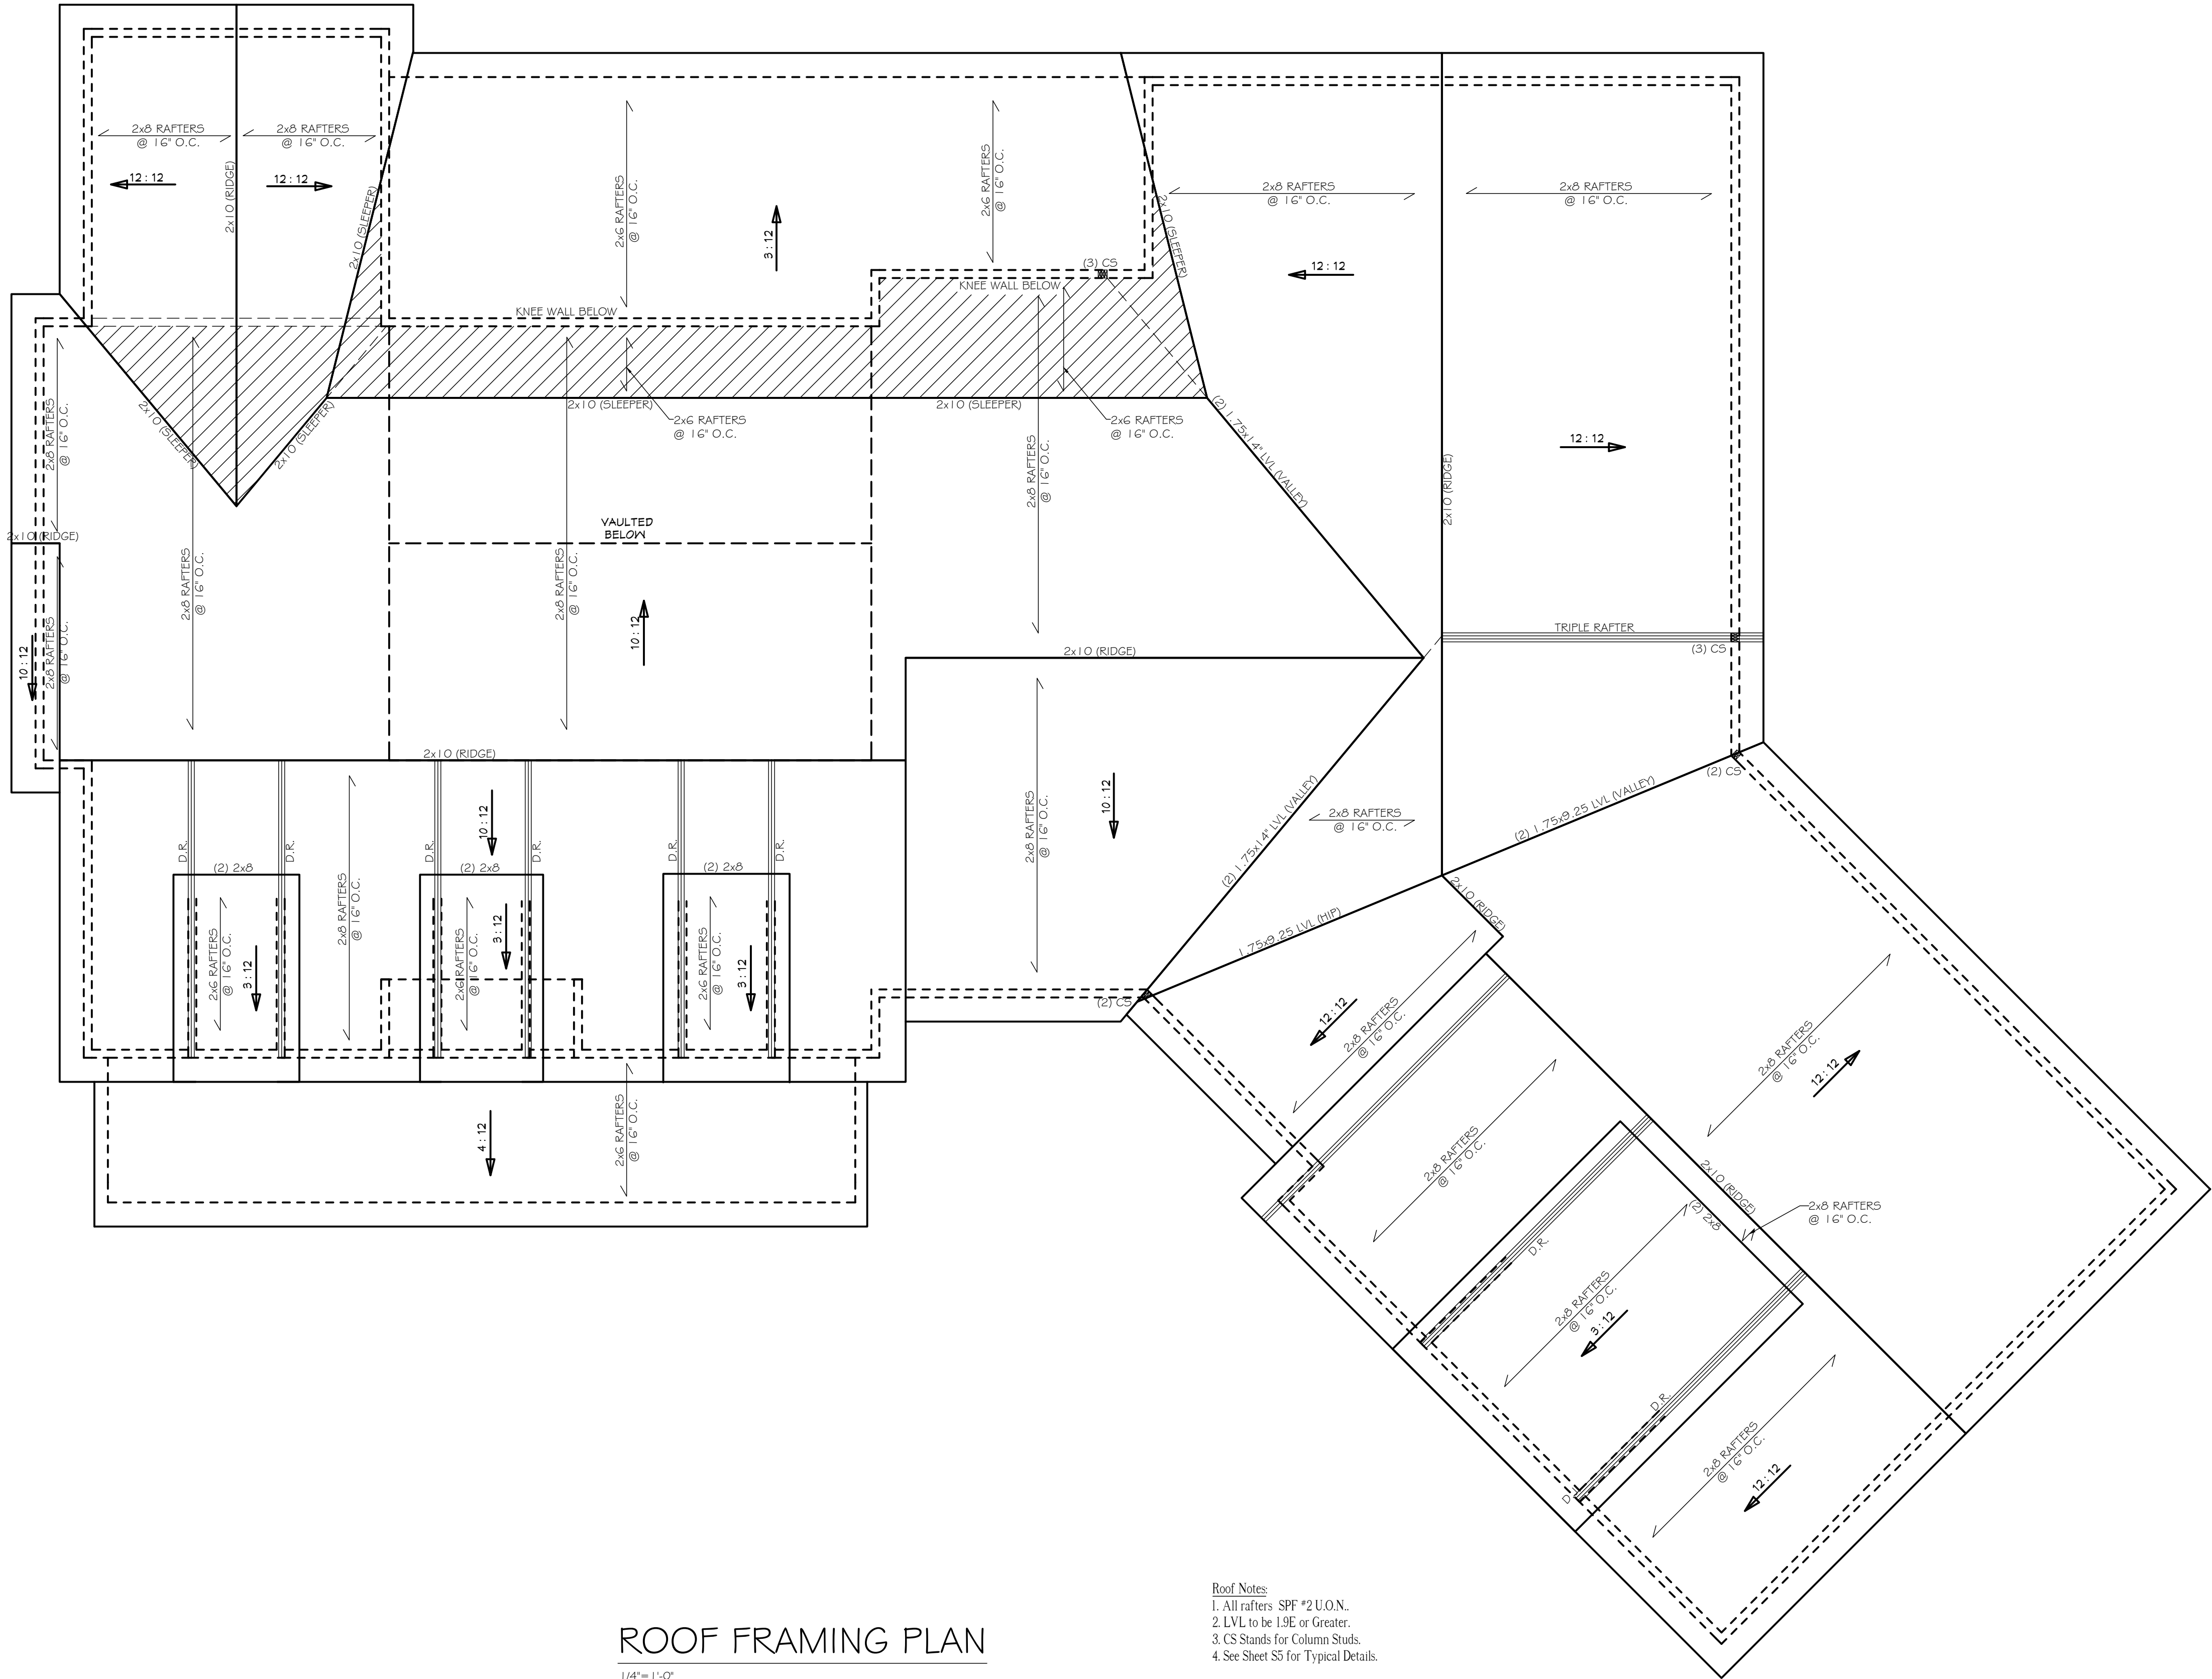


ROOF FRAMING PLAN

1/4"= 1'-0"

- Roof Notes:
1. All rafters SPF #2 U.O.N.
2. LVL to be 1.9E or Greater.
3. CS Stands for Column Studs.
4. See Sheet S5 for Typical Details.

Corp. License Number C-2550

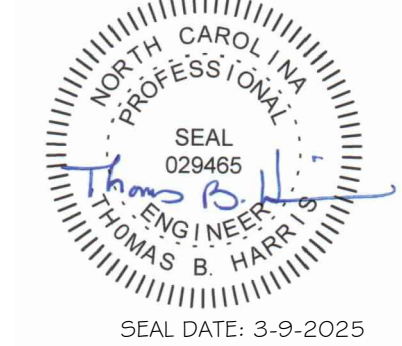

HW CUSTOM HOMES
LOT 58 PILOT RIDGE

Copyright © 2025 by
Harris Structural
Design, PA.
All rights reserved.
All drawings and copies thereof are
instruments of service and as such
remain the property of Harris Structural
Design, PA. They are produced for
one-time use only with respect to this
project. Harris Structural Design, PA
reserves the right to use these plans
at its own discretion. Approval from a
licensed building inspector will be the
responsibility of the consumer if required.
Nominal dimensions may be used. Do not
scale drawings.

issue date:


dwg. by TWB
ckd. by TBH

content


ROOF FRAMING PLAN

sheet


S4

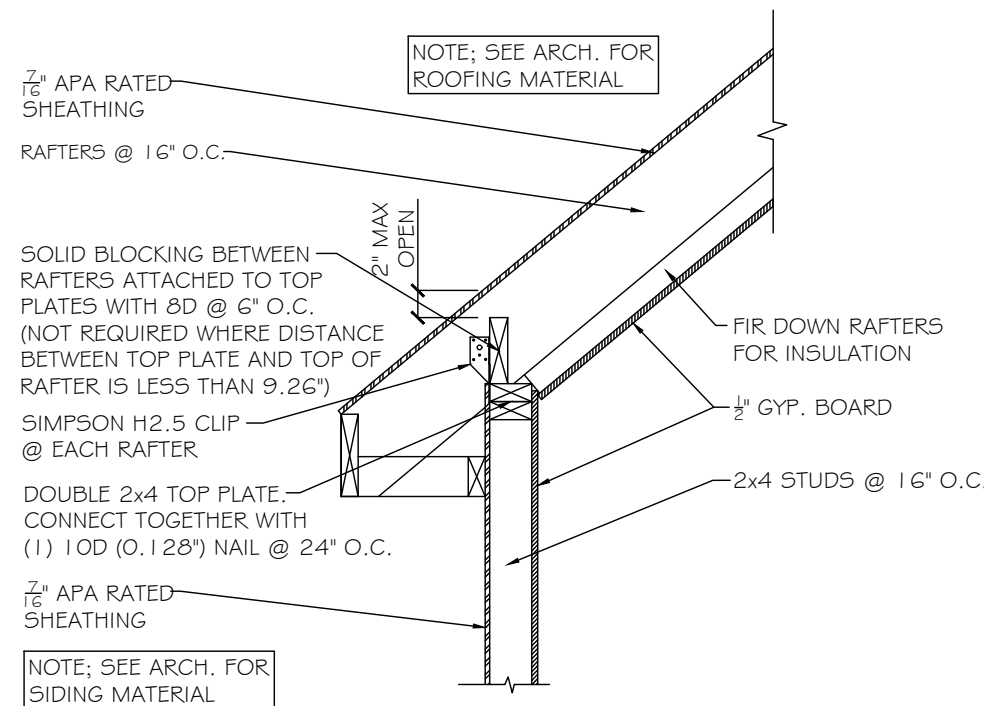


RAFTER BEARING @ VAULTED CEILING

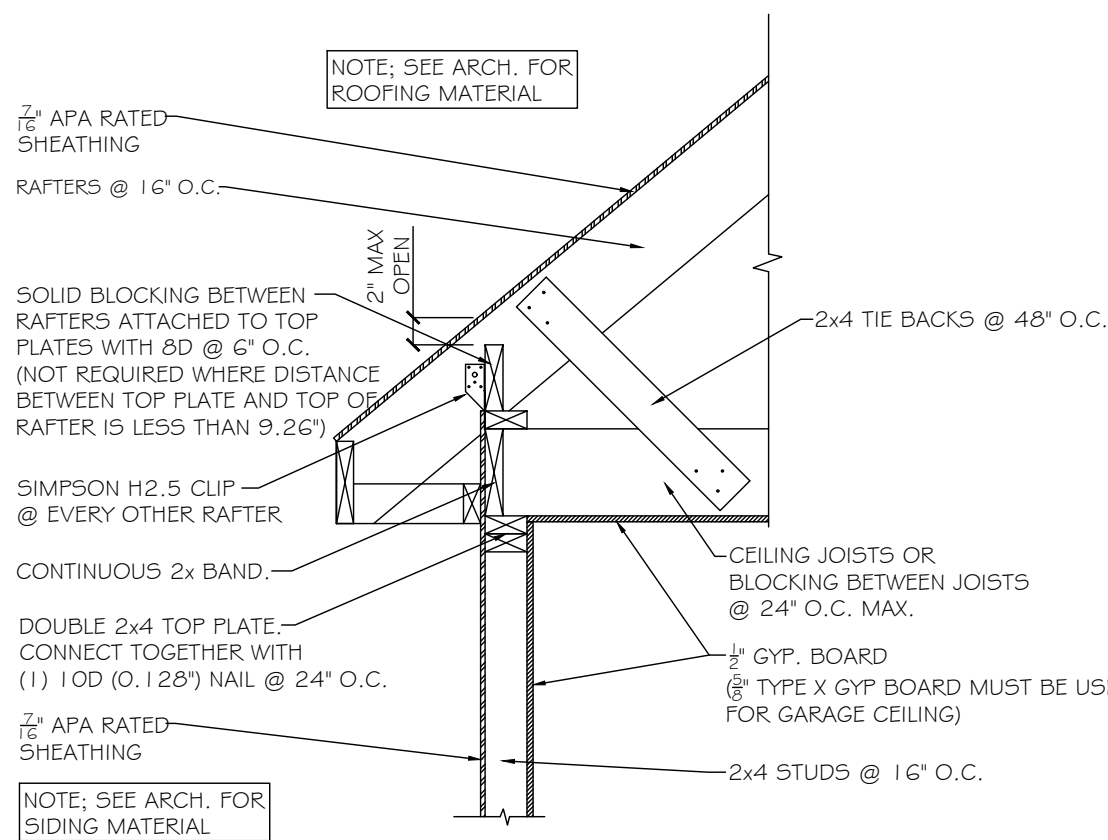

RAFTER BEARING @ FLAT CEILING

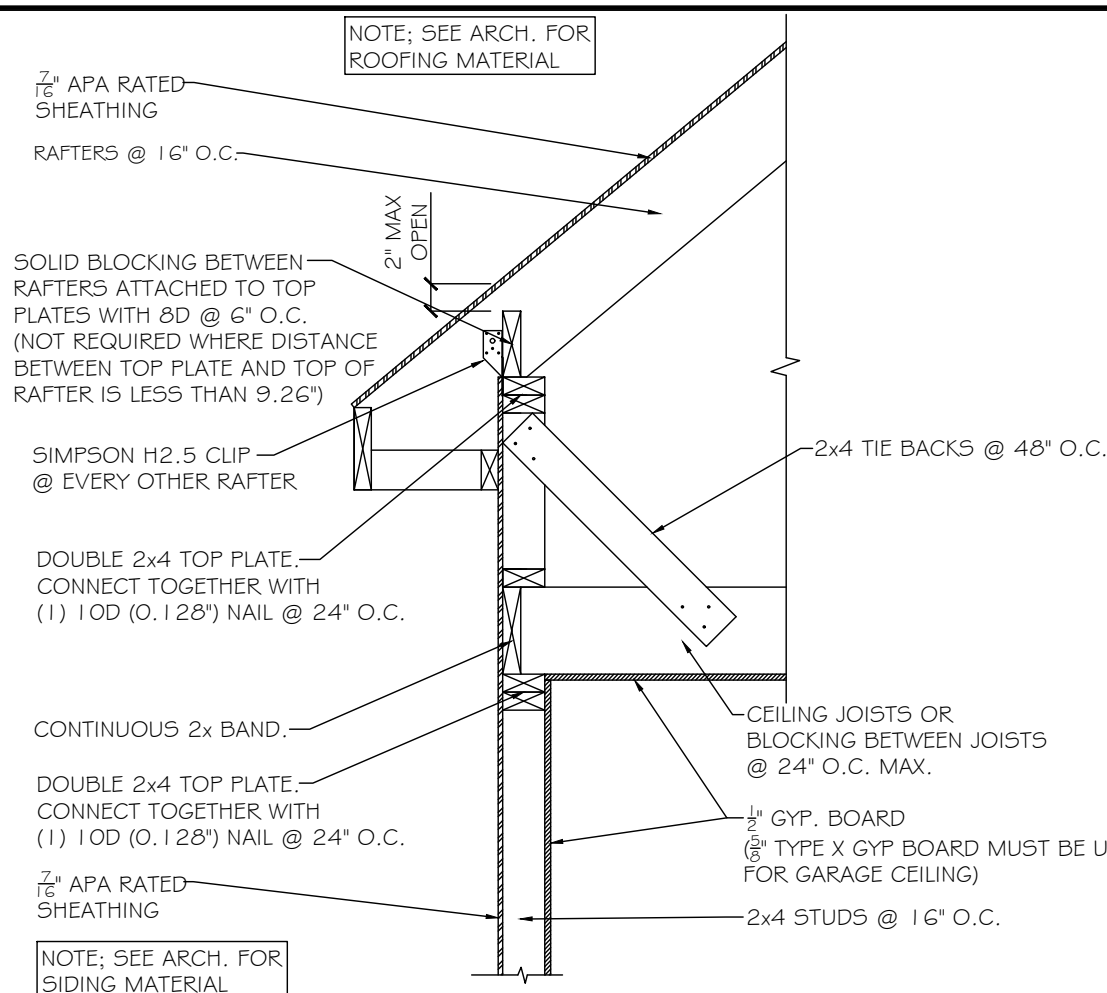


RAFTER BEARING ON KNEE WALL

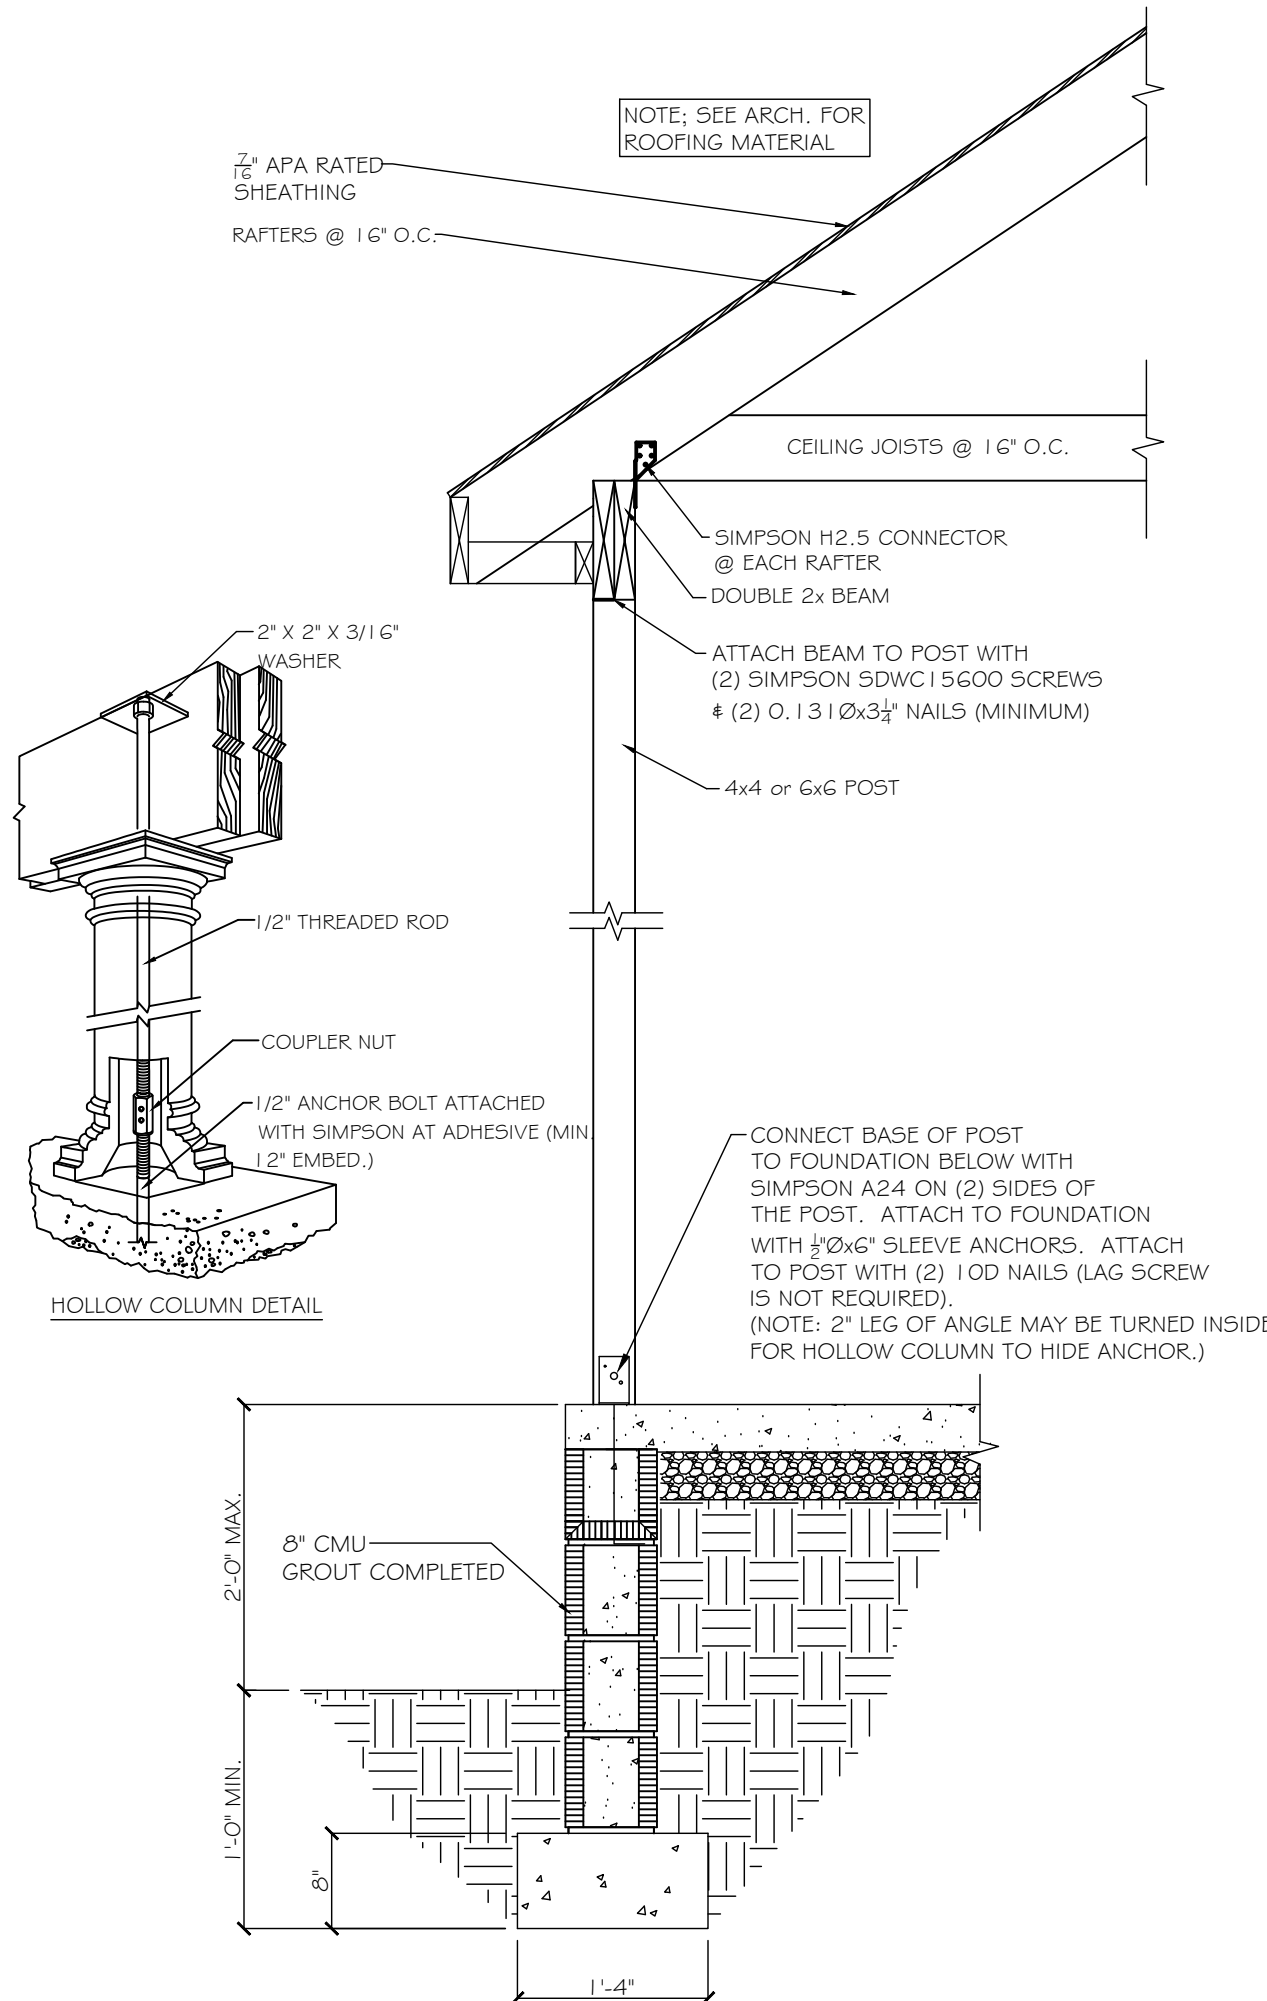


TYPICAL PORCH DETAIL


THICKENED SLAB

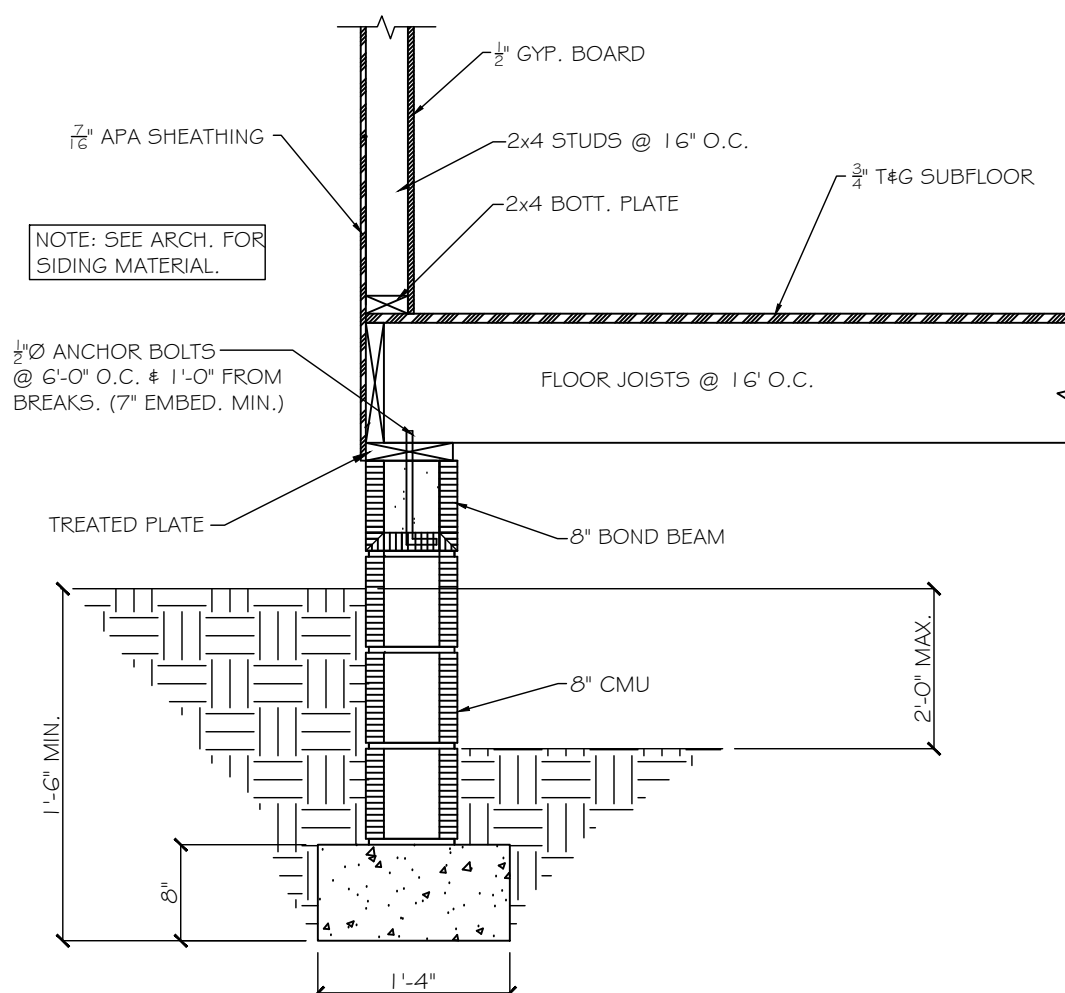


TYPICAL CRAWL SPACE FOUNDATION @ WALL WITH SIDING

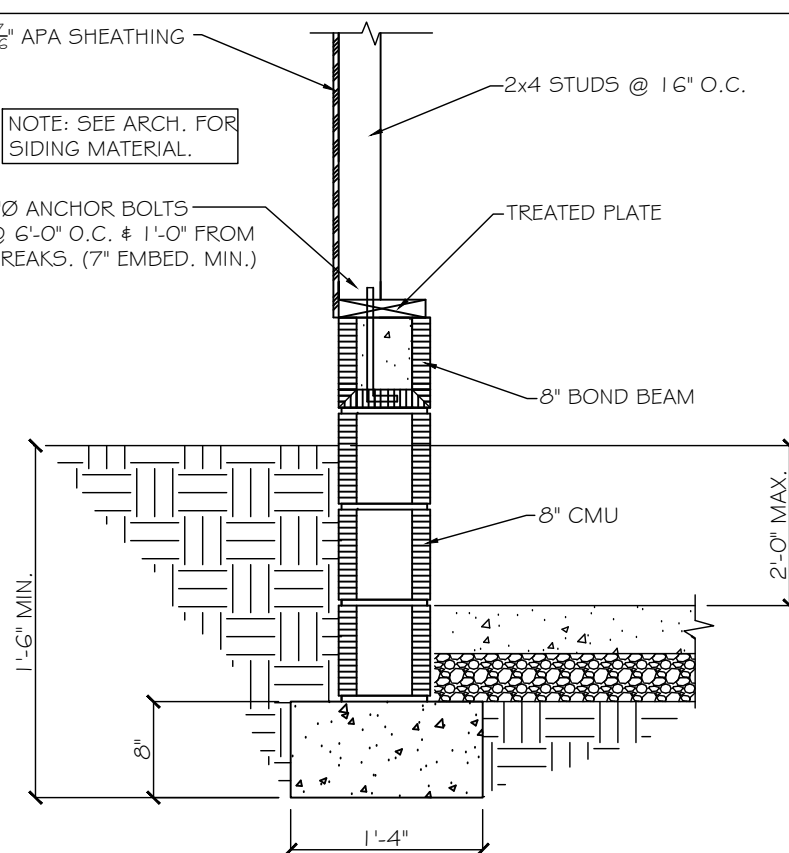

GARAGE FOUNDATION WALL DETAIL

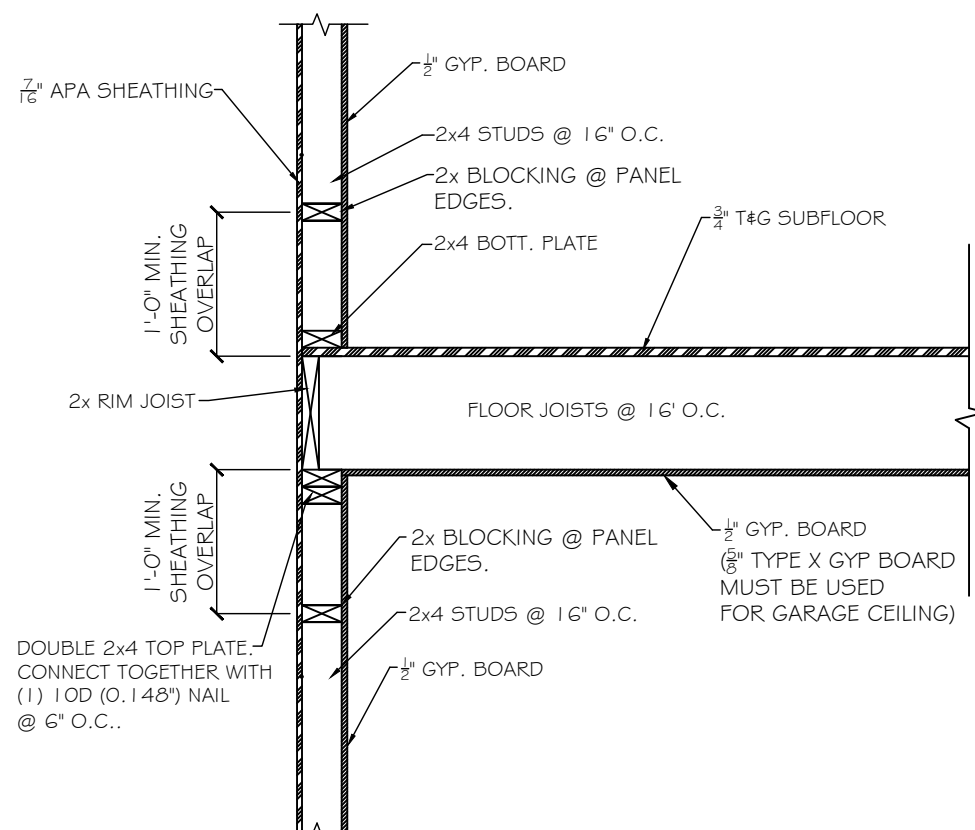

TYPICAL SECOND FLOOR DETAIL

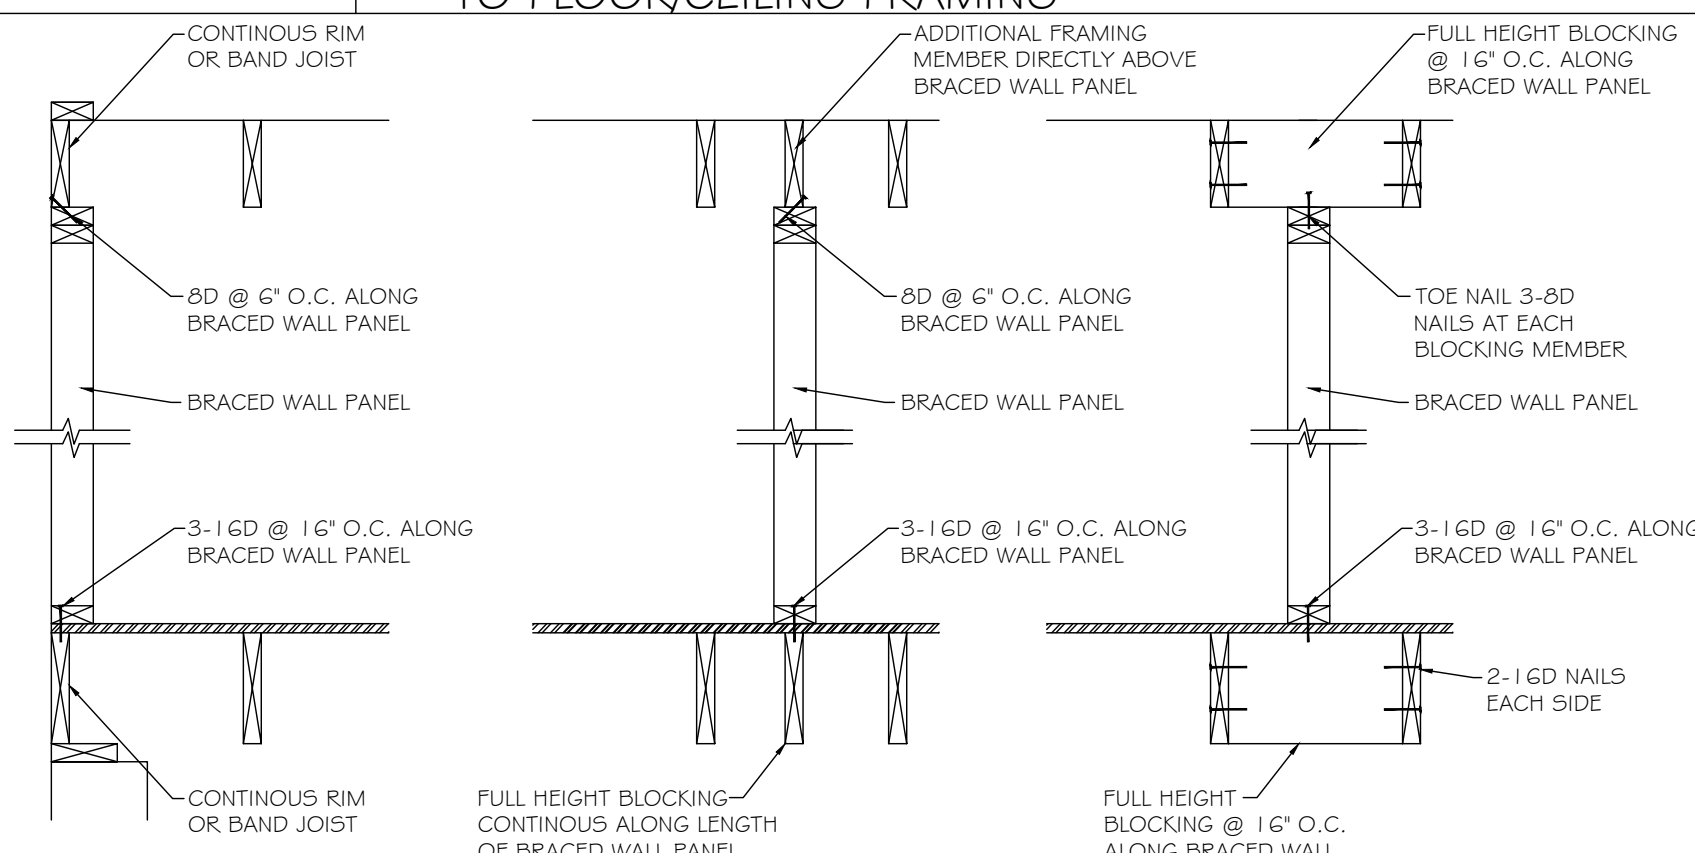

BRACED WALL PANEL CONNECTION WHEN PARALLEL TO FLOOR/CEILING FRAMING

- 1) ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF, RAFTERS, HIP, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS AND HEADERS, COLUMNS, CANTILEVERS, OFFSET, LOAD BEARING WALLS, PIER & GIRDER SYSTEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM.
- 2) ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA STATE RESIDENTIAL CODE & 2018 EDITION PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR AND WILL NOT HAVE CONTROL OF CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 3) DESIGN LOADS (R301.5)
- | | LIVE LOAD | DEAD LOAD | DEFLECTION |
|---------------------------------|--|-----------|------------|
| ROOMS OTHER THAN SLEEPING ROOMS | 40 | 10 | L/360 |
| SLEEPING ROOMS | 30 | 10 | L/360 |
| ATTIC WITH STORAGE | 20 | 10 | L/240 |
| ATTIC WITH OUT STORAGE | 10 | 10 | L/360 |
| STAIRS | 40 | 10 | L/360 |
| EXTERIOR BALCONIES | 60 | 10 | L/360 |
| DECKS | 60 | 10 | L/360 |
| GUARDRAILS AND HANDRAILS | 200 | 10 | ---- |
| PASSENGER VEHICLE GARAGES | 50 | 10 | L/360 |
| FIRE ESCAPES | 20 | 10 | L/360 |
| SNOW | 20 | 10 | ---- |
| WIND LOAD | (BASED ON 15 MPH WIND VELOCITY & EXPOSURE B) | | |
- 4) FOR WALL BRACING REQUIREMENTS REFER TO SECTION R602.10 OF THE NORTH CAROLINA STATE RESIDENTIAL CODE (2018 EDITION (UNC)). LATERAL BRACING SHALL BE SATISFIED BY CONTINUOUSLY SHEATHING WALLS WITH STRUCTURAL SHEATHING INSTALLED PER TABLE R602.10.2. NOTE THAT ANY SPECIFIC BRACED WALL DETAIL SHALL BE INSTALLED AS SPECIFIED.
- 5) CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (UNC). AIR ENTRAINMENT PER TABLE 409.2.
- 6) ALL FRAMING LUMBER SHALL BE SPF 12 (Fb = 875 PSI) UNLESS NOTED OTHERWISE (UNC).
- 7) L.V.L. SHALL BE LAMINATED VENEER LUMBER OR PARALLEL STRAND LUMBER (PSL) WITH THE FOLLOWING PROPERTIES: Fb = 2800 PSI; Fv = 285 PSI; E = 1,800,000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S INSTRUCTIONS.
- 8) ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2 INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER x 4" LONG). LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOIST ARE TOE NAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. .
- 9) FLITCH BEAMS SHALL BE BOLTED TOGETHER USING 1/2" DIAMETER BOLTS (ASTM A307) WITH WASHERS PLACED UNDER THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM) AND STAGGERED TOP AND AT BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.
- 10) BRICK LINTELS SHALL BE 3 1/2"x3 1/2"x1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"x4"x5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 8'-0" (UNC).
- 11) THE POSITIVE AND NEGATIVE DESIGN PRESSURE FOR DOORS AND WINDOWS FOR A MEAN ROOF HEIGHT OF 35 FEET OR LESS SHALL BE 25 PSF.
- 12) IF ANY PART OF THE CLEAR OPENING OF THE OPERABLE PORTION OF A WINDOW IS LOCATED MORE THAN 12" ABOVE THE EXTERIOR GRADE THEN THE LOWEST PART OF THE CLEAR OPENING MUST BE AT LEAST 24" ABOVE THE FLOOR OF THE ROOM IN WHICH IT IS LOCATED.

PLANS DESIGNED TO THE 2018 NORTH CAROLINA RESIDENTIAL CODE
HOUSE DESIGNED FOR 115 MPH WIND,
EXPOSURE B
ANCHOR BOLTS SHALL BE MIN. 1/2" DIAMETER & SHALL EXTEND A
MINIMUM 7" INTO MASONRY OR CONCRETE. ANCHOR BOLTS TO BE
NO MORE THAN 6" O.C. AND WITHIN 12" OF ALL PLATE SPLICES.

MEAN ROOF HEIGHT = 19.9'

COMPONENT #	CLADDING DESIGNED FOR THE FOLLOWING LOADS	
MEAN ROOF HGT UP TO 30'	30'-11" - 35'	35'-11" - 40'
ZONE 1	16.5, -18.0	17.3, -18.9
ZONE 2	16.5, -21.0	17.3, -22.1
ZONE 3	16.5, -21.0	17.3, -22.1
ZONE 4	18.0, -19.5	18.9, -20.5
ZONE 5	18.0, -24.1	18.9, -25.3

MINIMUM VALUES FOR ENERGY COMPLIANCE:
ZONE 4
MAX. GLAZING U-FACTOR = 0.35
CEILING: R-38, WALLS: R-15, FLOORS: R-19


HEATED SQUARE FOOTAGE

FINISHED BASEMENT	N/A
FIRST FLOOR	2374 SF
SECOND FLOOR	460 SF
THIRD FLOOR	N/A

UNHEATED SQUARE FOOTAGE

UNFIN BASEMENT	N/A
GARAGE	750 SF
UNFIN STORAGE	N/A
OTHER	503 SF

RESIDENTIAL CODE SUMMARY & NOTES

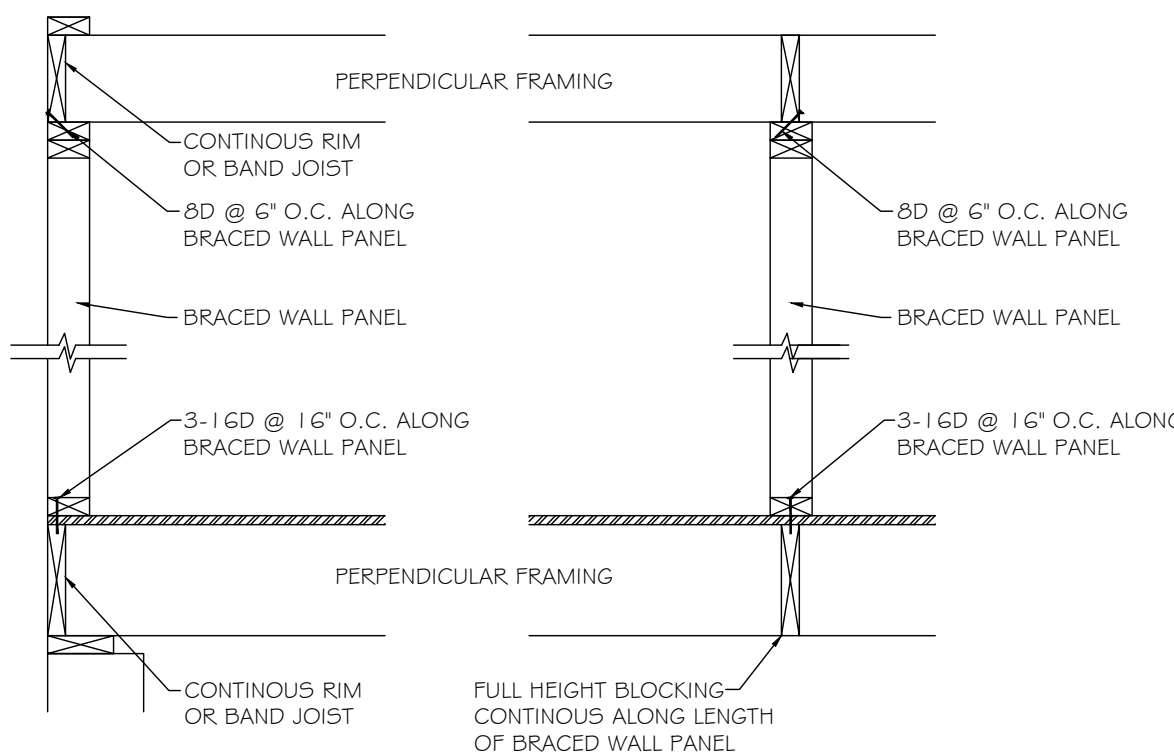

BRACED WALL PANEL CONNECTION WHEN PERPENDICULAR TO FLOOR/CEILING FRAMING