


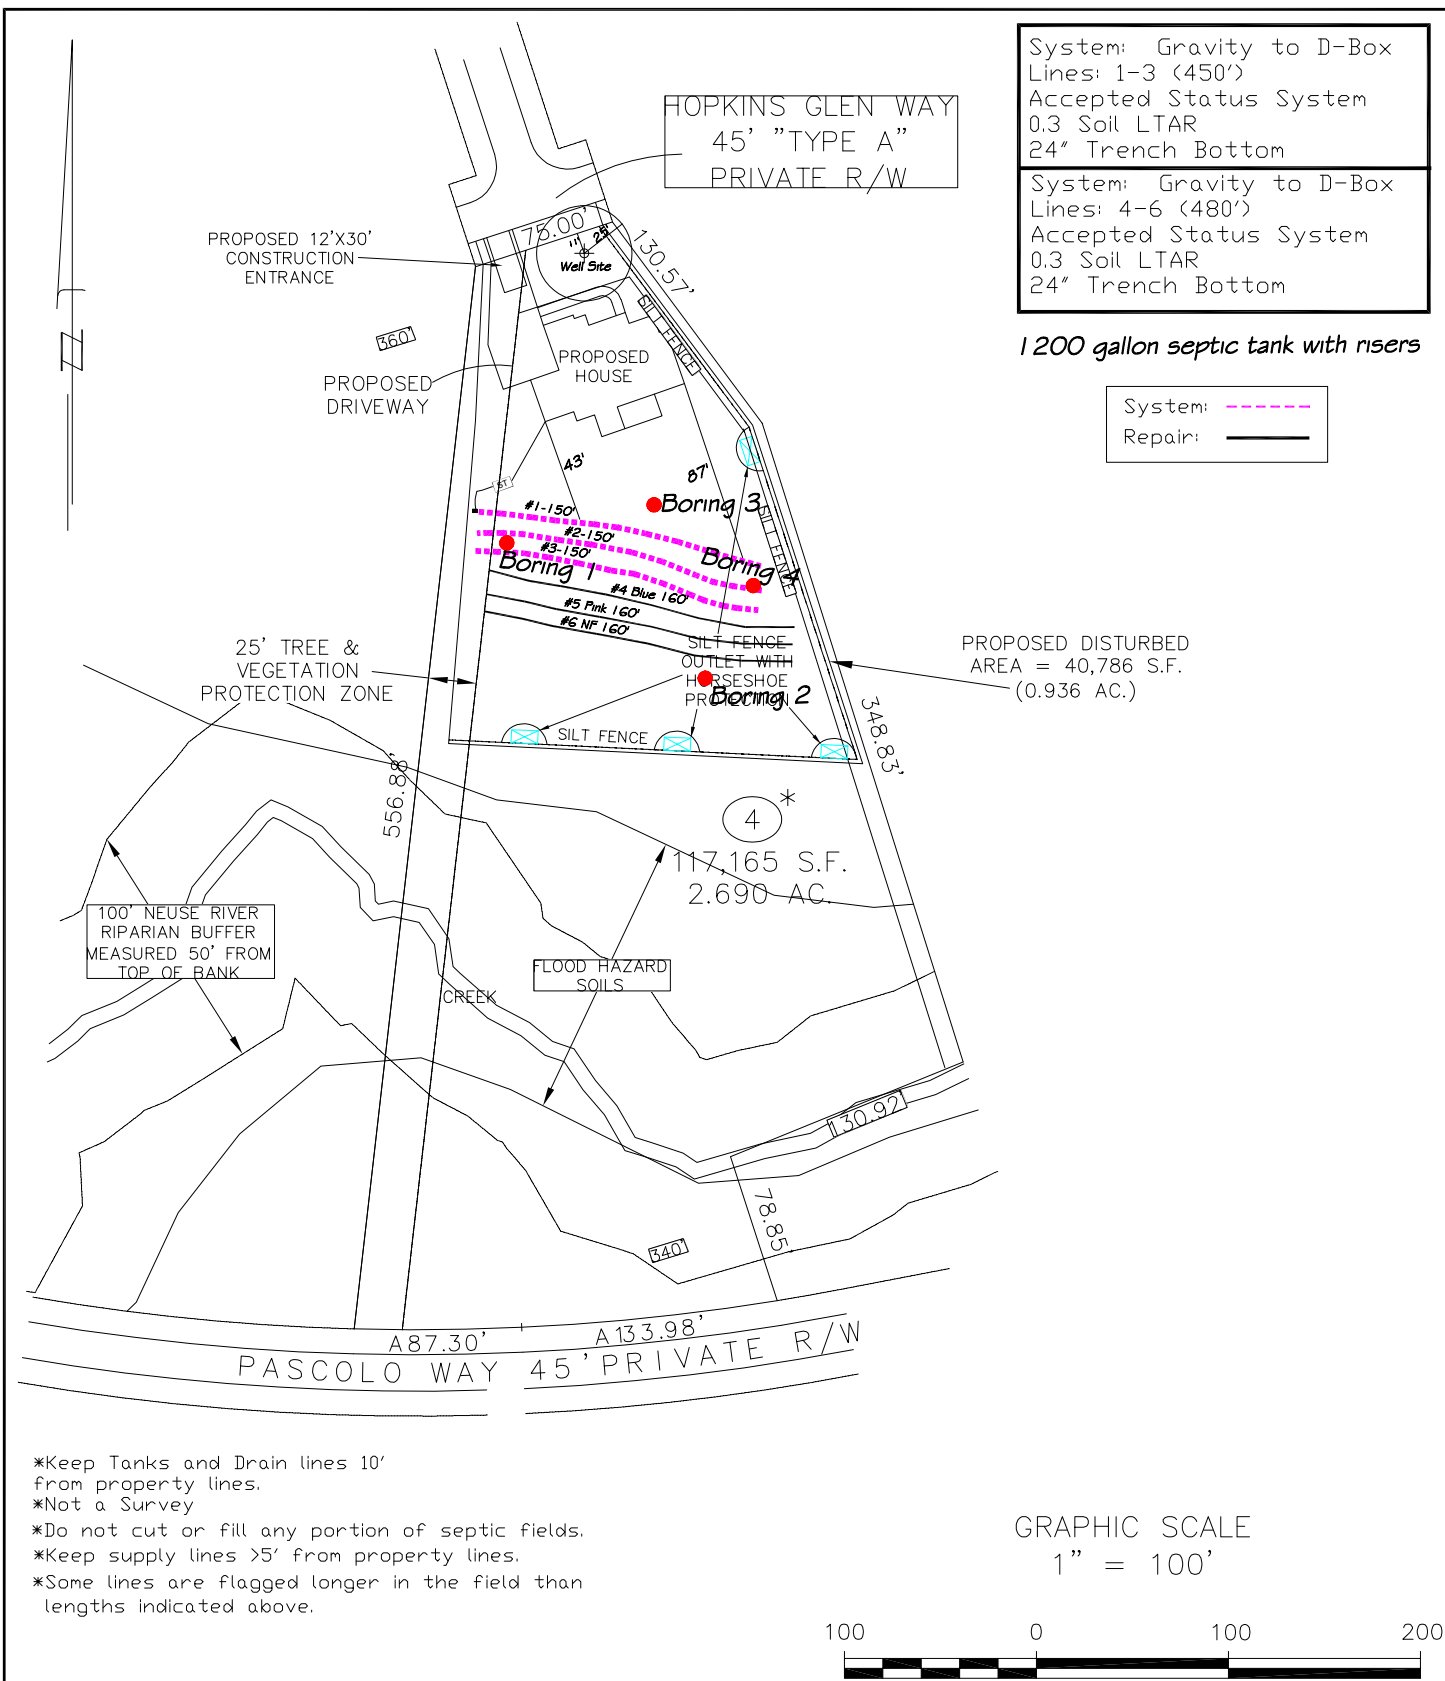

System: Gravity to D-Box
Lines: 1-3 (450')
Accepted Status System
0.3 Soil LTAR
24" Trench Bottom

System: Gravity to D-Box
Lines: 4-6 (480')
Accepted Status System
0.3 Soil LTAR
24" Trench Bottom

1200 gallon septic tank with risers

System: - - - - -
Repair: —————

- *Keep Tanks and Drain lines 10' from property lines.
- *Not a Survey
- *Do not cut or fill any portion of septic fields.
- *Keep supply lines >5' from property lines.
- *Some lines are flagged longer in the field than lengths indicated above.

GRAPHIC SCALE
1" = 100'



Central Carolina Soil Consulting, PLLC 1900 South Main Street, Suite 110 Wake Forest, North Carolina 27587 Phone (919)569-6704 Fax (919)569-6703	4-Bedroom Septic Layout Lennox Manor, Lot 4 Zebulon, North Carolina	Job# : 5294 Drawn By : PC Date : 10/29/25 Revision: 5/29/26
--	---	--