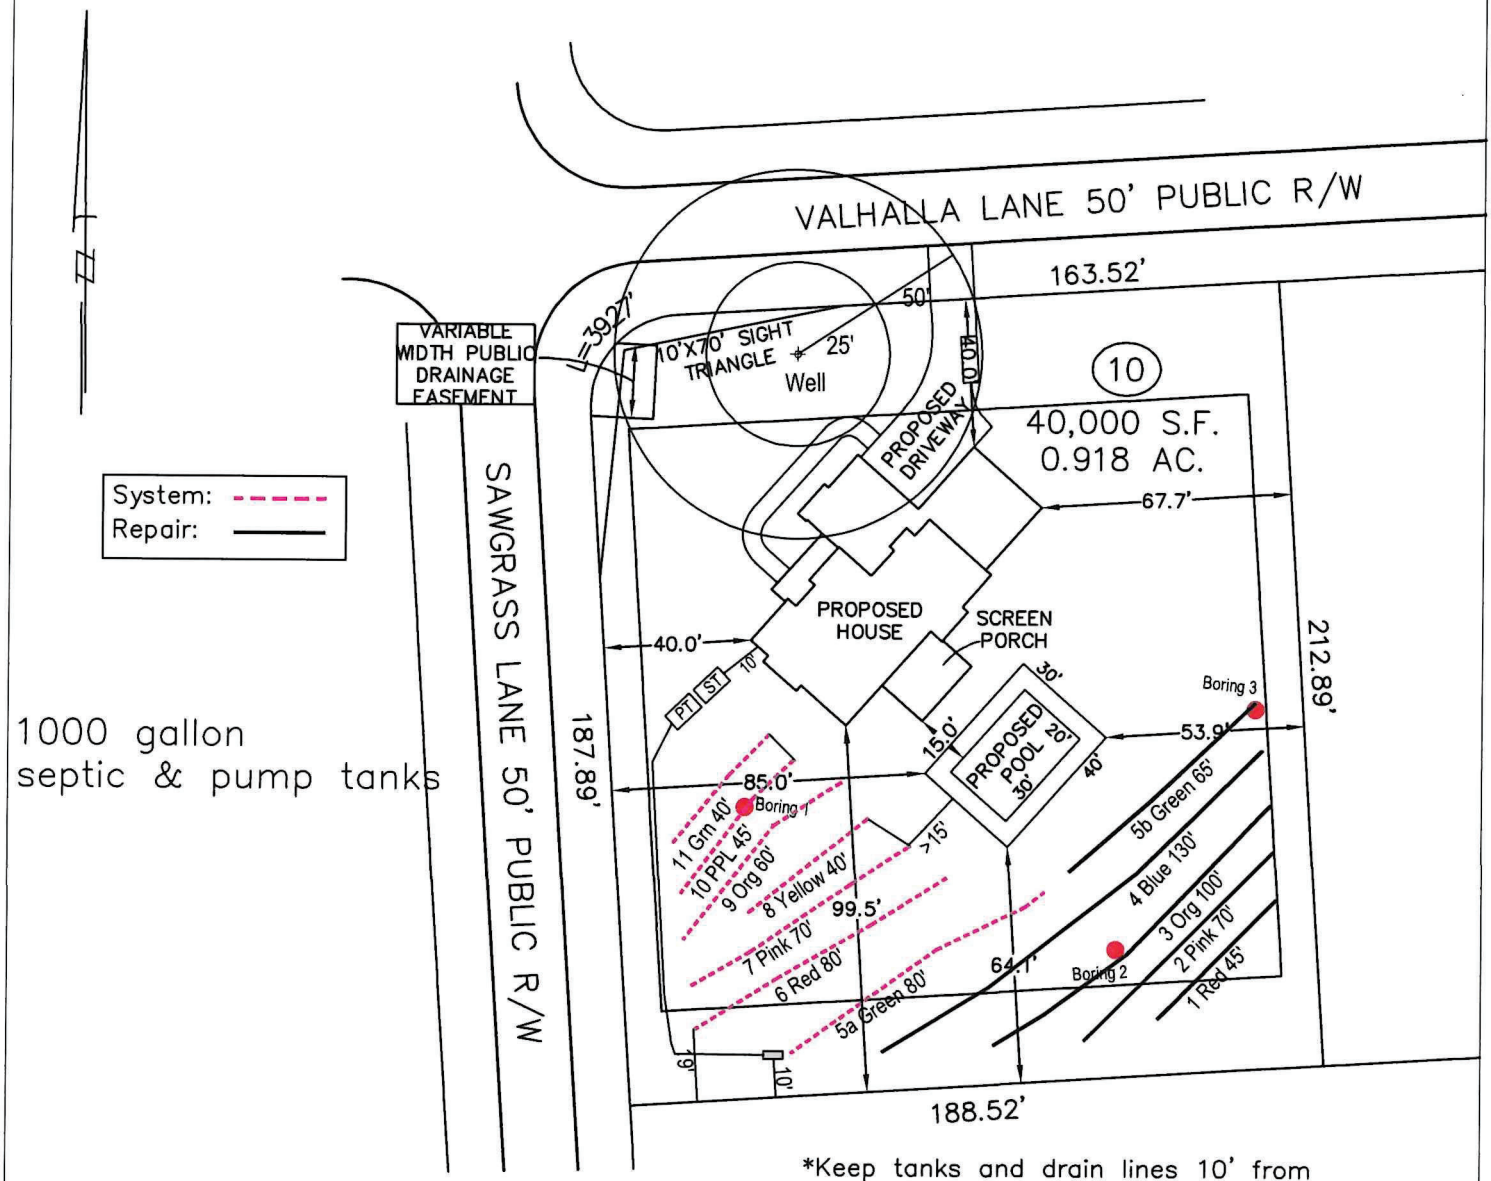


1000 gallon
septic & pump tanks

System: Pressure Manifold Lines: 5a–11, (415') Accepted Status System 0.3 Soil LTAR 24" TB
Repair: Pressure Manifold Lines: 1–5b, (410') Accepted Status System 0.3 Soil LTAR 24" TB

*Keep tanks and drain lines 10' from property lines.
*Not a survey.
*Not a guarantee of a septic permit.
*Keep supply lines >5' from property lines.
*Some lines are flagged longer in the field than lengths indicate.
*No grading septic area.
*No adding soil within septic area
*No rutting–up septic area
*No cuts of >2' within 15' of septic areas

GRAPHIC SCALE
1" = 50'

50 0 50 100

Central Carolina Soil Consulting, PLLC
1900 South Main Street, Suite 110
Wake Forest, North Carolina 27587
Phone (919)569-6704 Fax (919)569-6703

4-Bedroom Septic Layout
Lot 10, Glen Meadows Subdivision
Franklin County, North Carolina

Job#: 4870
Drawn By: JH
Date: 9/3/26
Revision: